
REV.

SUPPORTS LEGEND:

ISSUED FOR CONSTRUCTION

DESCRIPTION

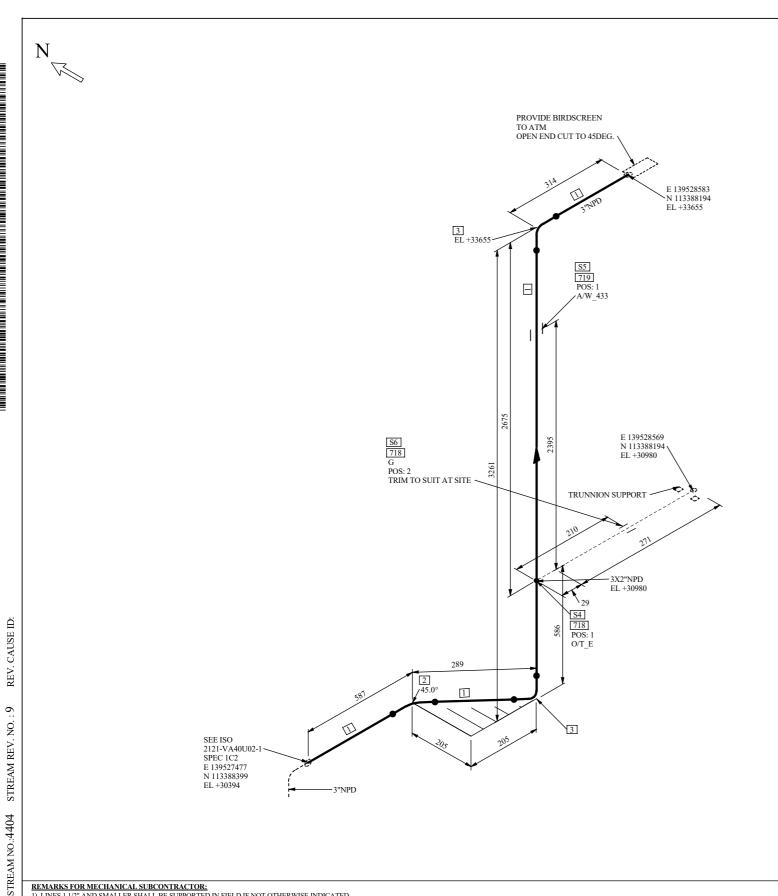

A=RESTING SUPPORT G=GUIDE F=AXIAL STOP B=ANCHOR M=SPRING S=TEFLON PAD WHERE A WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.

P.VAZE

CHECK BY

G.PAGANONI

APPR. BY

14-JUL-23

U.CHAVAN

TRESS CALC. Nº

PIPE LAYOUT Nº

APPR. CLIENT

19-A-19-000-1-01-00001 sheet 48

19-L-19-000-2-00-86196 sheet 8

19-L-19-000-2-00-80602

LINE

3"-VA-40U02-1C2

REMARKS FOR MECHANICAL SUBCONTRACTOR:

1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.

2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.

3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL ✗, ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT

4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.

6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.

8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603

BILL OF MATERIAL HOLD COMPONENT DESCRIPTION ITEM CODE QTY STATUS (IN) PIPE - A106-B BE SMLS T01AC03V02 S-STD < PIPA010B13STD > (L-7806) I117921 FITTINGS 45 LR ELBOW ASME B16.9 A234-WPB BE SMLS C02DC04V01 S-STD <45LA200F33STD> I201301 (L-7956) 90 LR ELBOW ASME B16.9 A234-WPB BE SMLS C01DC04V01 S-STD <90LA200F33STD> (L-7955) PIPE SUPPORTS WELDED EXTENSIONS-EW05 DN2 = 2 L = 300 U BOLT (FOR GUIDE)-P02D 719 STANDARD GUIDE FOR NOT INS. PIPING-N1G1 PIPE MATERIAL NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102 CS 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021 HEAT TREATMENT (PWHT) 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE" PAINTING SCHEME (3) CONTRACTOR: CONTRACTOR DRAWING NUMBER: PROJECT: PIPING CLASS 4001008 4274-XH-DL-2121VA40U02-2 WELDING CLASS (4) LOW LINEAL DENSITY POLYETHILENE (PEL) CLIENT / COMPLEX AND POLYPROPYLENE (PP) PLANTS REPSOL POLYMEROS/ PED CATEGORY FOR PROJECT - ALBA PROJECT SINES INDUSTRIAL COMPLEX Art 4.3 REPSQL INSULATION CODE / THK. (mm) ANNEX DRAWING NUMBER 00