


THIS DOCUMENT BELONGS TO REPSOL. IT CAN NOT BE COPIED, REPRODUCED AND/OR USED WITHOUT PREVIOUS AUTHORIZATION OF REPSOL. COMPUTERIZED DRAWING (HANDWRITING STRICTLY FORBIDDEN).

EXTR. DATE: 02-02-2024 18:05:31

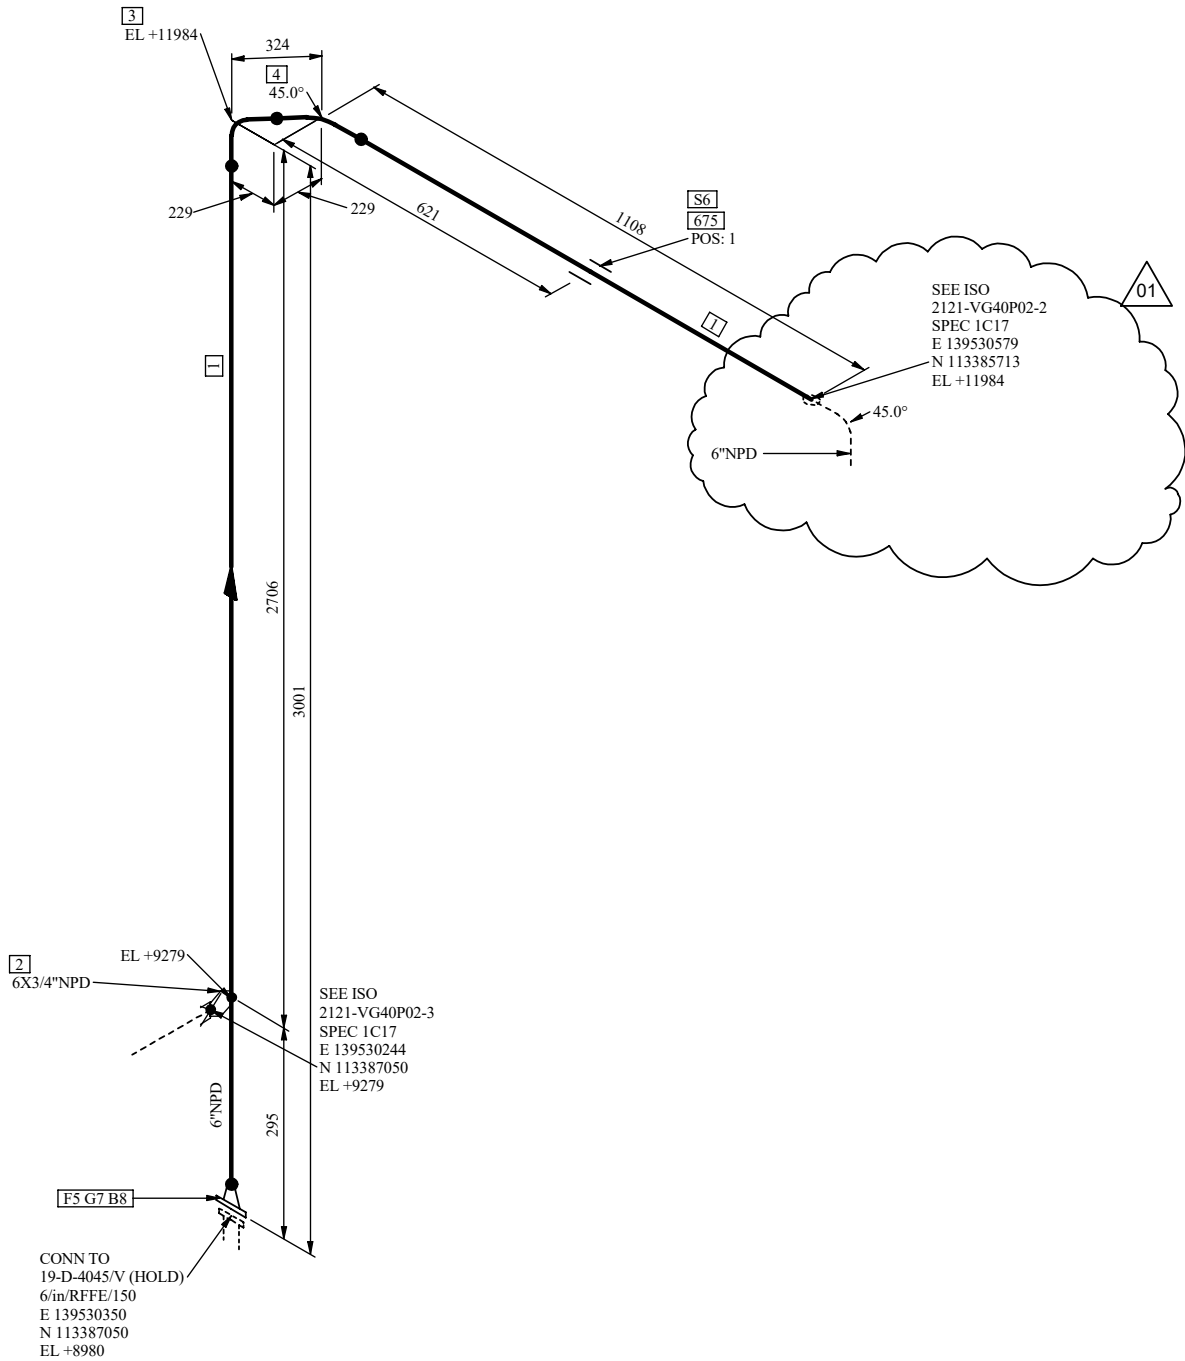


STREAM NO.: 3278

REV. CAUSE ID: 1



REMARKS FOR MECHANICAL SUBCONTRACTOR:

- 1) LINES 1.1/2" AND SMALLER SHALL BE SUPPORTED IN FIELD IF NOT OTHERWISE INDICATED.
- 2) ALL DIMENSION AND PROPER CONFIGURATION FOR LINES NPS 1.1/2" AND SMALLER SHALL BE CHECKED IN FIELD BEFORE CONSTRUCTION.
- 3) FOR THE COMPONENTS MARKED AS FIELD WELDED WITH THIS SYMBOL , ONE WELD FOR ADJUSTMENT OF IN LINE COMPONENT MUST BE LEFT
- 4) FOR EXTRA PIPE LENGTH REFER TO 4274-LZ-PC-00000603.
- 5) GUSSETING TO BE IMPLEMENTED BY MECHANICAL SUBCONTRACTOR AS PER 45-L-45-000-2-00-80004 / 4274-XH-SG-00000002.
- 6) CROSSING BETWEEN WELDS ON PIPELINE SHALL NOT BE ADMITTED.
- 7) IN CASE OF DISCREPANCIES BETWEEN DATA SHOWN ON ISO AND IN LINE LIST (AS APPLICABLE, DATA SHOWN IN LINE LIST GOVERN.
- 8) ACTUAL CUT LENGTH OF PIPE AND FIELD WELDS SHALL BE DEFINED BY MECHANICAL SUBCONTRACTOR (REF.TO 4274-LZ-PC-00000603).
- 9) WHERE EARTHING BONDING IS REQUIRED, MECHANICAL SUBCONTRACTOR TO PERFORM IT BASED ON DOC. 45-P-000-7-06-00902/ 4274 -NN-DW-00000002 AND ASSEMBLY NO FEA005 AND FE019.

SUPPORTS LEGEND:		 DENOTES PARTS LIST NO	PIPE SUPPORT		A=RESTING SUPPORT	G=GUIDE	F=AXIAL STOP	B=ANCHOR	M=SPRING	S=TEFLON PAD
		WHERE  WITHOUT NUMBERING IS INDICATED, THIS MEANS THAT THERE IS A REST DIRECTLY ON STEEL STRUCTURE.								

							STRESS CALC. N°
							-
01	ISSUED FOR CONSTRUCTION	05-FEB-24	M.YADAV	P.VAZE	G.PAGANONI		P & ID 19-A-19-000-1-01-00001 sheet 45
00	ISSUED FOR CONSTRUCTION	07-APR-2023	M.YADAV	P.VAZE	G.PAGANONI		LINE LIST N° 19-L-19-000-2-00-80602
REV.	DESCRIPTION	DATE	DRW. BY	CHECK BY	APPR. BY	APPR. CLIENT	PIPE LAYOUT N° 19-L-19-000-2-00-86196 sheet 3

APPROVED FOR CONSTRUCTION



Signature for construction is shown on Iso list of relevant CWA

ISOMETRIC DRAWING LINE

6"-VG-40P02-1C17

BILL OF MATERIAL

PT NO	COMPONENT DESCRIPTION	N.S. (IN)	ITEM CODE	QTY	HOLD STATUS
PIPE					
1	PIPE - A106-B BE SMLS T01AC03V02 S-STD <PIPA010B16STD> (L-7806).	6	I117981	3.7 M	
FITTINGS					
2	REDUCING SOCKOLET MSS-SP-97 3000# A105N BE SWE - R13DNC44V101 NREQD <SOKA300LB01711> (L-343).	6X3/4	I1651371	1	
3	90 LR ELBOW ASME B16.9 A234-WPB BE SMLS C01DC04V01 S-STD <90LA200F36STD> (L-7955).	6	I128667	1	
4	45 LR ELBOW ASME B16.9 A234-WPB BE SMLS C02DC04V01 S-STD <45LA200F36STD> (L-7956).	6	I201303	1	
FLANGES					
5	WN FLANGE ASME B16.5 150# A105N RFFE BE 125 - 250 AARH F01CDC44BV05 S-STD <WNFA300R156STD> (L-149).	6	I4067788	1	
PIPE SUPPORTS					
6	VERT.TRESTLES WELDED TO STR TR34 HEA100	6	675	1	
GASKETS					
7	SPIRAL WOUND GASKET ASME B16.20 150# RFTBE 304/GRAFOIL CARBON STEEL SS 304 ASME B16.5 G03GDP1IS12 <N/A> (N/A)	6	I63508932	1	
BOLTS					
8	STUD BOLTS&NUTS ASME B18.31.2/ B18.2.2 A193-B7/A194-2H INCH SIZE I01OB0301 <SB2R51G3/441/4> - 2 NUTS PER BOLT - 105 mm Length	3/4	I53437464	8	

PIPE MATERIAL		NOTES: 1. FOR TECHNICAL DETAILS SEE LINE LIST. 2. FOR VENT, DRAIN OR INSTRUMENT CONNECTION DETAILS SEE 45-L-45-000-2-00-80102. 3. WELDING ACCORDING TO 45-L-45-000-2-00-80021. 4. PAINTING ACCORDING TO 45-A-45-000-1-00-20160. 5. CODE SHOWN IN BOM BETWEEN "<" & ">" DENOTES REPSOL UNICODE. "<N/A>" MEANS UNICODE IS "NOT AVAILABLE".			
CS					
HEAT TREATMENT (PWHT)					
N					
PAINTING SCHEME (3)			CONTRACTOR:	CONTRACTOR DRAWING NUMBER: 4274-XH-DL-2121VG40P02-1	PROJECT: 4001008
1					
PIPING CLASS					
IC17					
WELDING CLASS (4)		 <div>LOW LINEAL DENSITY POLYETHYLENE (PEL) AND POLYPROPYLENE (PP) PLANTS FOR PROJECT - ALBA PROJECT</div> <div>CLIENT / COMPLEX REPSOL POLYMEROS/ SINES INDUSTRIAL COMPLEX</div>			
E					
PED CATEGORY					
II					
INSULATION CODE / THK. (mm)		ANNEX 19	SPEC. L	DRAWING NUMBER 19-000-2-02-00001 sheet 2121VG40P02-1	REV. 01
N 0					