PROPOSED RESIDENTIAL HOUSE TO BE BUILT AT KINONDONI, DAR ES SALAAM, TANZANIA.



0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE TO BE BUILT AT PLOT NO. 70, BLOCK 41 AT KINONDONI MUNICIPALITY DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name

COVER PAGE


Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040 honesty@gmail.com

ARUSHA , TANZANIA

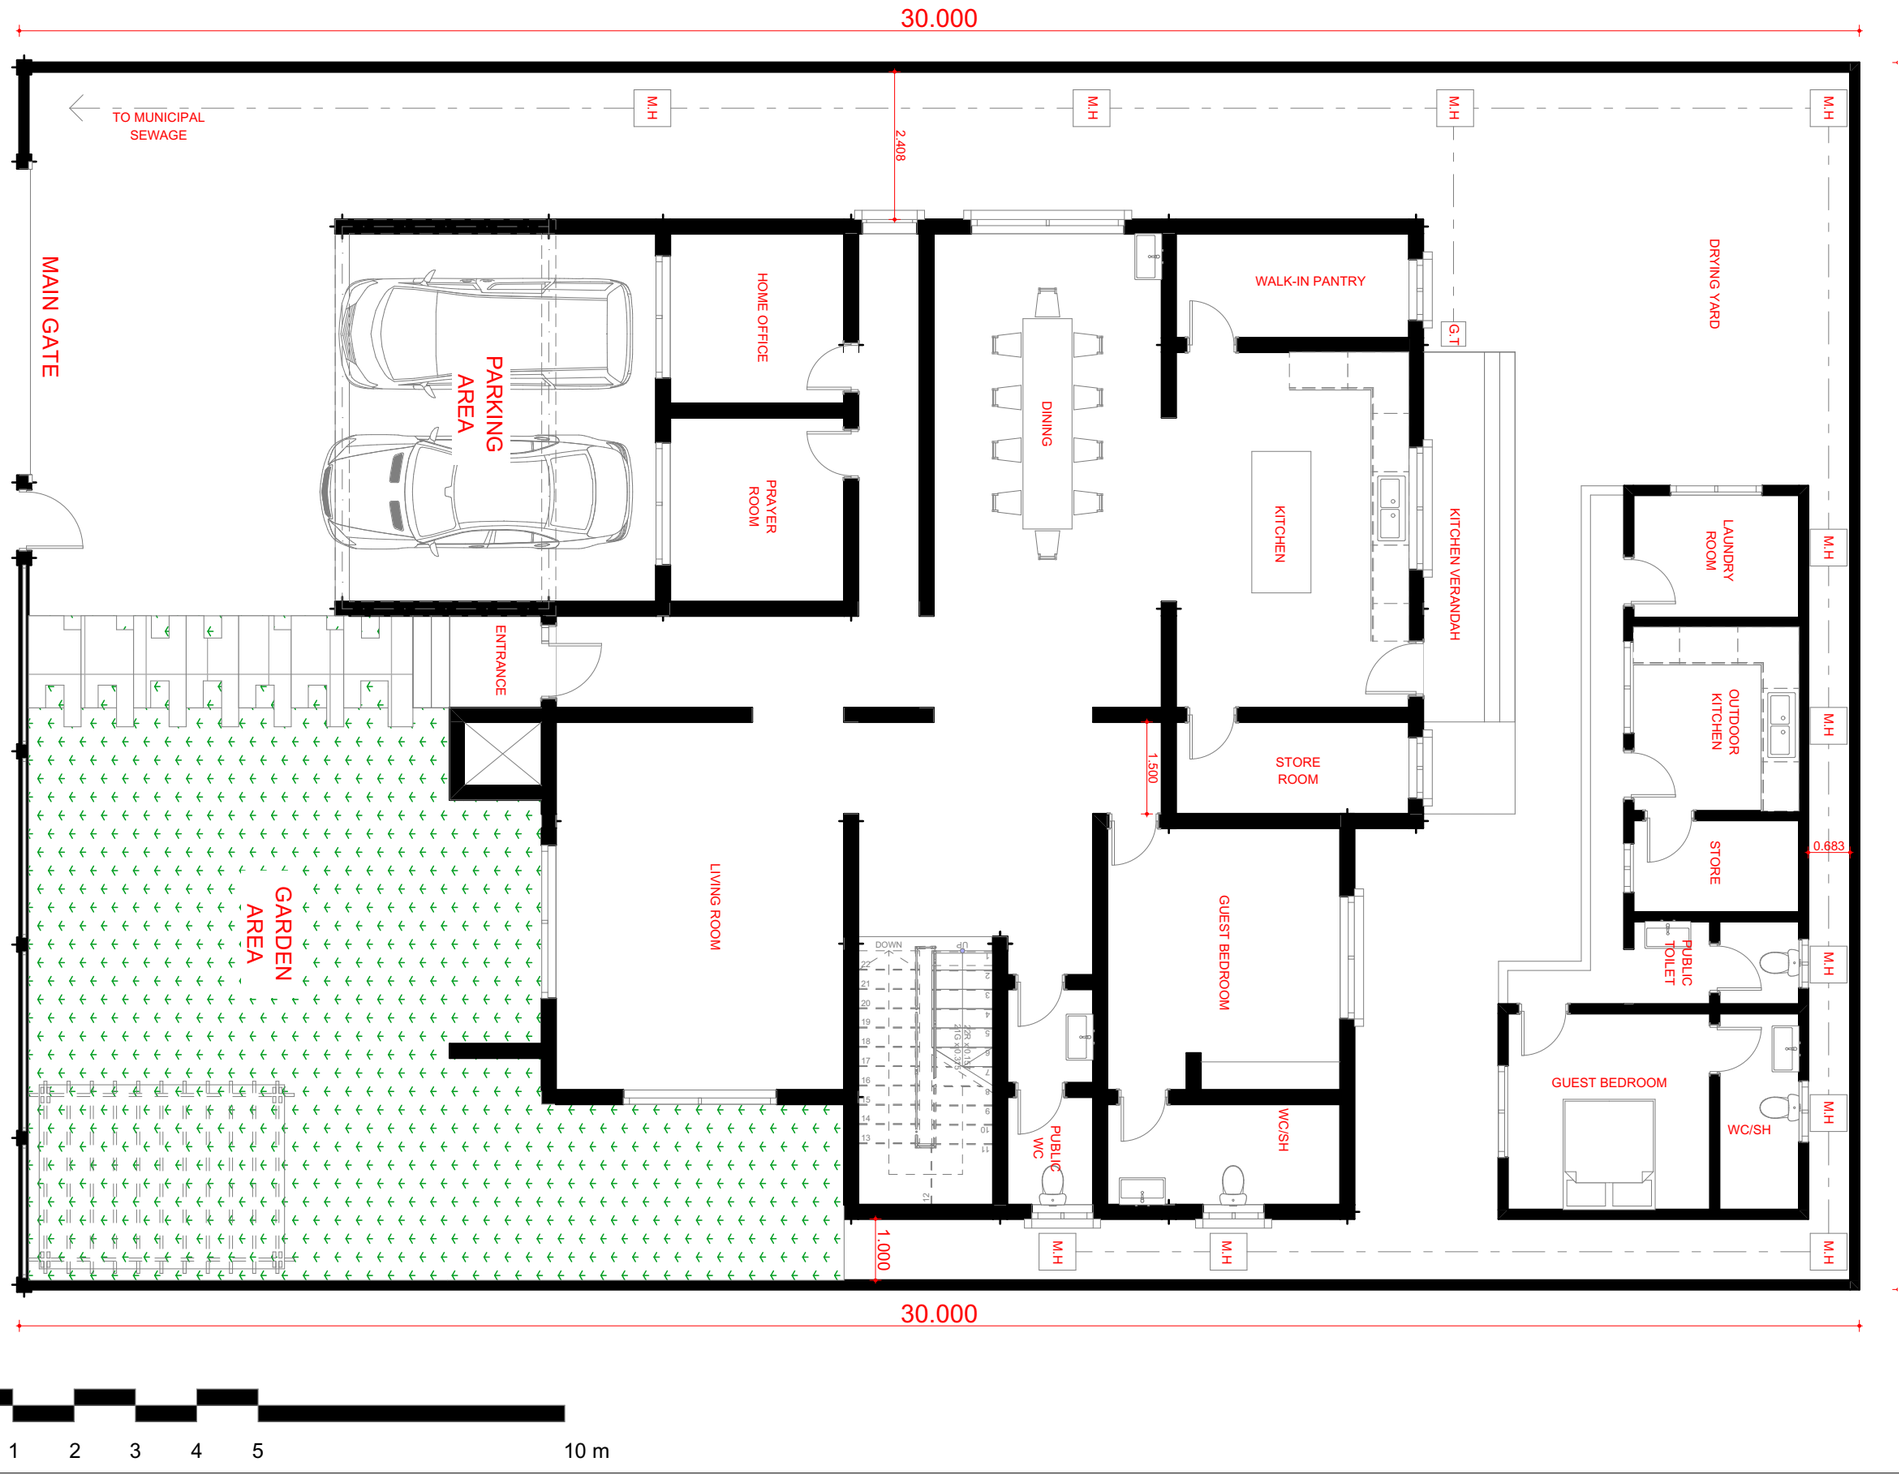

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


SITE LAYOUT PLAN

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-100

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

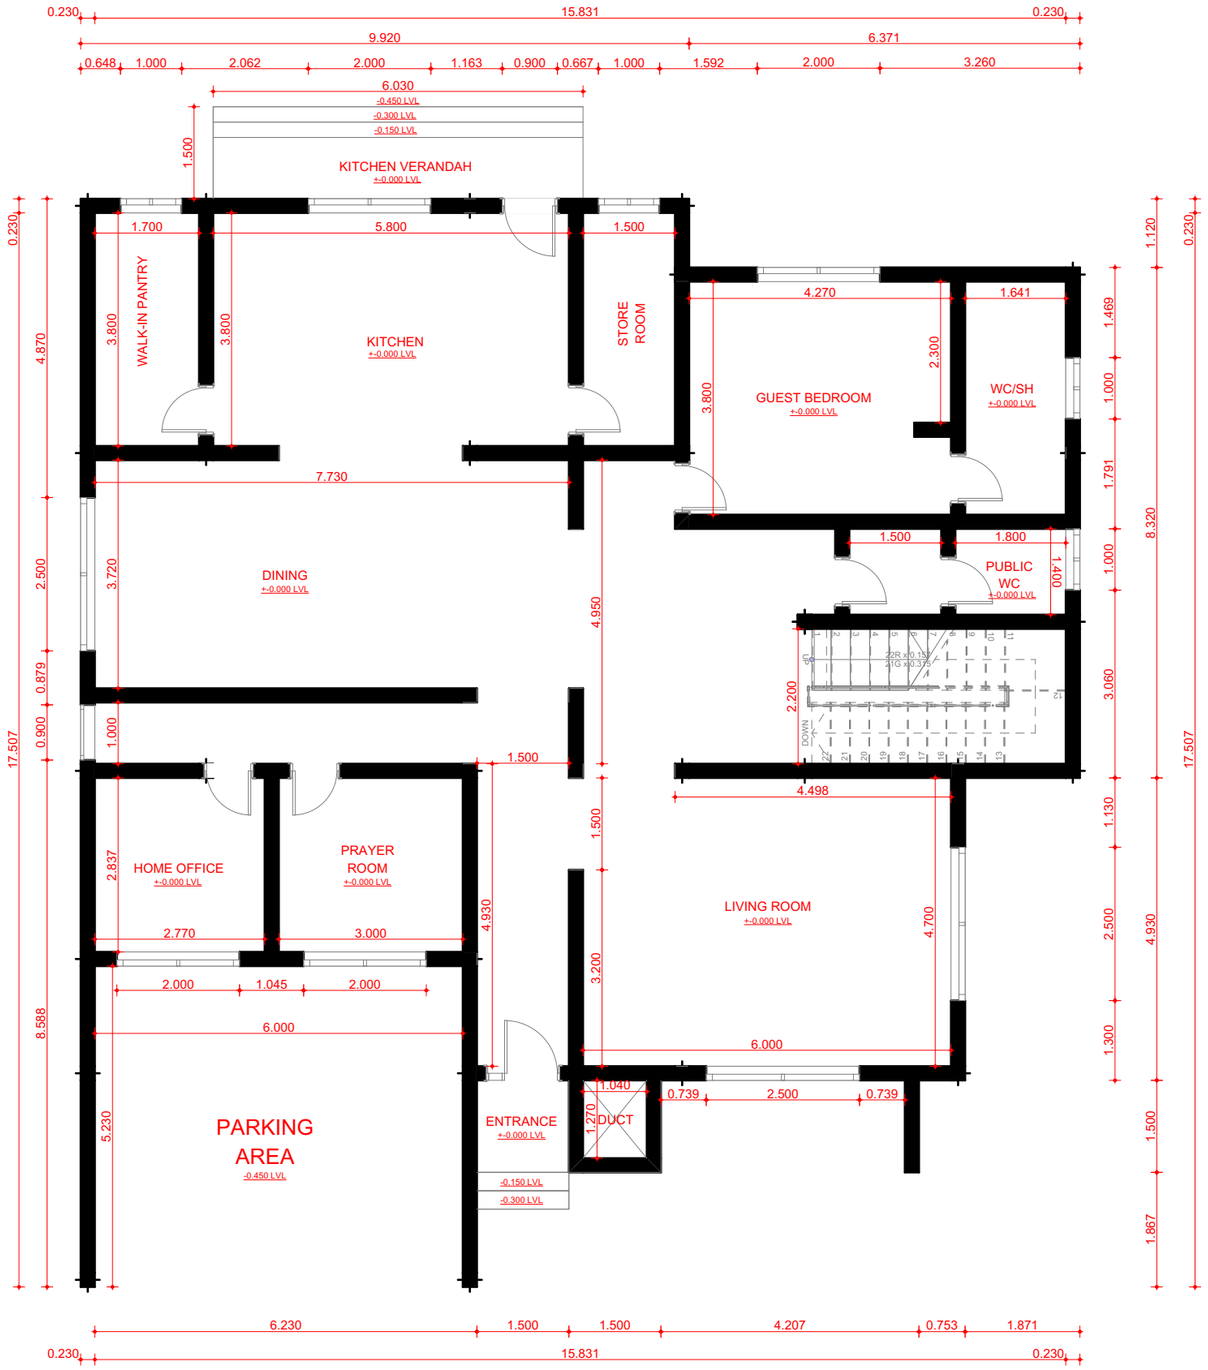

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


GROUND FLOOR PLAN
(Dimension Details)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-101

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

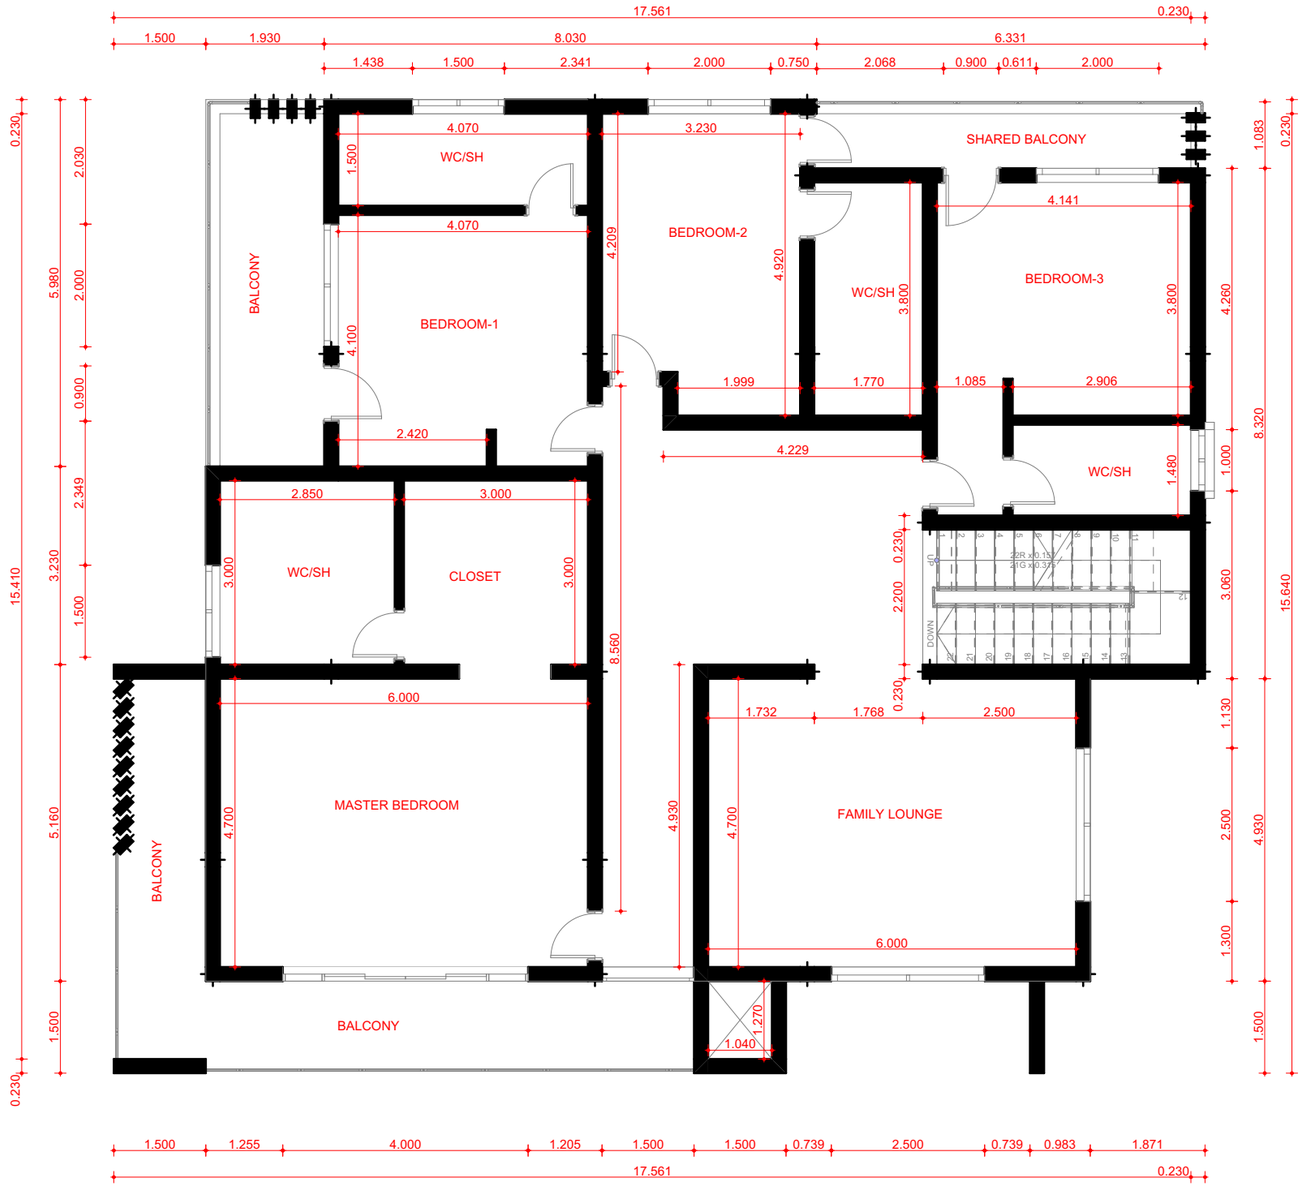

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


FIRST FLOOR PLAN
(Dimension Details)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-102

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

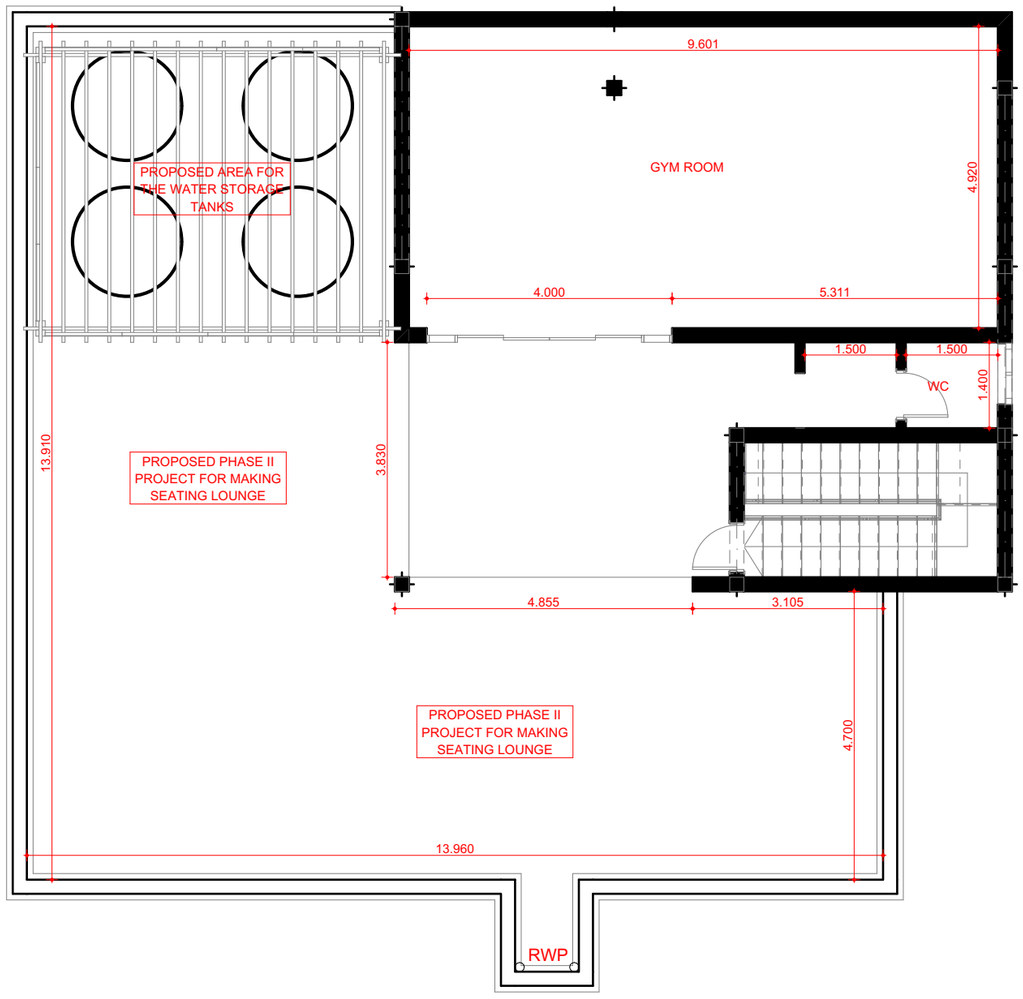

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


SECOND FLOOR PLAN
(Dimension Details)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-103

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

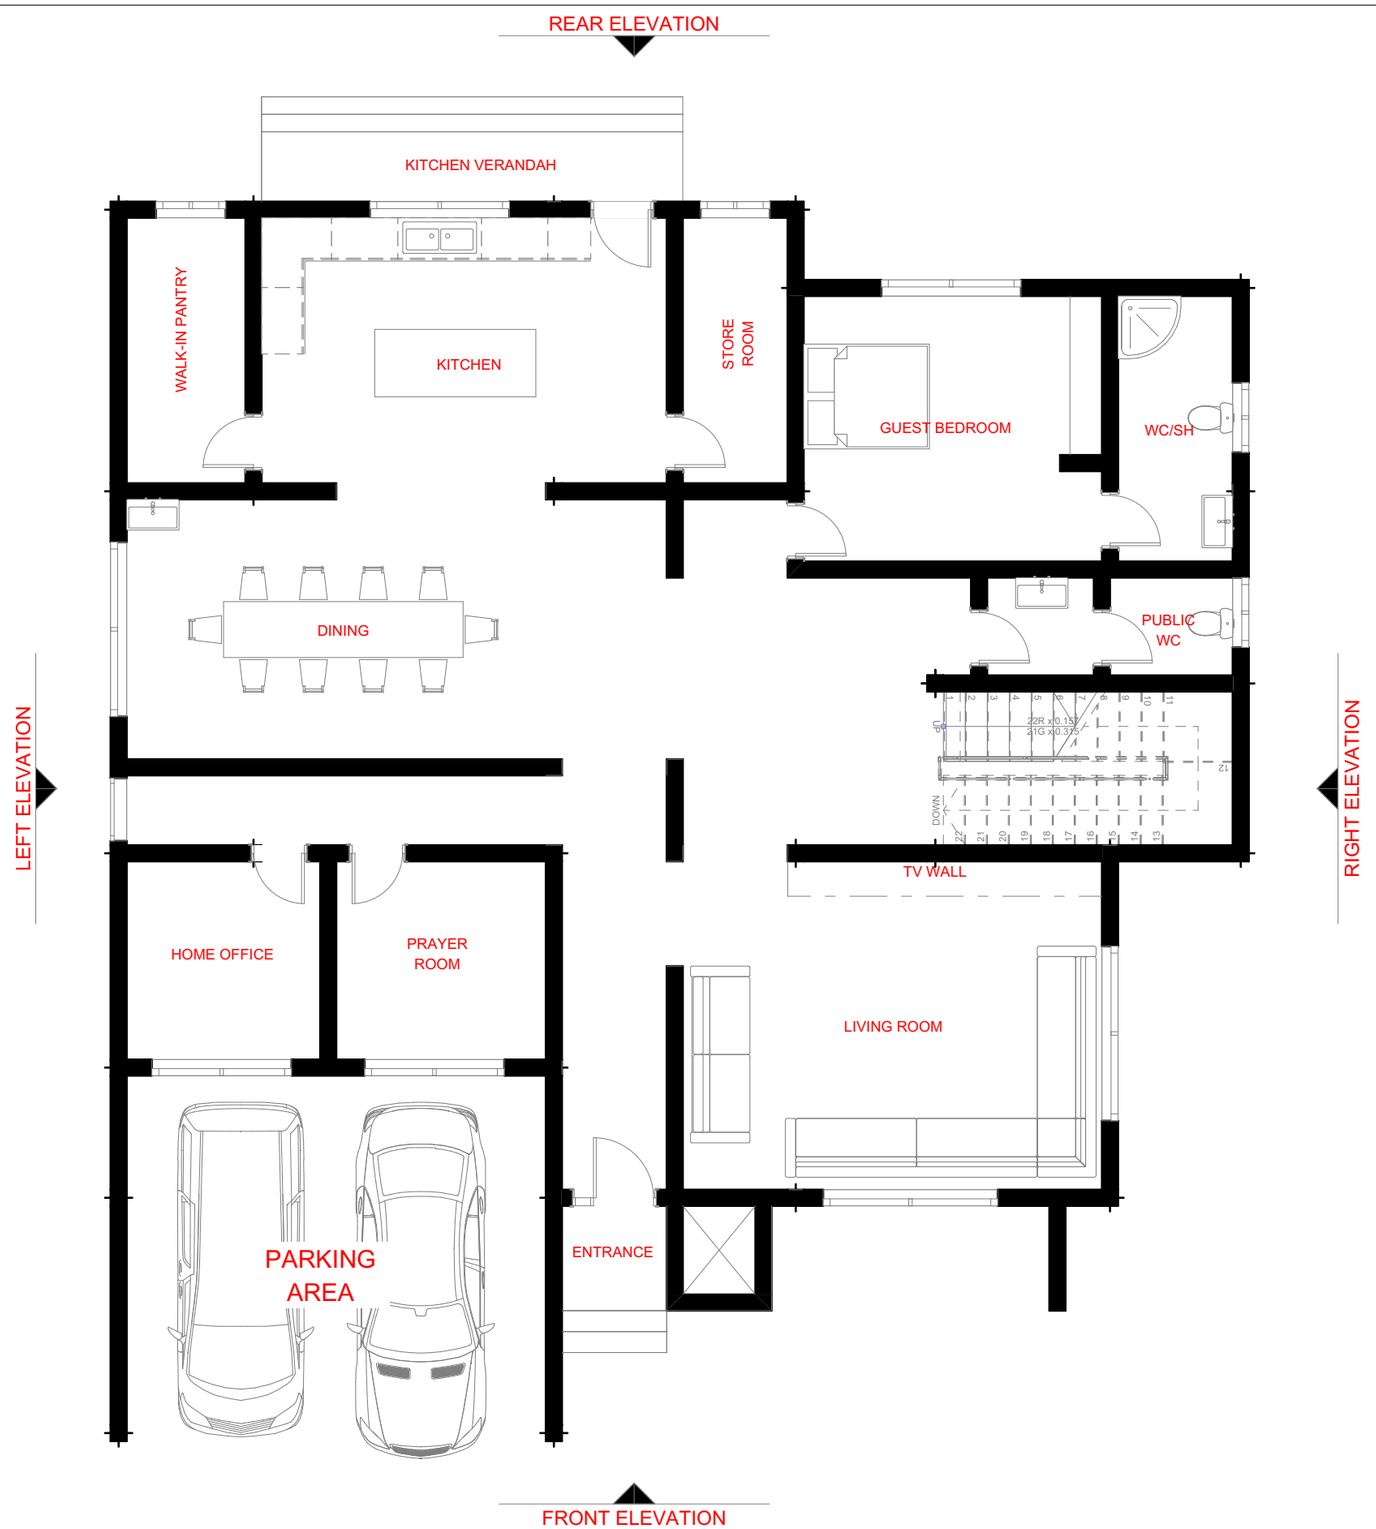

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


GROUND FLOOR PLAN
(Furniture Layout)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-104

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

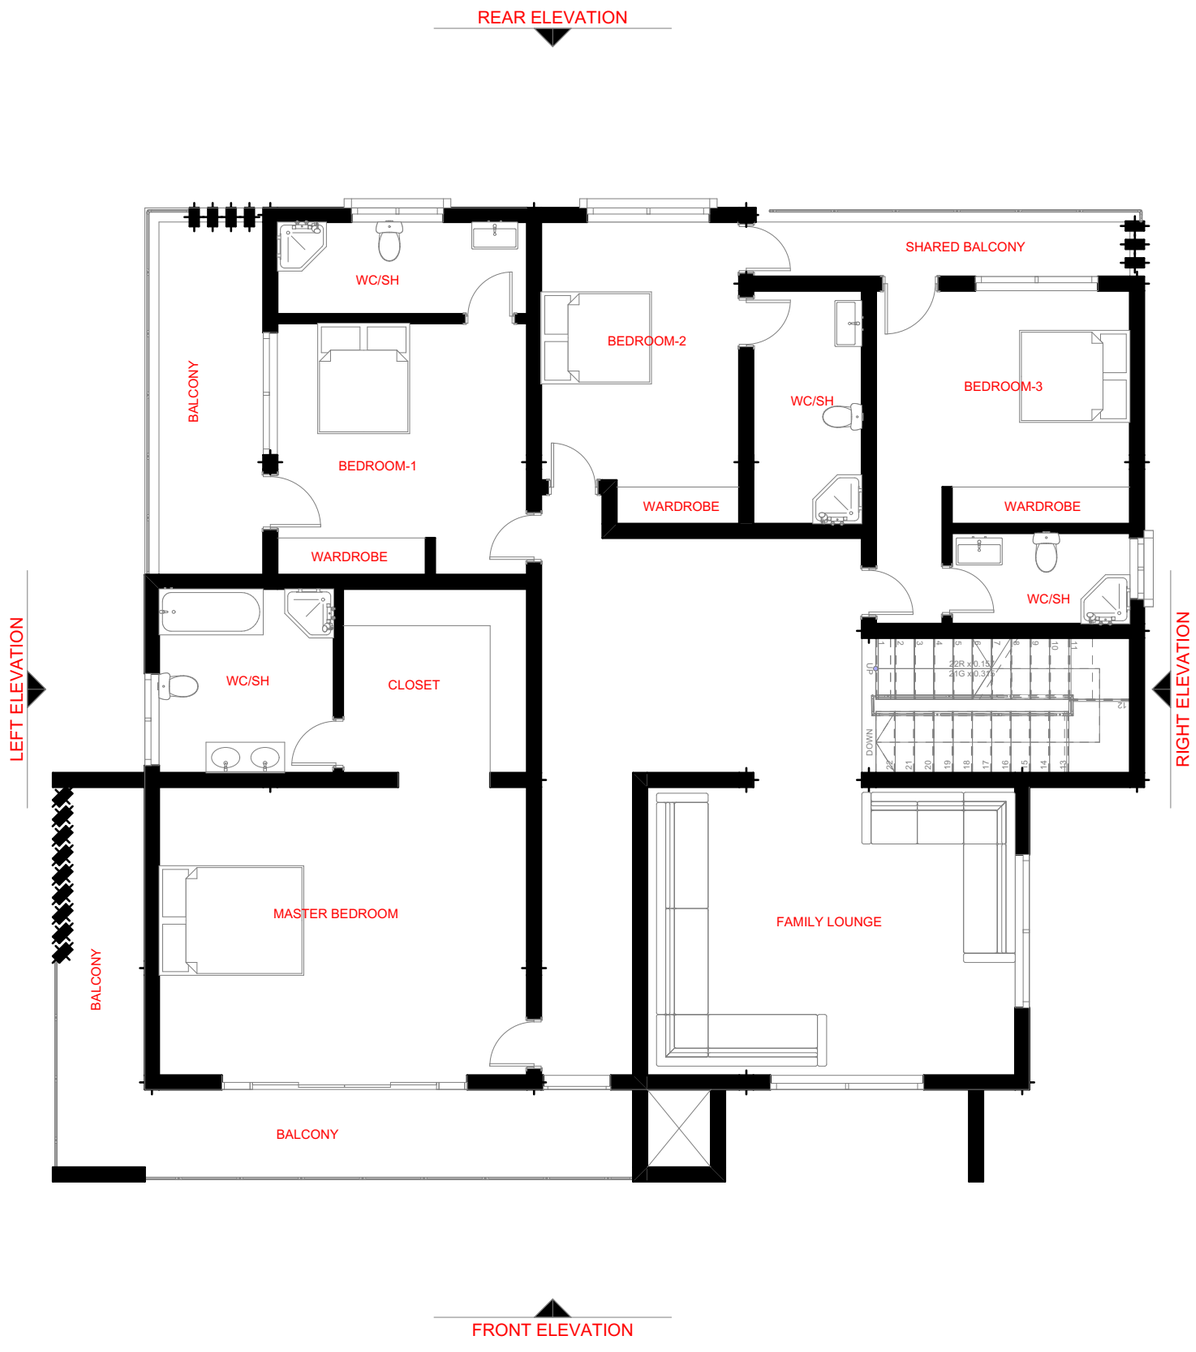

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name

FIRST FLOOR PLAN
(Furniture Layout)


Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-105

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

REAR ELEVATION

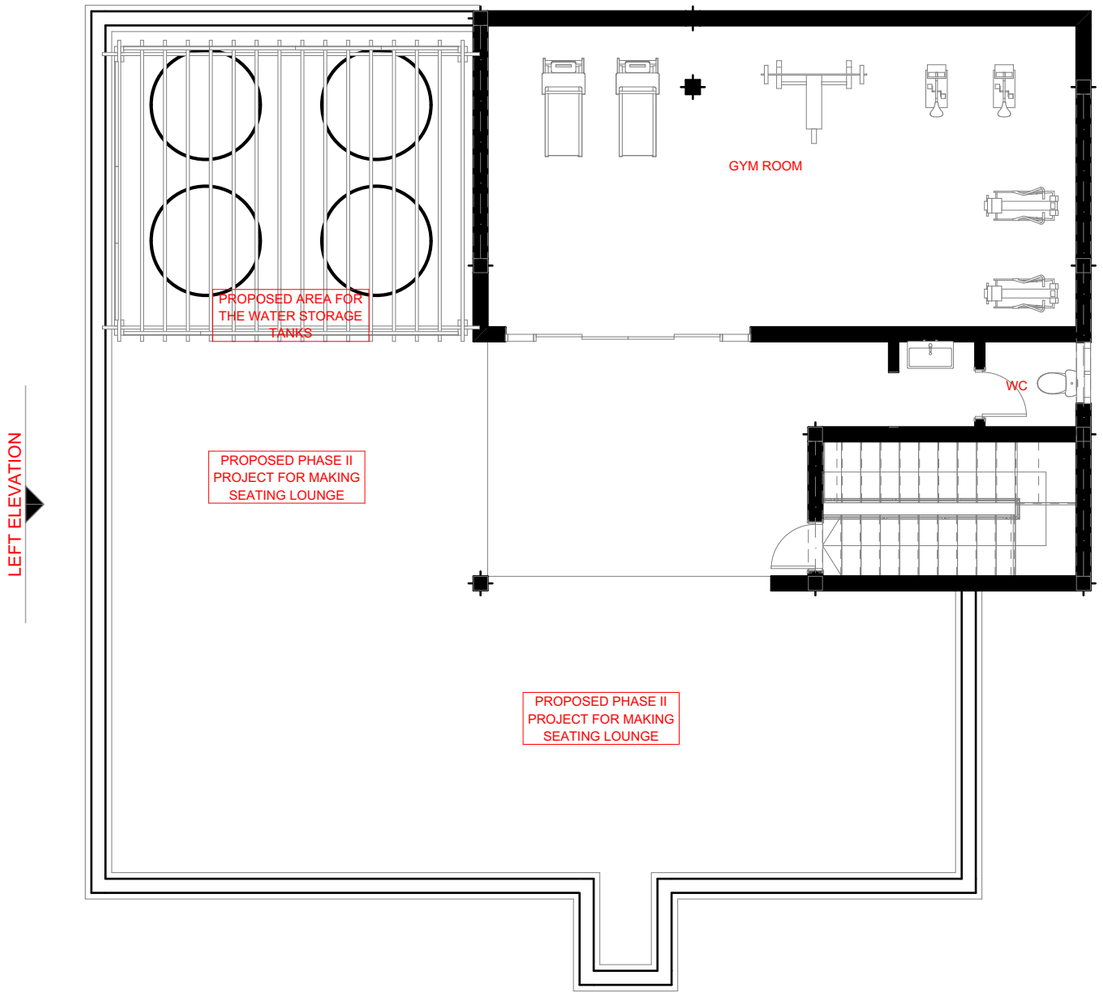

LEFT ELEVATION

RIGHT ELEVATION

FRONT ELEVATION

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name

SECOND FLOOR PLAN
(Furniture Layout)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date


Drawing Scale	Revision	Drawing No.
1:100	A	A-106

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA



FRONT ELEVATION

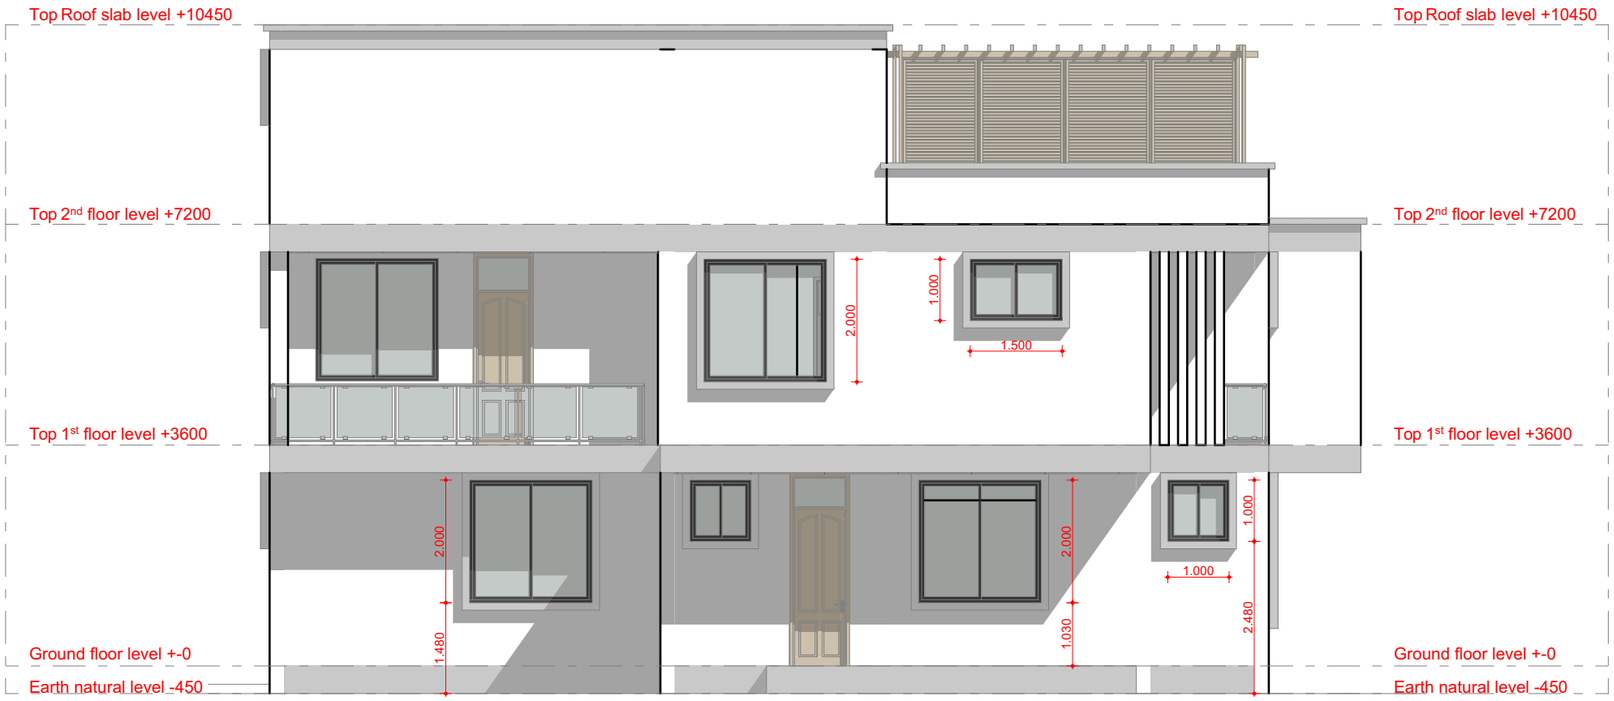

REAR ELEVATION

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


ELEVATION - 01

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-107

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

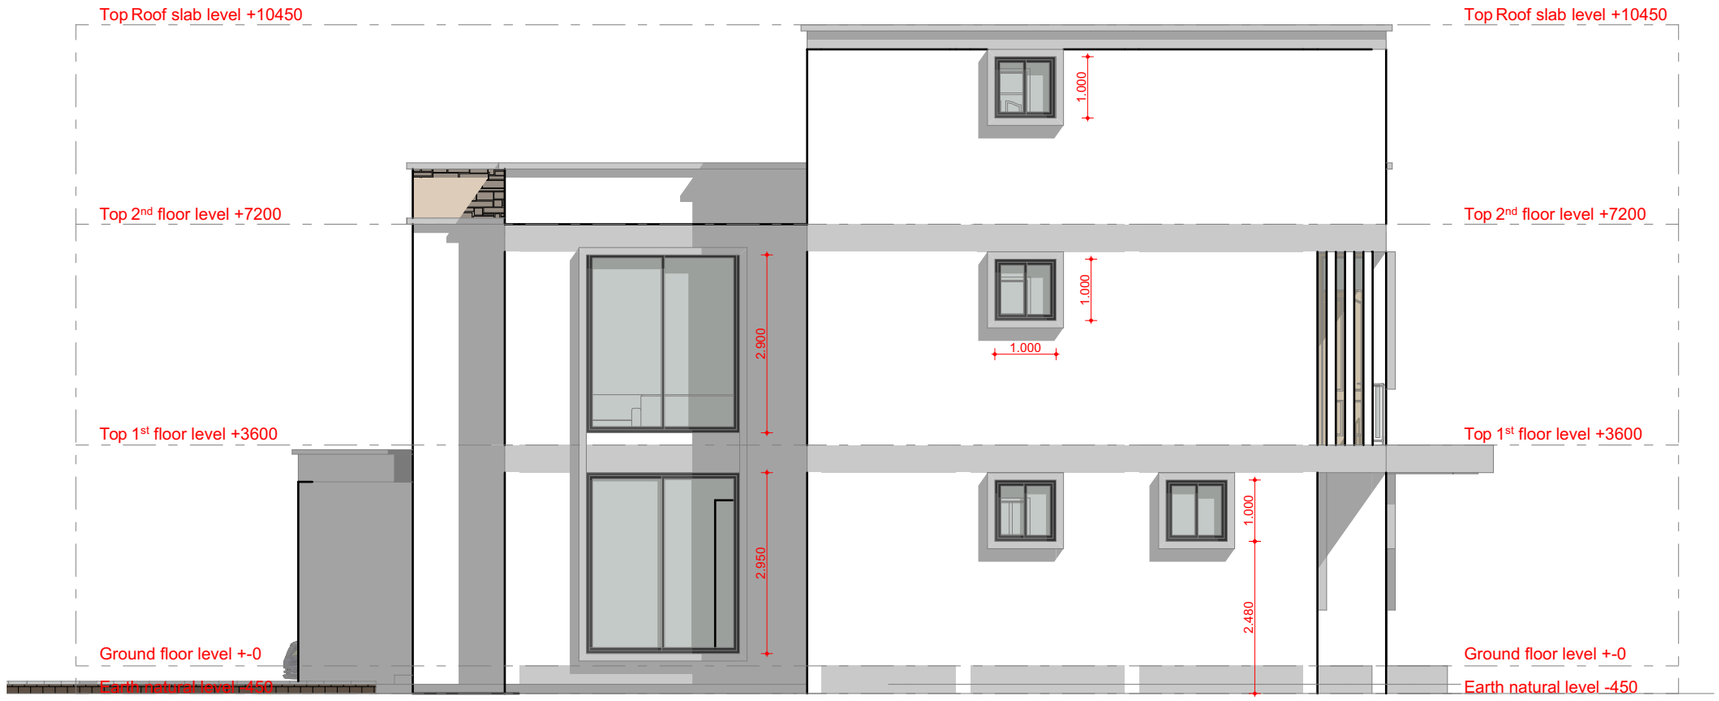

RIGHT ELEVATION



LEFT ELEVATION

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


ELEVATION - 02

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-108

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

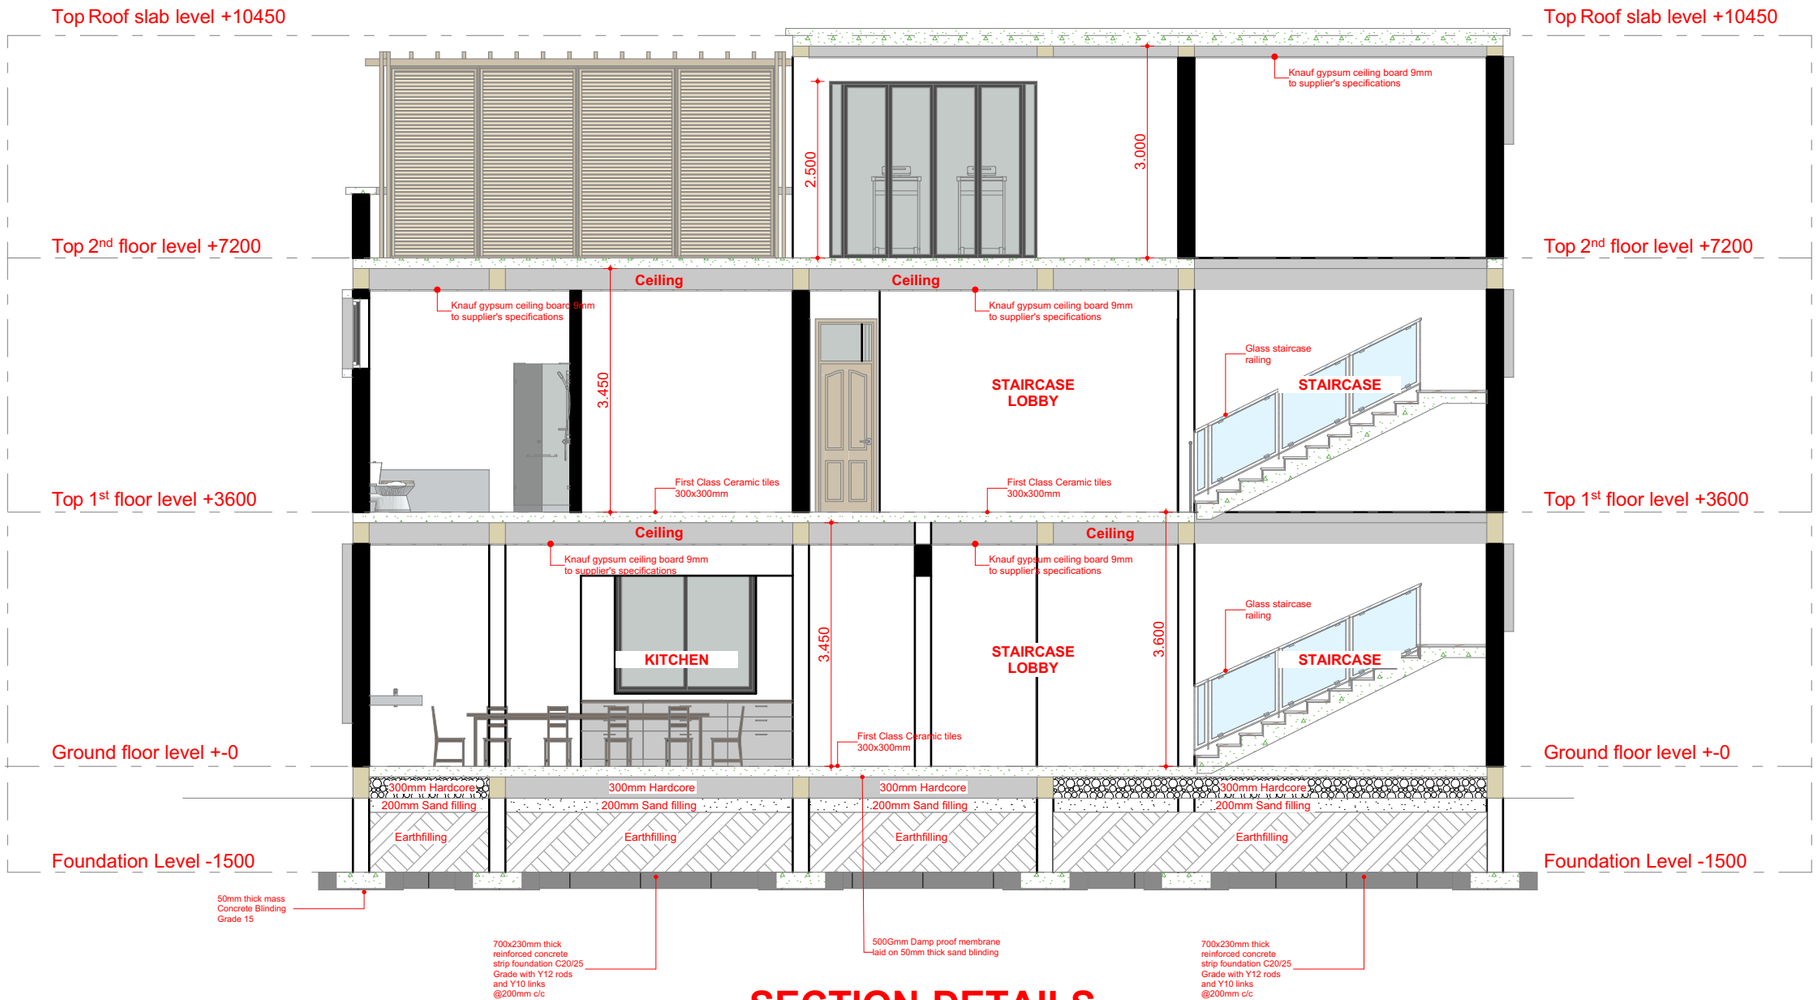

SECTION DETAILS

PLASTERING
1.INTERNAL PLASTERING
a. COAT 1 (COARSE) SHALL BE A MINIMUM OF 5 MM THICK 1:3 CEMENT AND SAND MORTAR.
b. COAT 2 (COARSE) SHALL BE ABOUT 7 MM THICK 1:8 CEMENT AND SAND MORTAR.

2.EXTERNAL PLASTERING
a. COAT 1 (COARSE) SHALL BE A MINIMUM OF 5 MM THICK 1:3 CEMENT AND SAND MORTAR.
b. COAT 2 (COARSE) SHALL BE ABOUT 10 MM THICK 1:8 CEMENT AND SAND MORTAR.
c. COAT 3 (FINE) SHALL BE A FINISHING COAT APPROXIMATELY 3 MM THICK OF CEMENT: LIME: SAND IN PROPORTIONS OF 1:4:10.
IT SHALL BE WELL RUBBED AND SMOOTHED DOWN WITH STEEL TROWELS AND FELT BOARDS FLUSH WITH THE DOOR JAMBS.

PUTTY
LIME BASED PUTTY SHALL BE APPLIED MINIMUM 2 COATS TILL UNEVENESS IS REMOVED FOR BOTH INTERNAL AND EXTERNAL SURFACES.

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)


Drawing Name


SECTION DETAILS

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-109

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE
+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

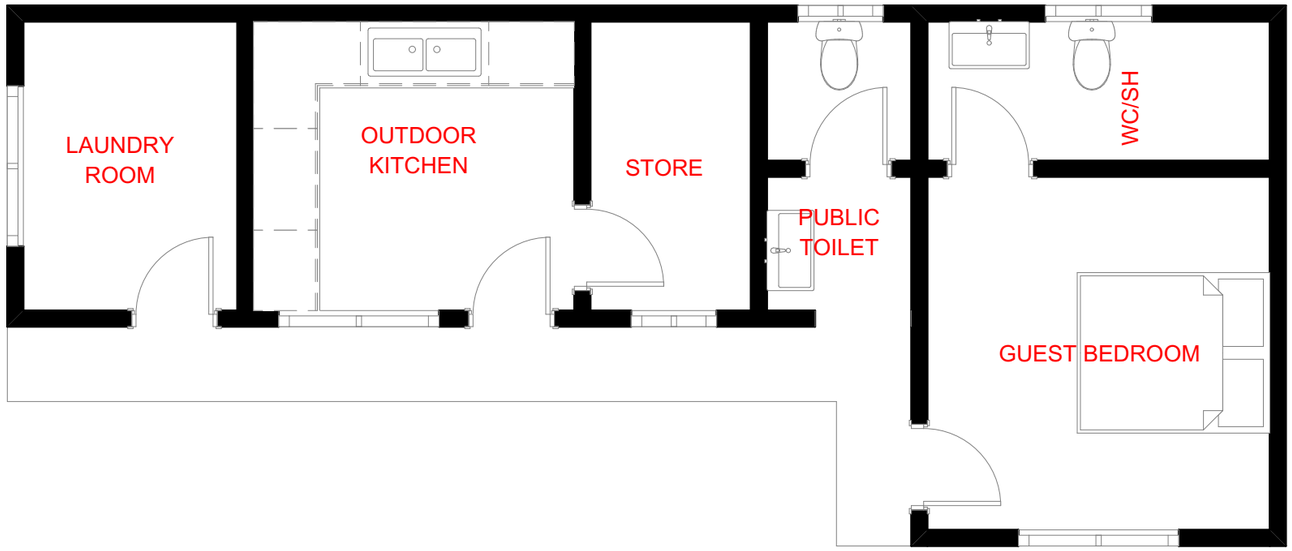

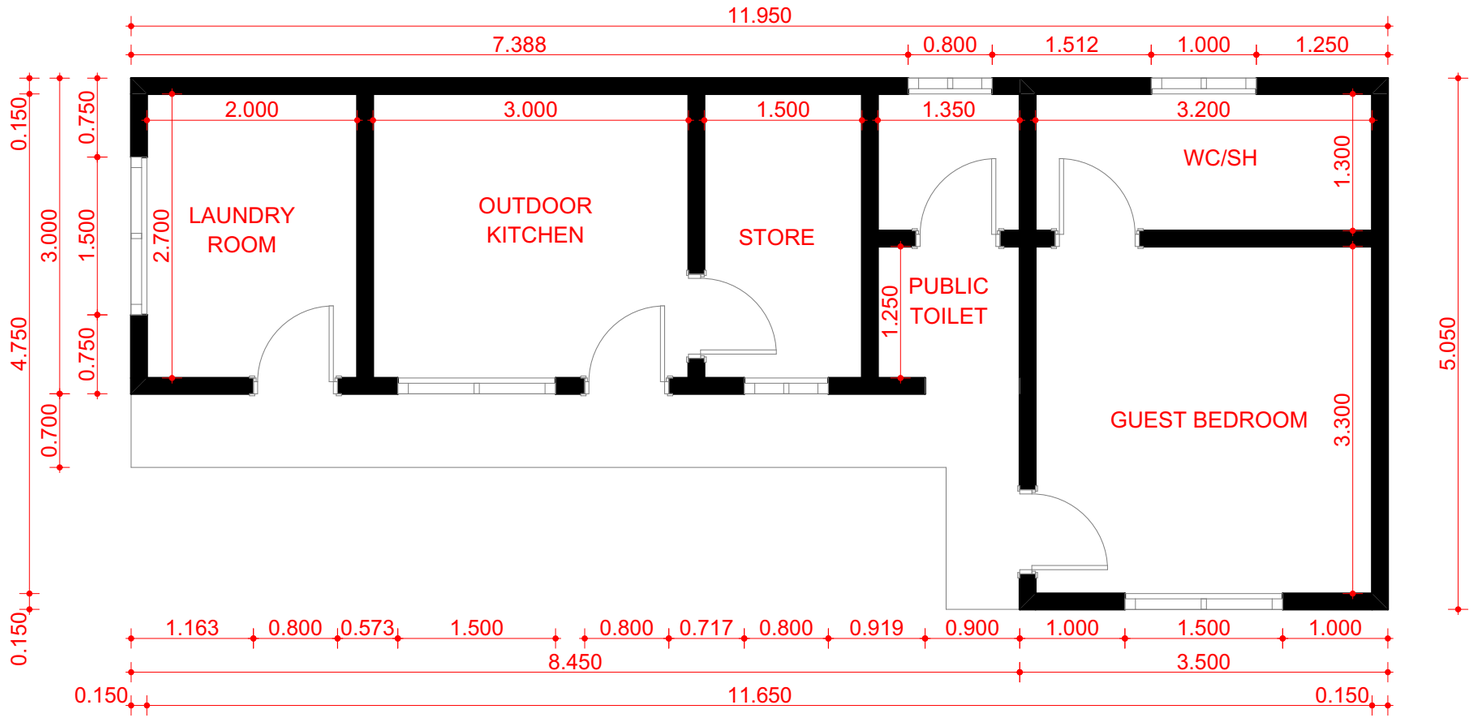



GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STAFF HOUSE FLOOR PLAN
(Dimension Details)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date


Drawing Scale	Revision	Drawing No.
1:100	A	A-110

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

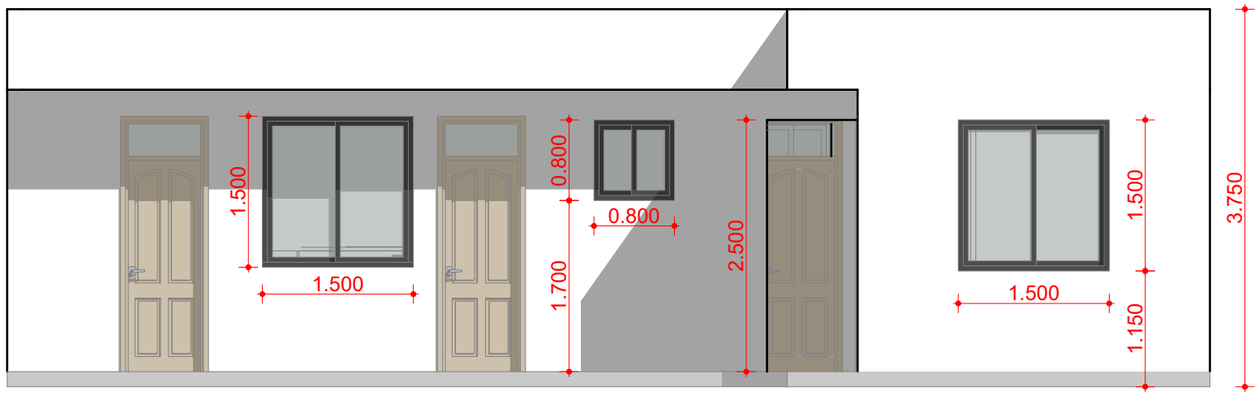


FRONT ELEVATION

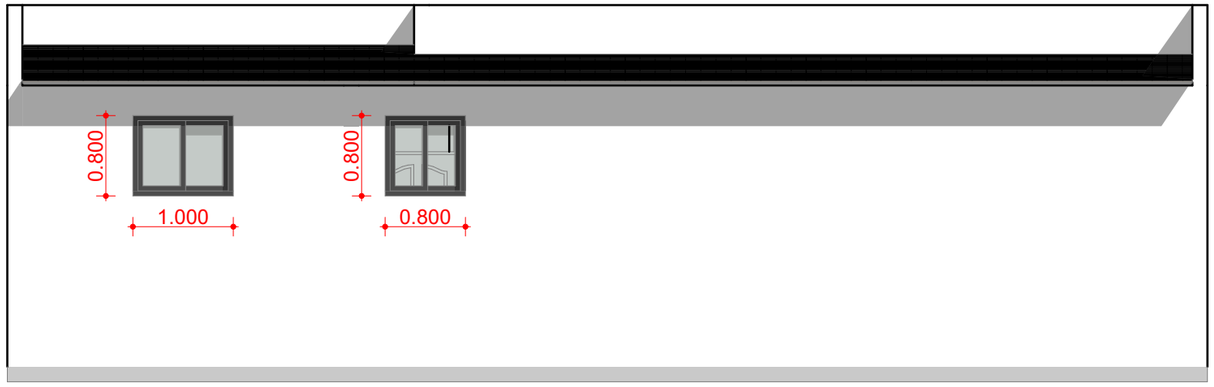

REAR ELEVATION



RIGHT ELEVATION

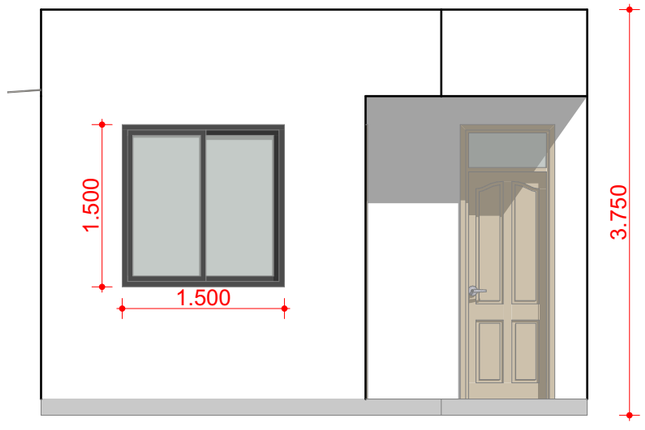

LEFT ELEVATION

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STAFF HOUSE ELEVATIONS

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-111

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

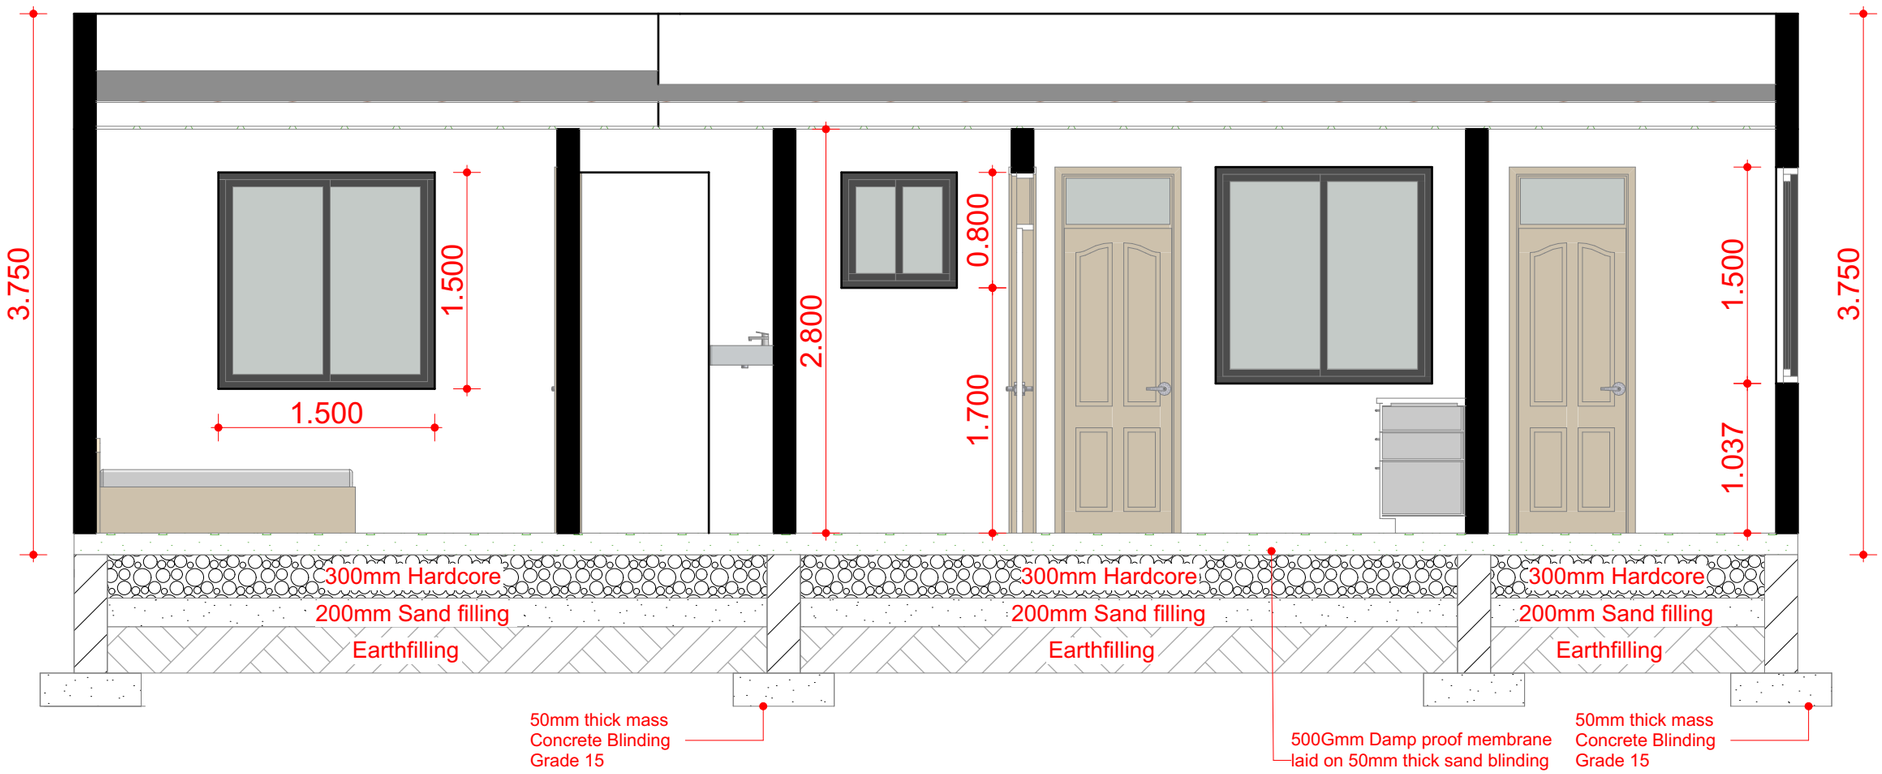

SECTION DETAILS

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title
PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.


Client Name
MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name
STAFF HOUSE SECTION DETAILS

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	A-112

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE
+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

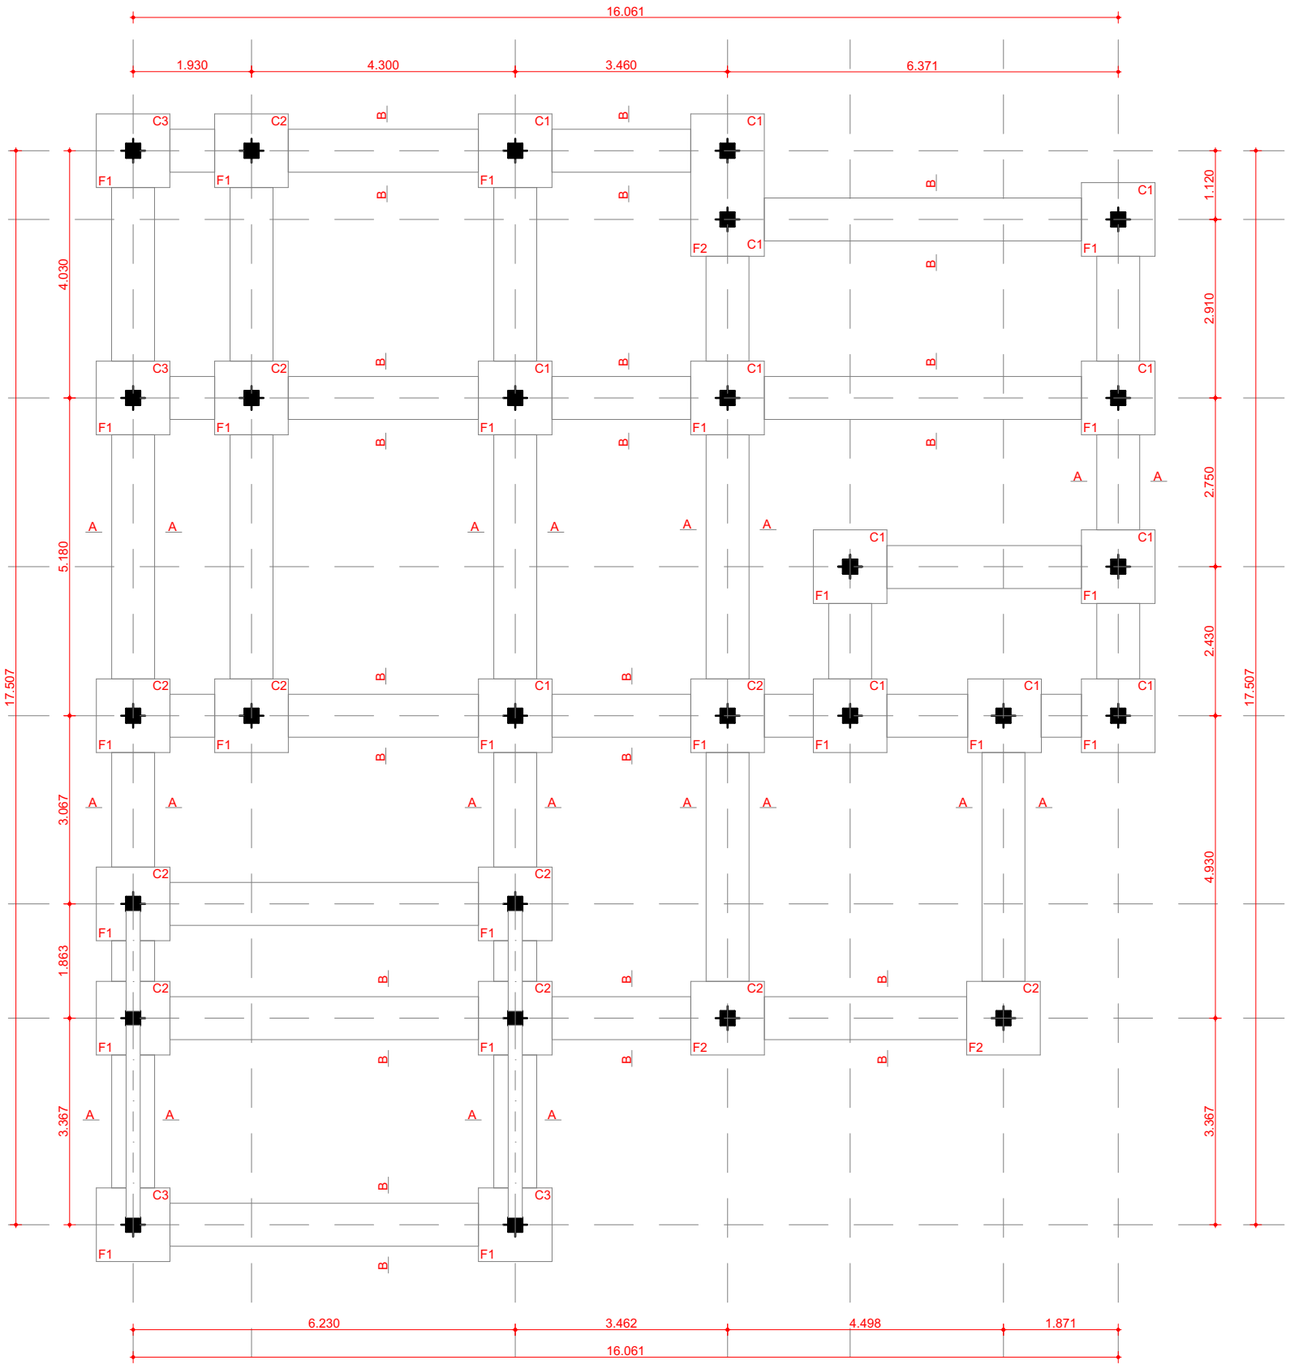

FOUNDATION PLAN

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STRUCTURAL DRAWING
(FOUNDATION PLAN)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date


Drawing Scale	Revision	Drawing No.
1:100	A	ST-01

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE


+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

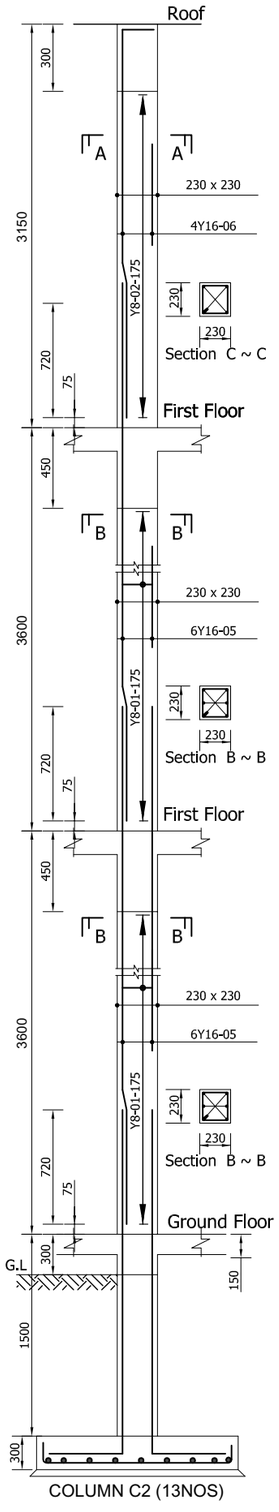


COLUMN C2 (13NOS)

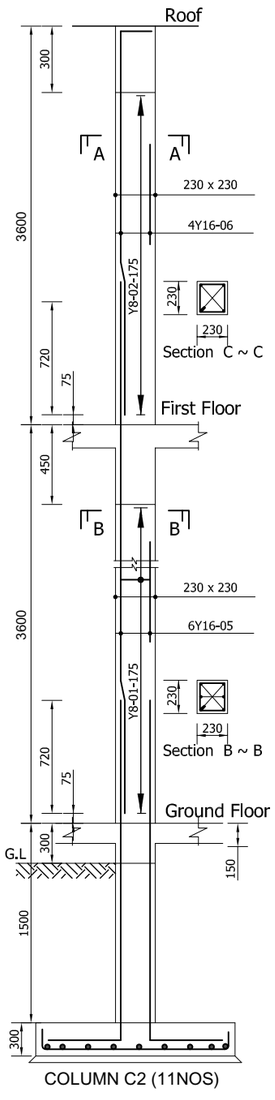


COLUMN C2 (11NOS)

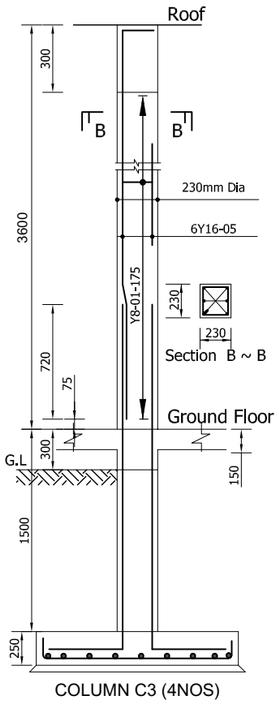


COLUMN C3 (4NOS)

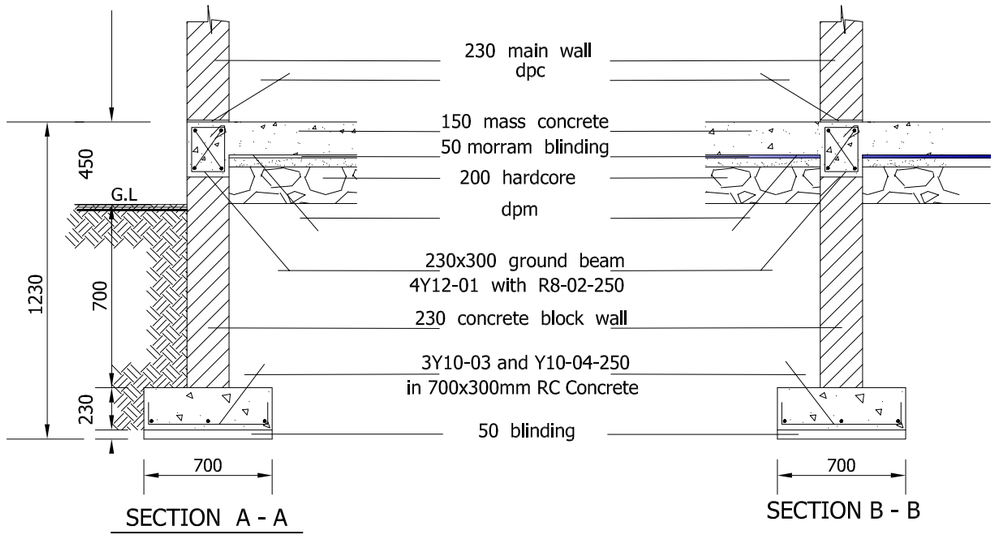

FOUNDATION DETAILS

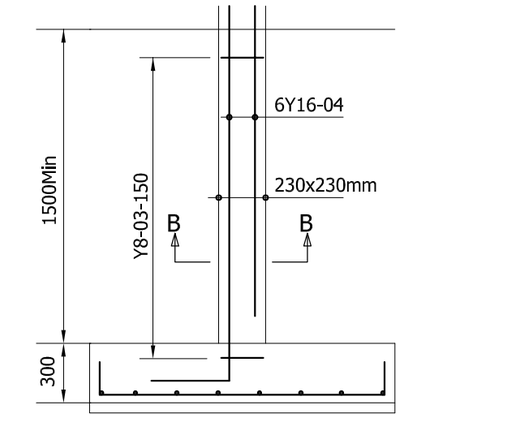

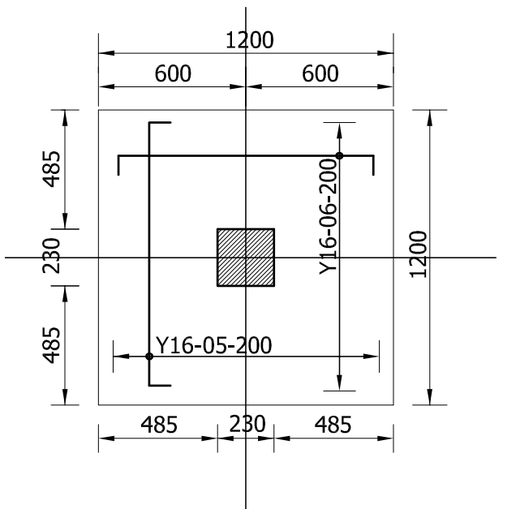



GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)


Drawing Name

STRUCTURAL DRAWING
(FOOTING&COLUMN DETAILS)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date


Drawing Scale	Revision	Drawing No.
1:100	A	ST-02

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE
+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

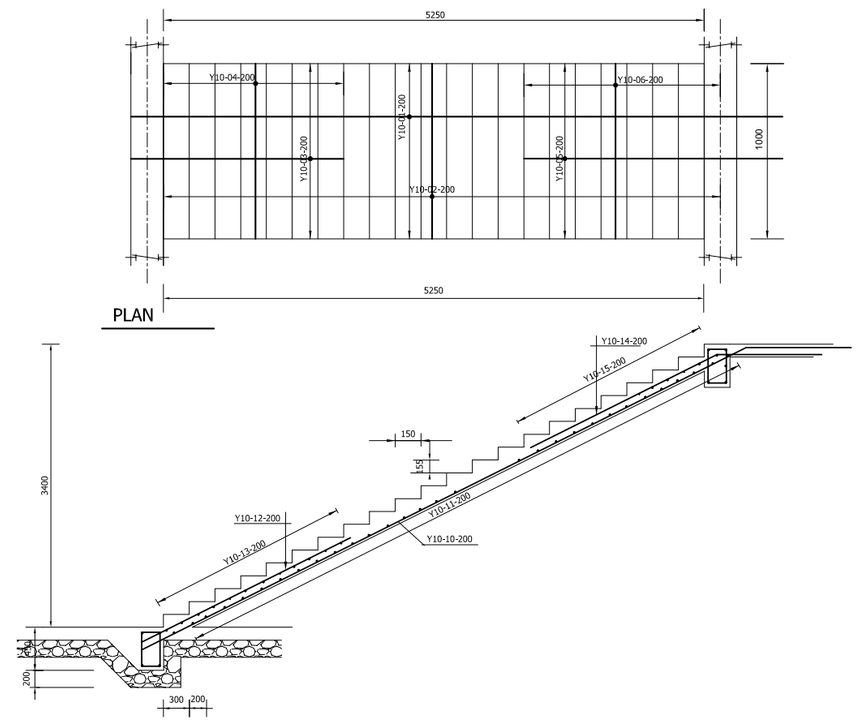


PLAN


SECTION

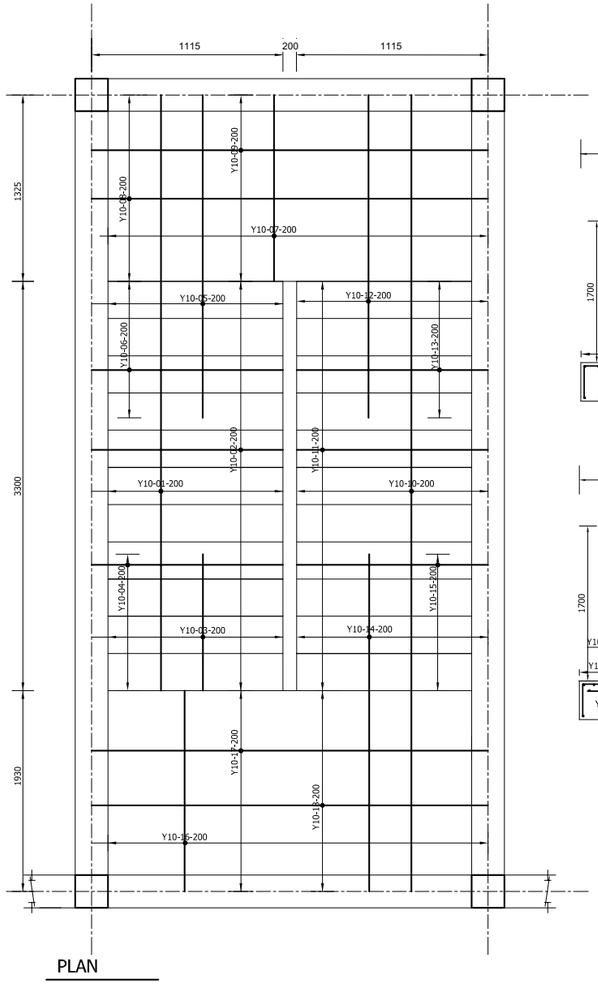


PLAN

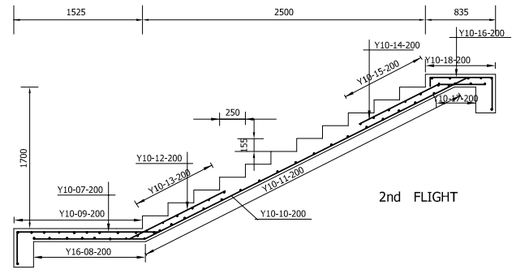

2nd FLIGHT

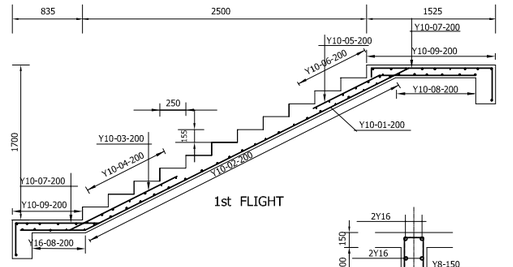

1st FLIGHT



Landing Beam

STAIR REINFORCEMENTS

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.


Client Name
MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name
STRUCTURAL DRAWING
(STAIRCASE REINFORCEMENT)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ST-03

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE
+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

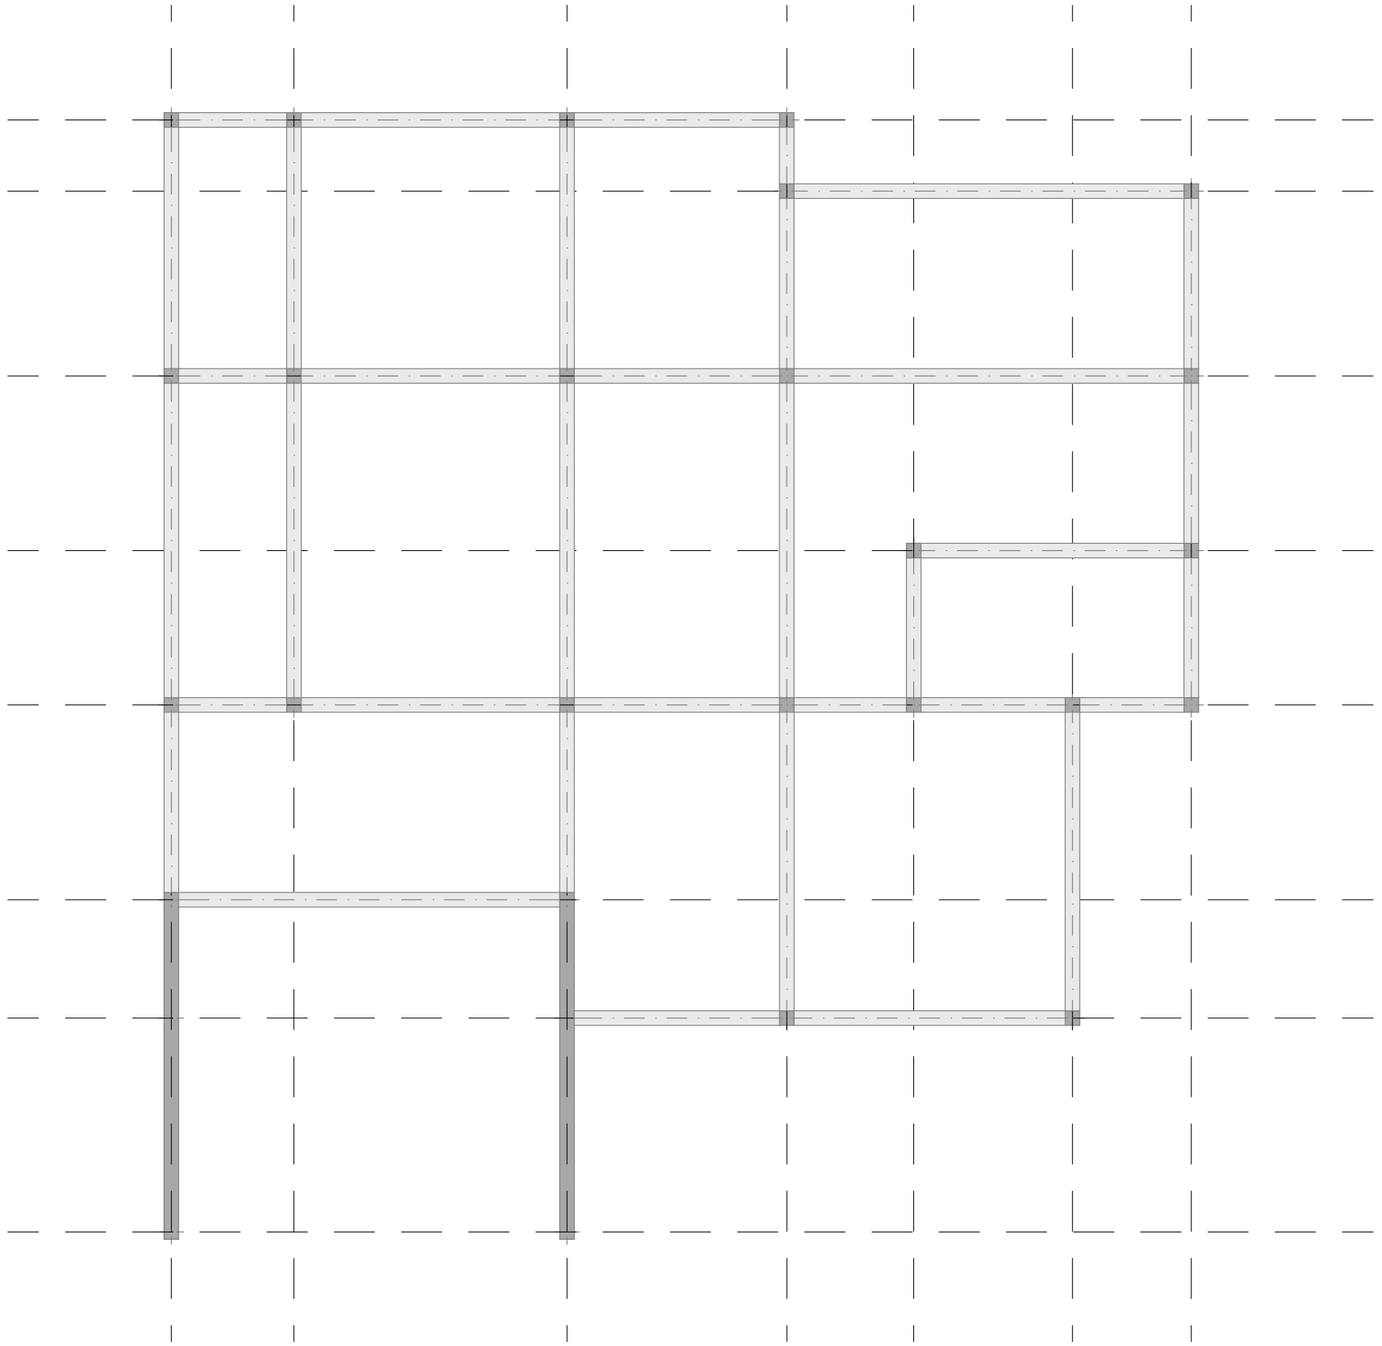

GROUND BEAM LAYOUT

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STRUCTURAL DRAWING
(GROUND BEAM LAYOUT PLAN)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	**A**	ST-04

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

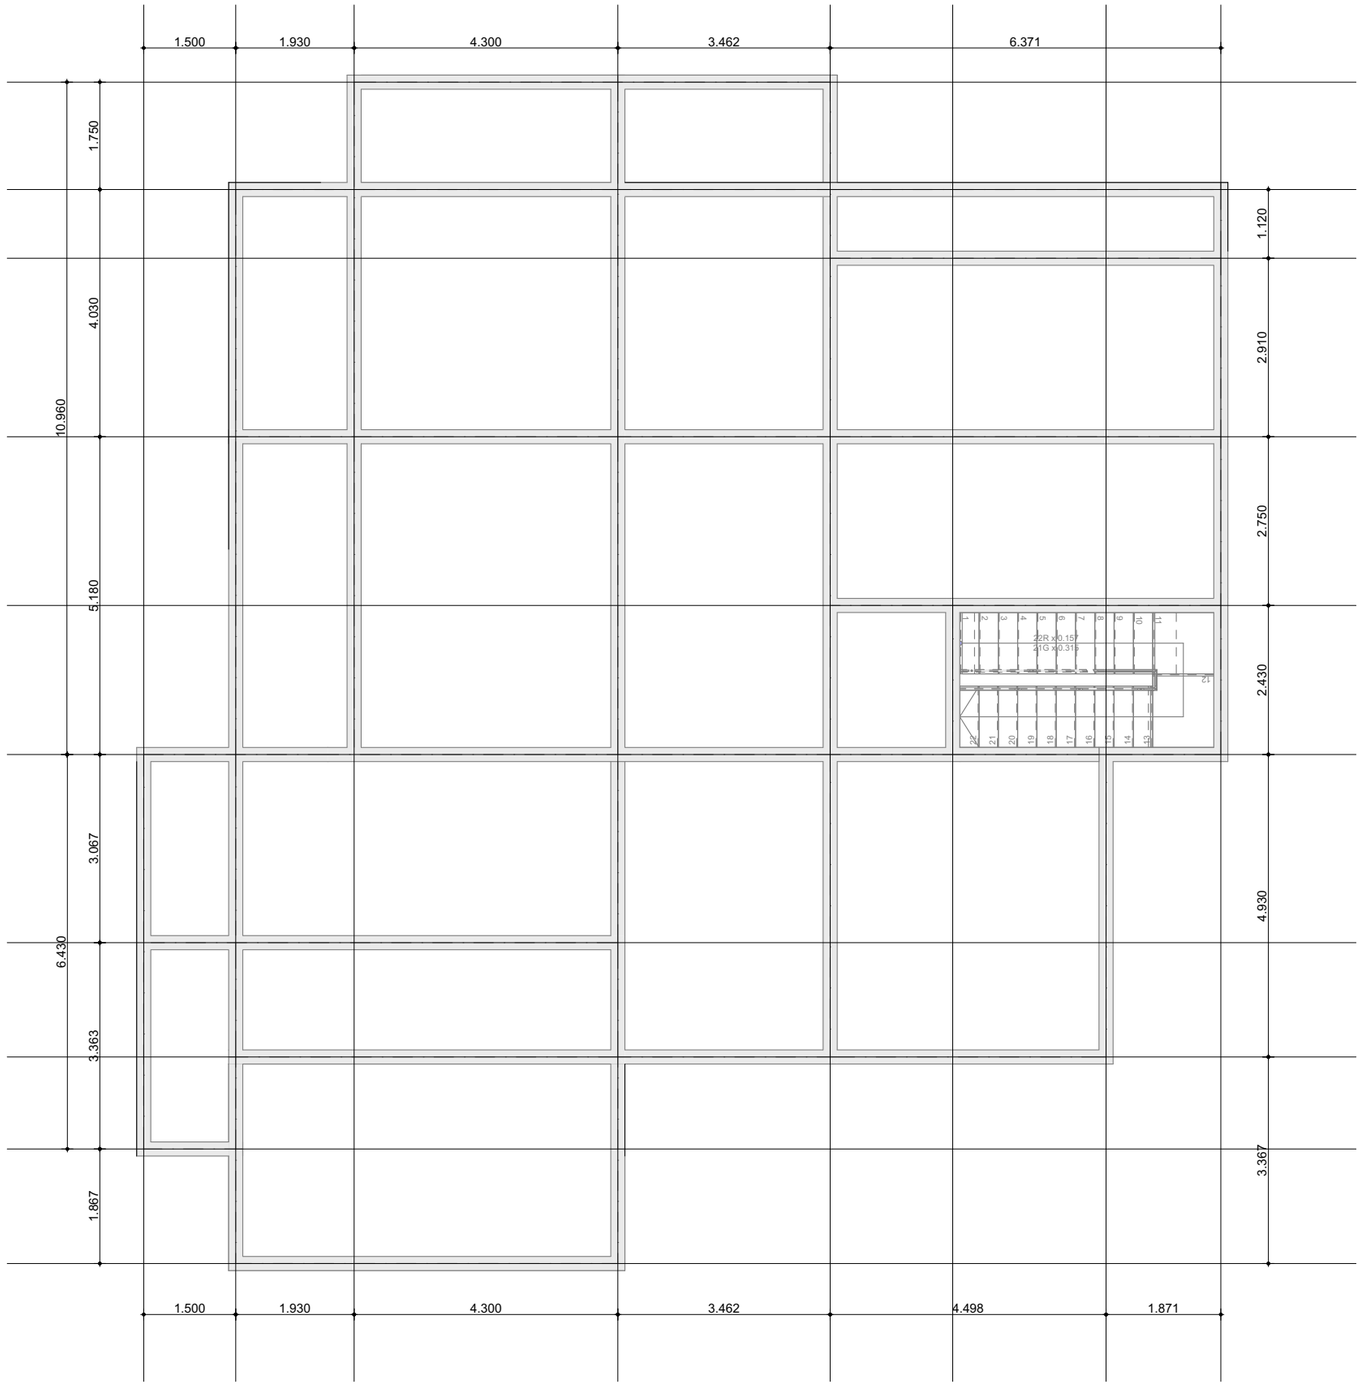

FIRST FLOOR BEAM LAYOUT

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STRUCTURAL DRAWING
(FIRST BEAM LAYOUT PLAN)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ST-05

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

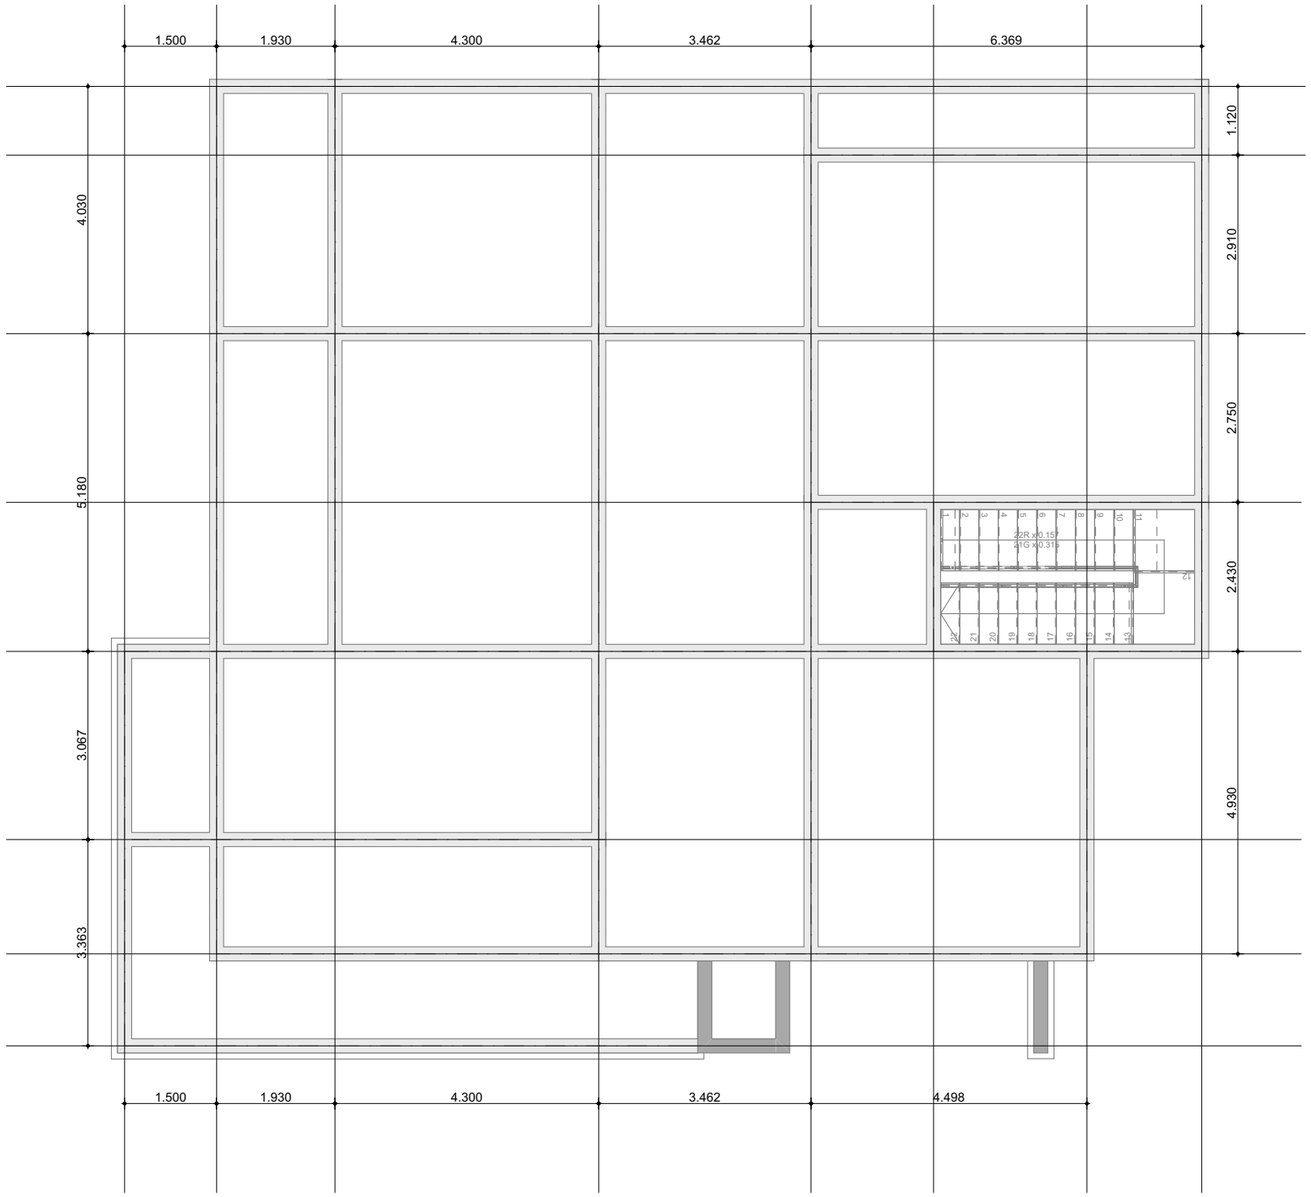

SECOND FLOOR BEAM LAYOUT

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STRUCTURAL DRAWING
(SECOND BEAM LAYOUT PLAN)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ST-06

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

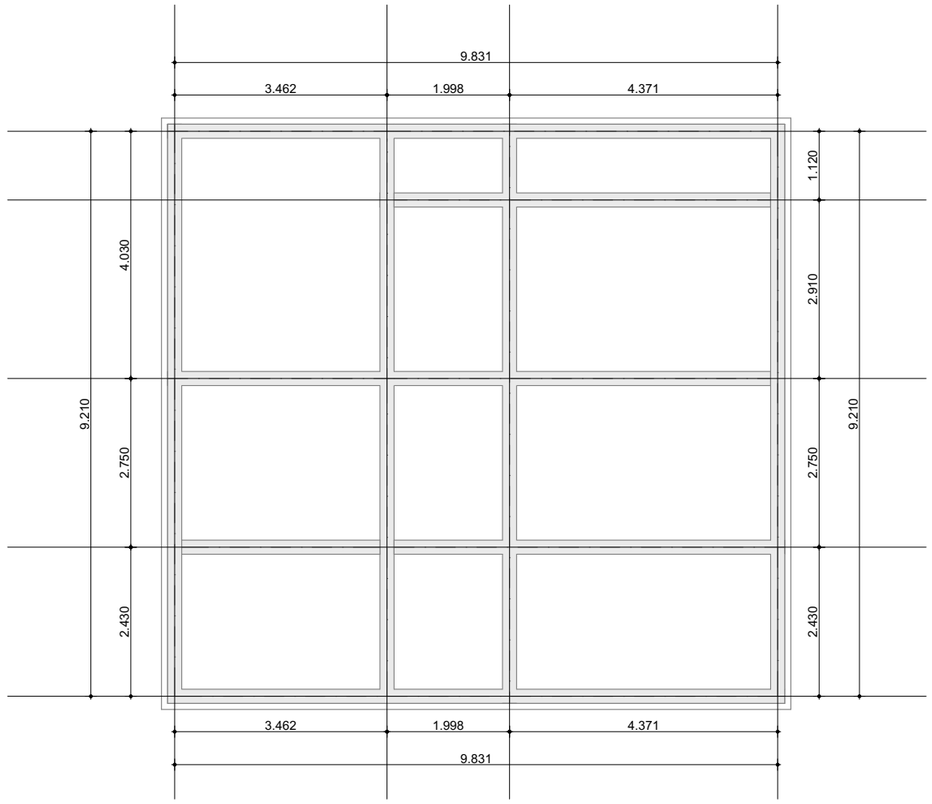

ROOF BEAM LAYOUT

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name

STRUCTURAL DRAWING
(ROOF BEAM LAYOUT PLAN)


Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ST-07


HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040 qhonesty@gmail.com


ARUSHA , TANZANIA

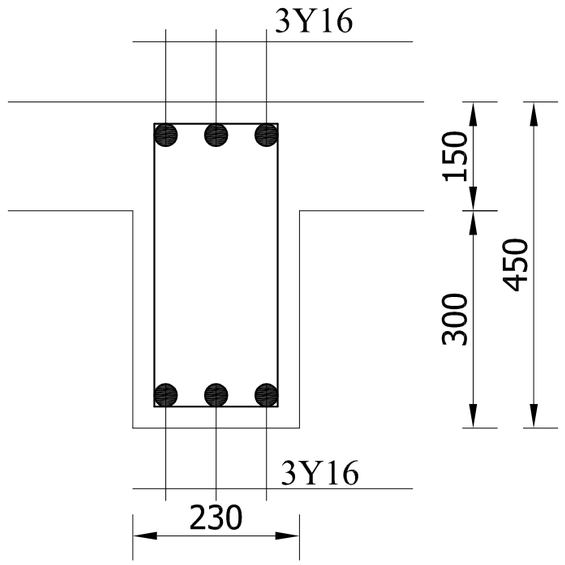


MAIN BEAM
SECTION

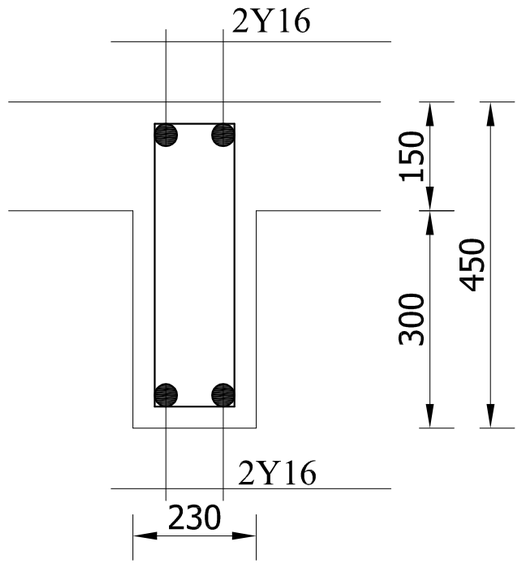

FIRST FLOOR
RING BEAM

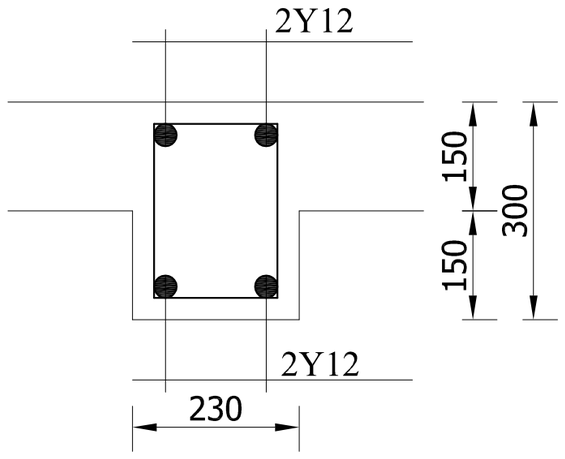

GROUND BEAM
SECTION

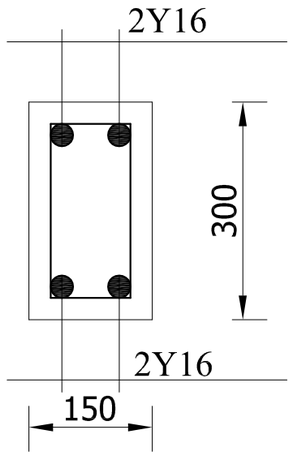

UPPER
RING BEAM

BEAM REINFORCEMENTS



GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STRUCTURAL DRAWING
(BEAM REINFORCEMENT DETAILS)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ST-08

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

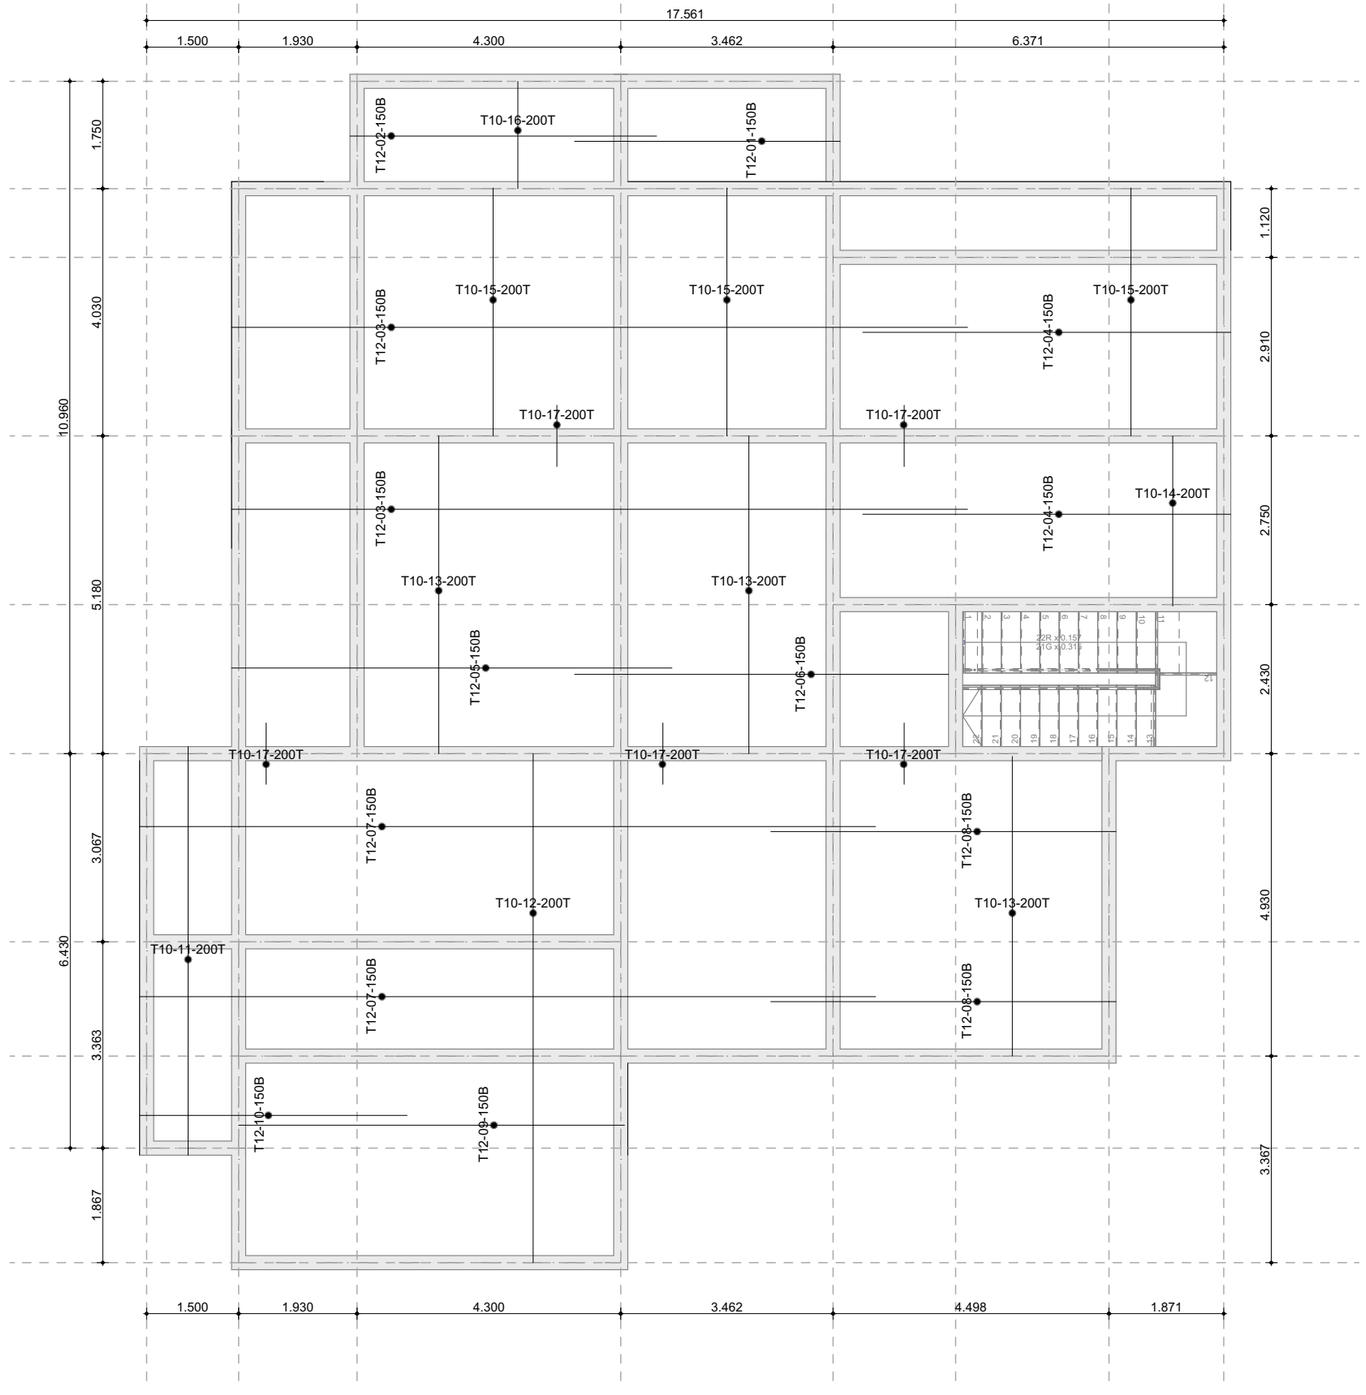

FIRST FLOOR SLAB REINFORCEMENT

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STRUCTURAL DRAWING
(FIRST FLOOR SLAB REINFORCEMENT)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ST-09

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

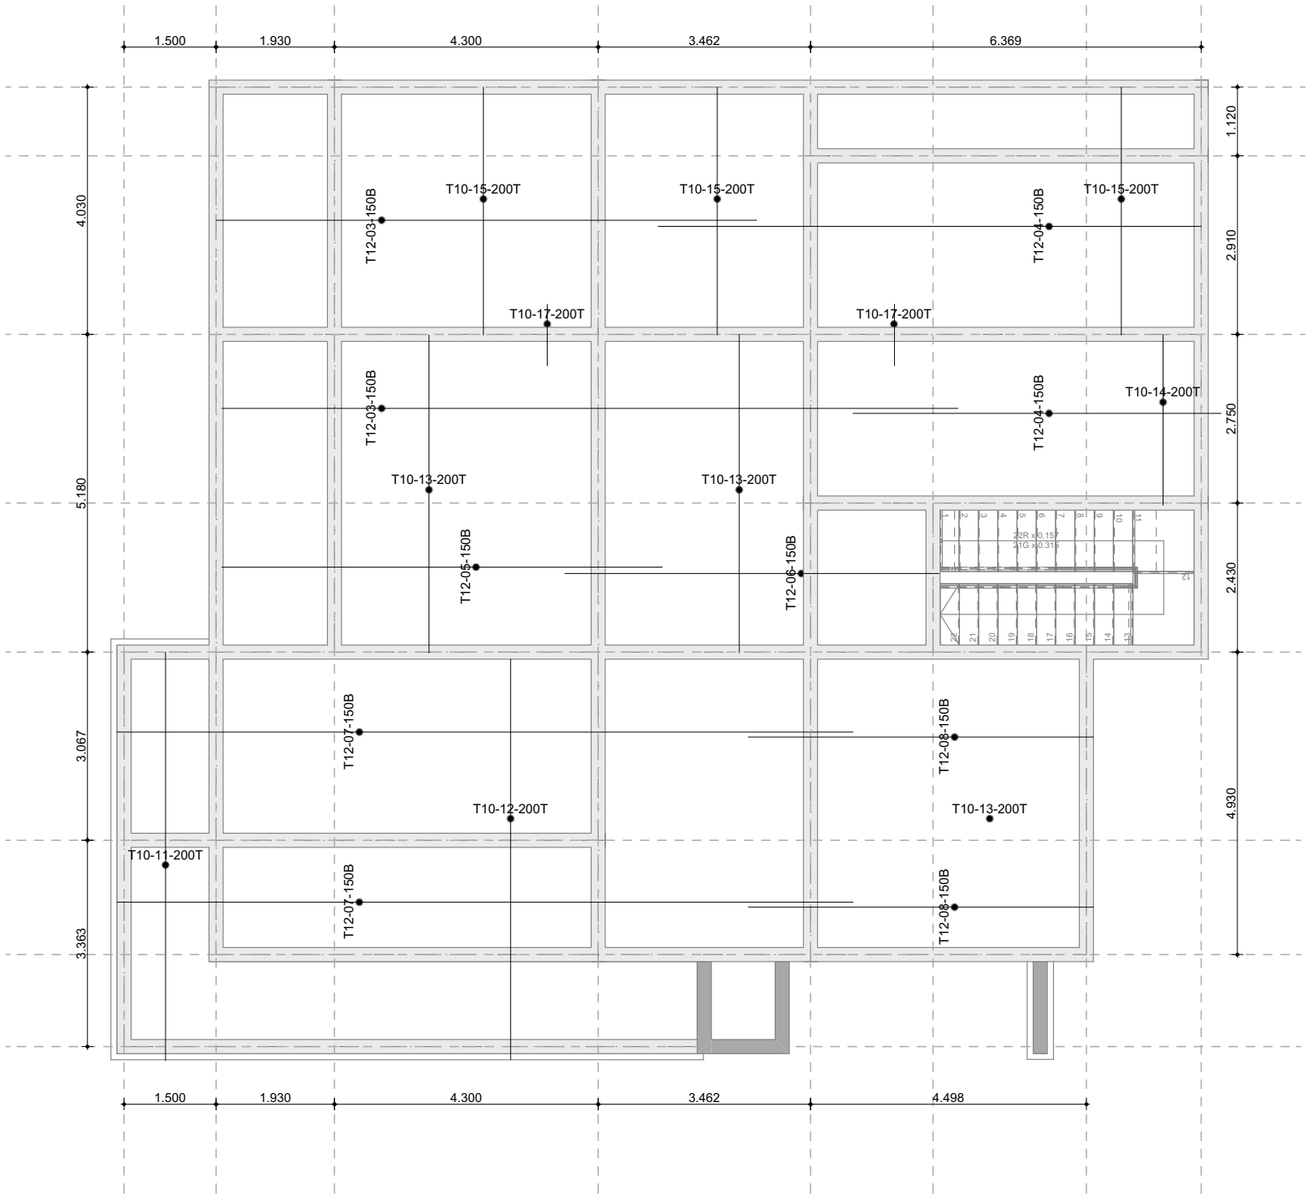

SECOND FLOOR SLAB REINFORCEMENT

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STRUCTURAL DRAWING
(SECOND FLOOR SLAB REINFORCEMENT)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ST-10

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

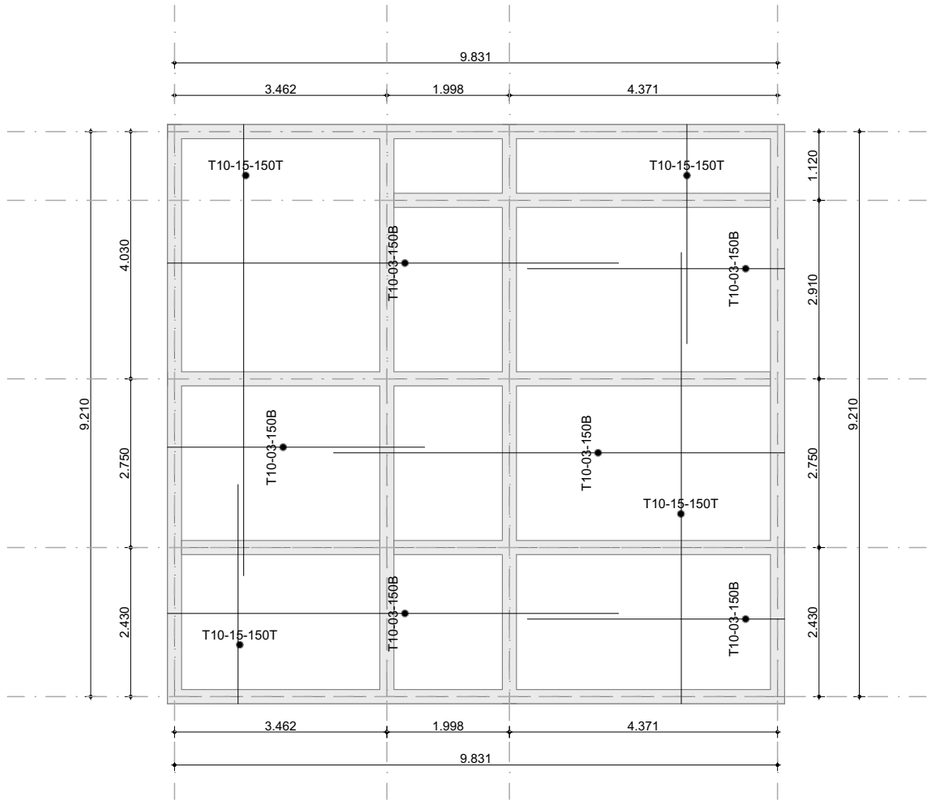

ROOF SLAB REINFORCEMENT

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


STRUCTURAL DRAWING
(ROOF FLOOR SLAB REINFORCEMENT)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date


Drawing Scale	Revision	Drawing No.
1:100	A	ST-11


HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

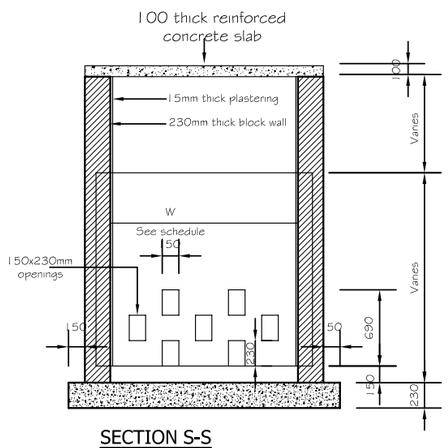


SECTION S-S

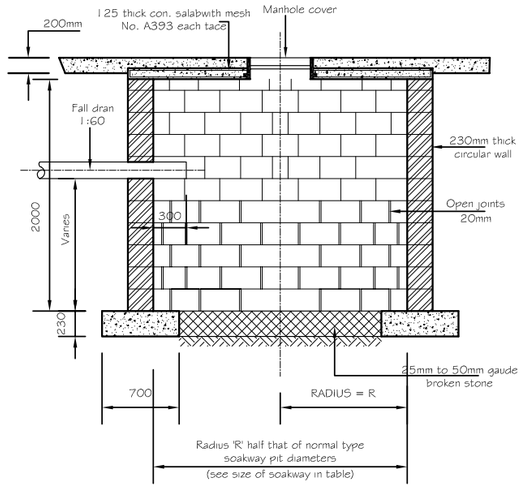


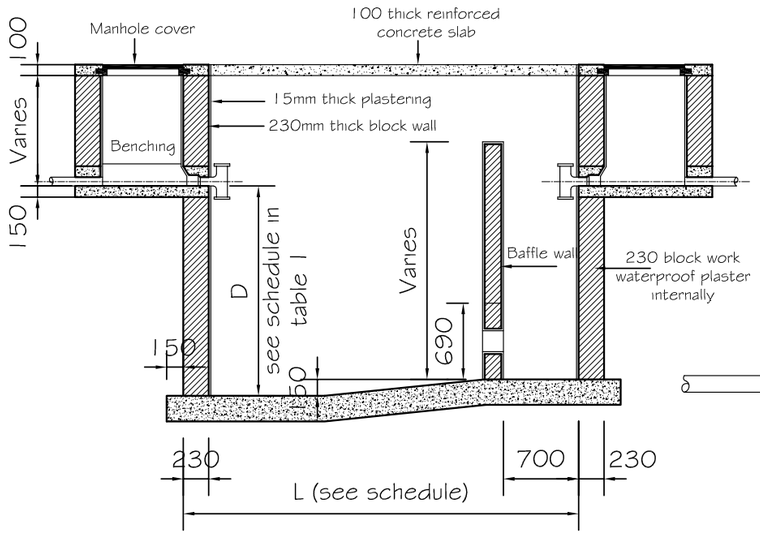

SECTION H-H

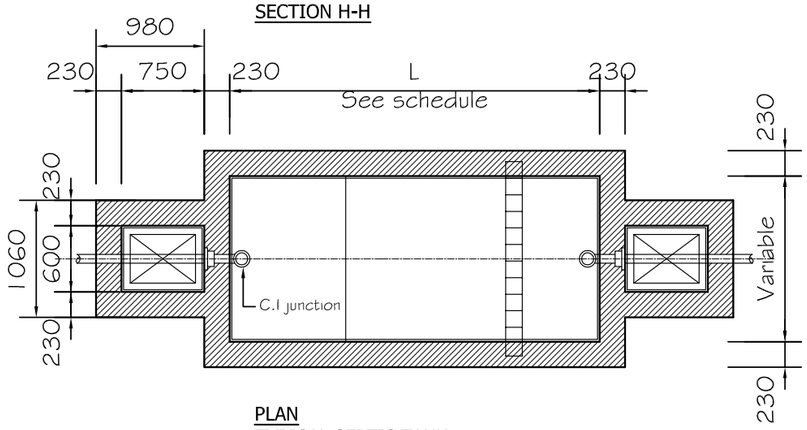

PLAN
TYPICAL SEPTIC TANK

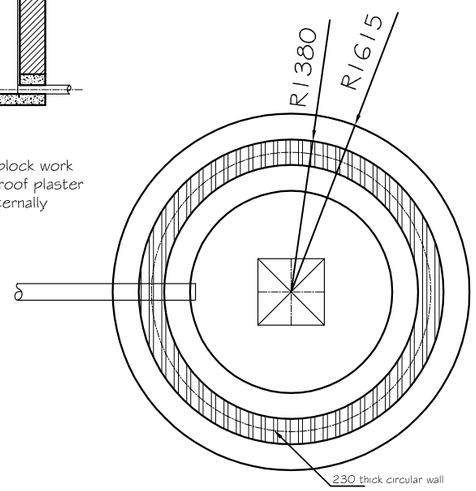

SOAK WAY SECTION

PLAN
TYPICAL SOAK PIT

TABLE 1 SEPTIC TANK SIZE

TYPE	All wastes No No. of users	Soil wastes No No. of users	Dimensions (metres)			Volume	Capacity
			Lenght	Width	Depth	M^3	Litres
1		10	2.00	1.00	1.30	2.60	2600
2	7	20	2.20	1.00	1.50	3.30	3300
3	15	30	2.50	1.20	1.70	5.10	5100
4	30	45	3.00	1.30	1.80	7.02	7020
5	40	60	3.40	1.50	1.80	9.18	9180
6	50	75	3.70	1.60	1.80	10.66	10666
7	60	90	4.20	1.70	1.80	12.85	12850
8	75	105	4.50	1.80	2.00	16.20	16200
9	85	120	4.80	1.80	2.00	17.28	17280

TABLE 2 SOAKWAY TRENCH SIZE

All wastes No. of users	Soil wastes No. of users	Plan area as for soakage trenches (so metres)					
		Per colation factors					
		1.5	3.5	6.5	10	15	20
	10	2.97	4.92	5.85	7.34	8.83	10.31
7	20	20	6.22	8.27	10.22	12.17	14.49
15	30	30	8.18	9.29	11.52	15.24	17.84
30	45	45	9.38	12.17	15.51	19.04	21.46
40	60	60	10.78	14.31	17.98	21.46	25.08
50	75	75	11.99	15.98	19.60	23.60	27.96
60	90	90	13.40	17.47	21.83	26.11	30.56
75	105	105	14.21	18.77	23.69	28.43	33.17
85	85	120	15.38	20.25	25.27	30.47	35.40

TABLE 3 SOAK PIT SIZES

All wastes No. of users	Soil wastes No. of users	Diameter of Soak pit (metres)					
		Per colation factors					
		1.5	3.5	6.5	10	15	20
	10	2.80	3.10	3.50	3.80	4.40	4.80
7	20						
15	30	3.10	3.70	4.30	4.80	5.30	5.70
30	45						
40	60	3.40	4.10	4.70	5.30	6.00	6.30
50	75						
60	90	3.70	4.40	5.10	5.70	6.30	6.70
75	105						

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE TO BE BUILT AT PLOT NO. 70, BLOCK 41 AT KINONDONI MUNICIPALITY DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name

SEPTIC TANK & SOAK PIT


Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ST-12

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

0 1 2 3 4 5 10 m

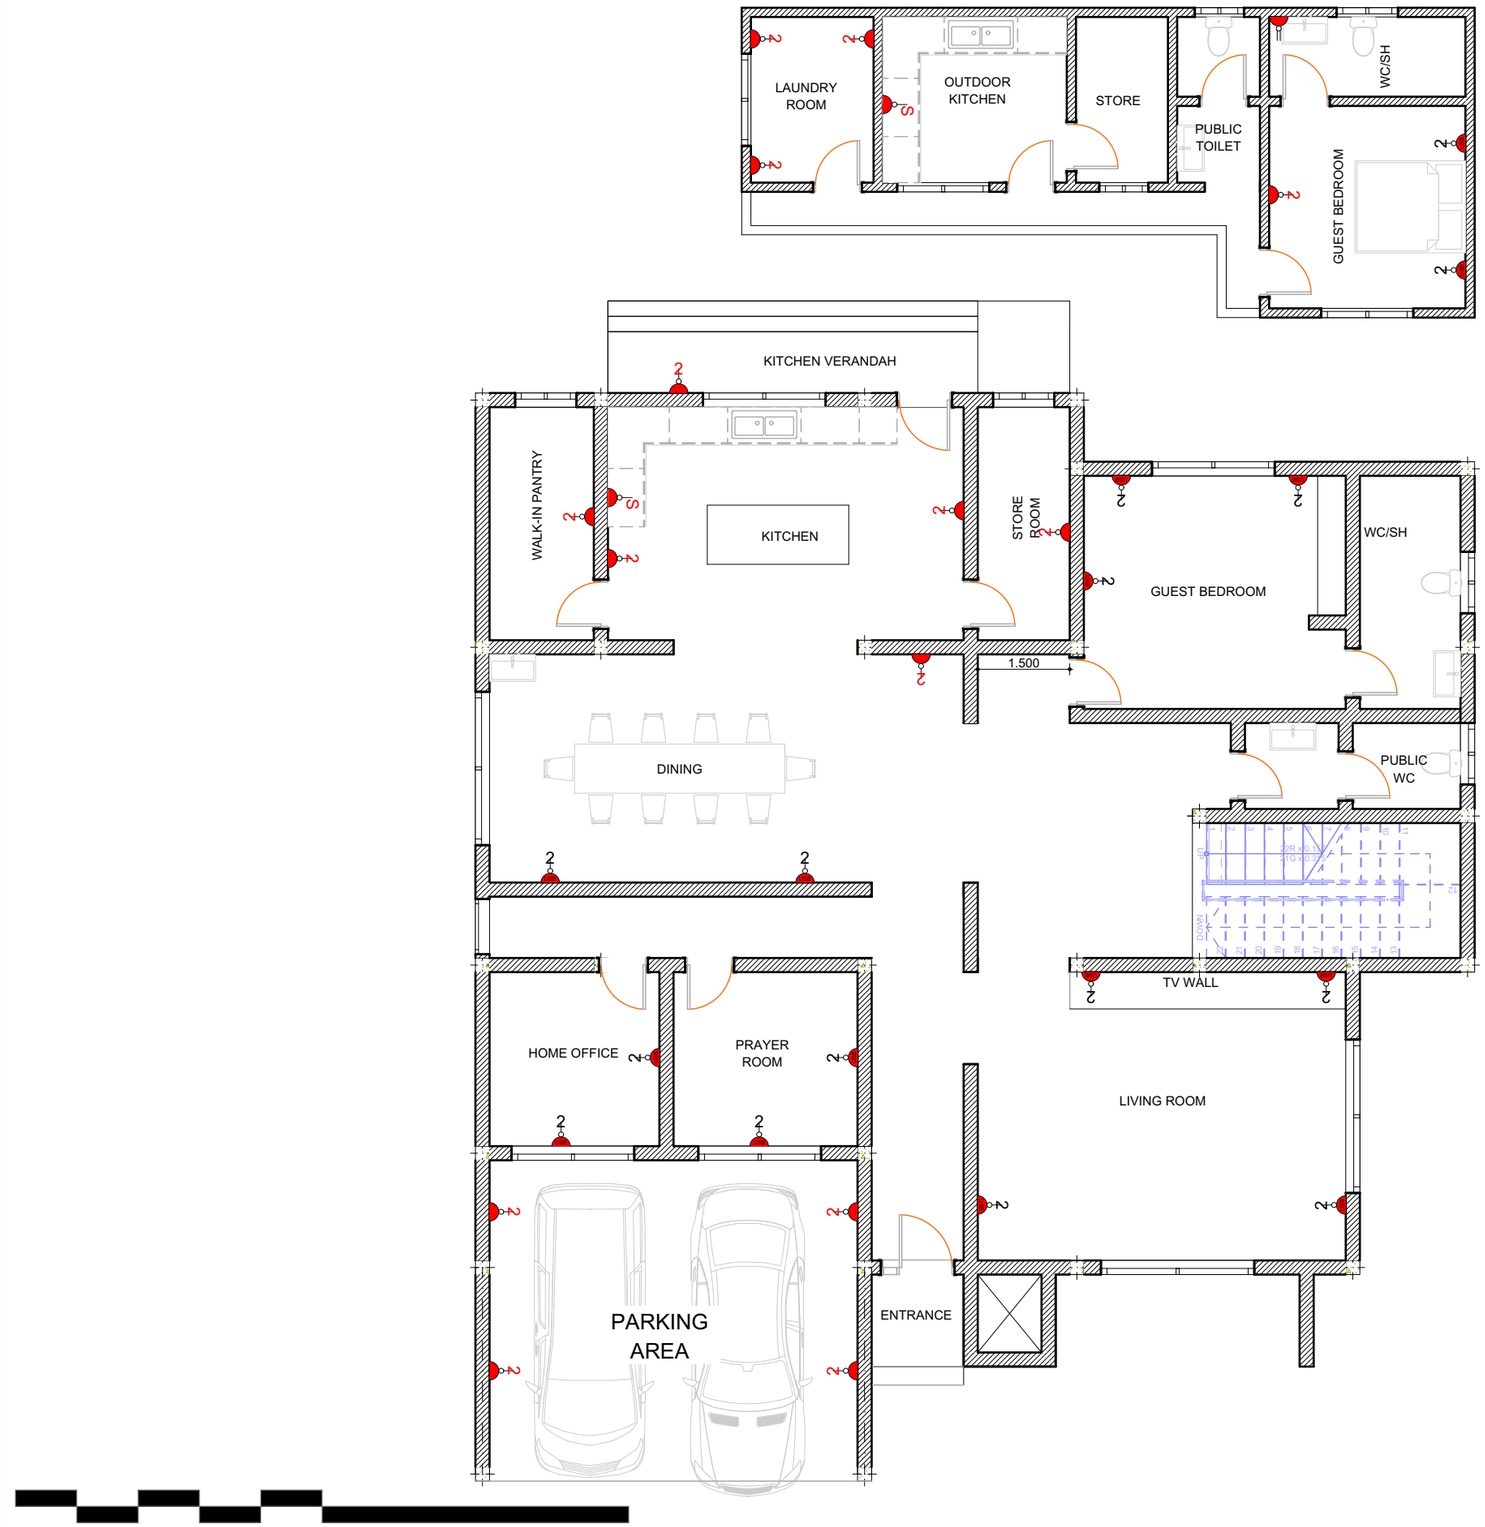

2	Double Socket with USB
2	Double Socket
	Shaver
S	Kitchen Socket
D-4	TV,HDMI,DATA,AUDIO Outlet

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name

GROUND FLOOR PLAN
(Electrical - Power output)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ELEC-01

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA



	Single light switch
2	Single pole 2 gang switch
3	Single pole 3 gang switch
D	Down ceiling light
W	Wall light
C	Chandelier light
	Wire connection

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)


Drawing Name

GROUND FLOOR PLAN
(Electrical - Lighting)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ELEC-02

HONESTY DESIGNS COP
CREATE . CRAFT . INSPIRE
+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

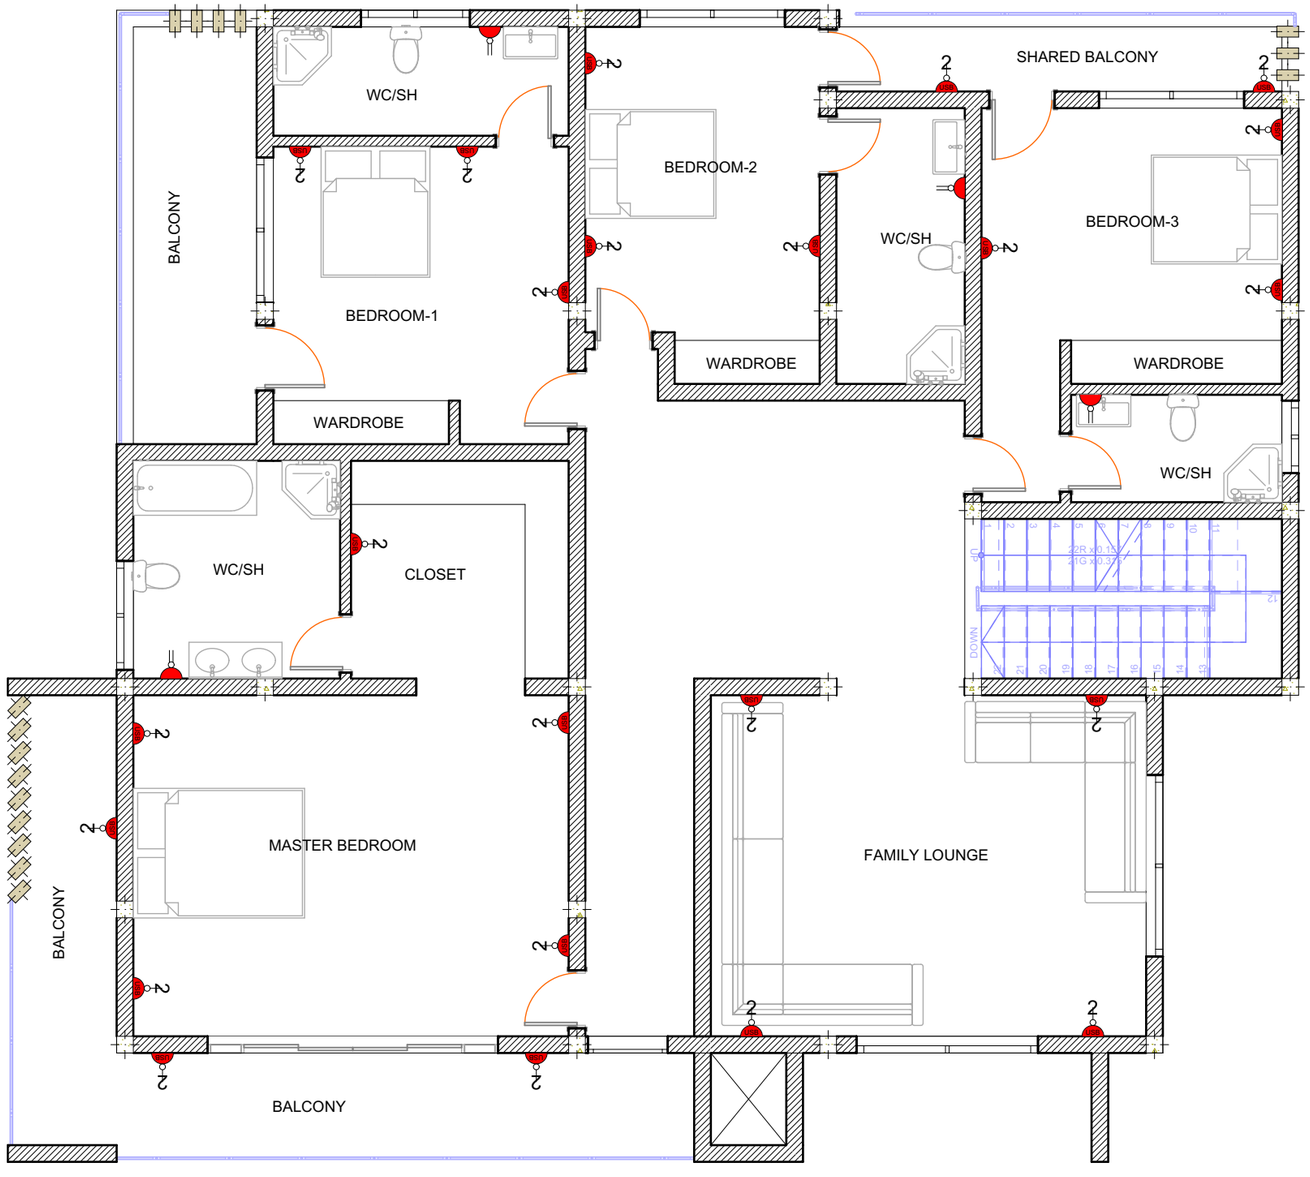

2	Double Socket with USB
2	Double Socket
	Shaver
S	Kitchen Socket
D-4	TV,HDMI,DATA,AUDIO Outlet

0 1 2 3 4 5 10 m

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


FIRST FLOOR PLAN
(Electrical - Power Output)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ELEC-03

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

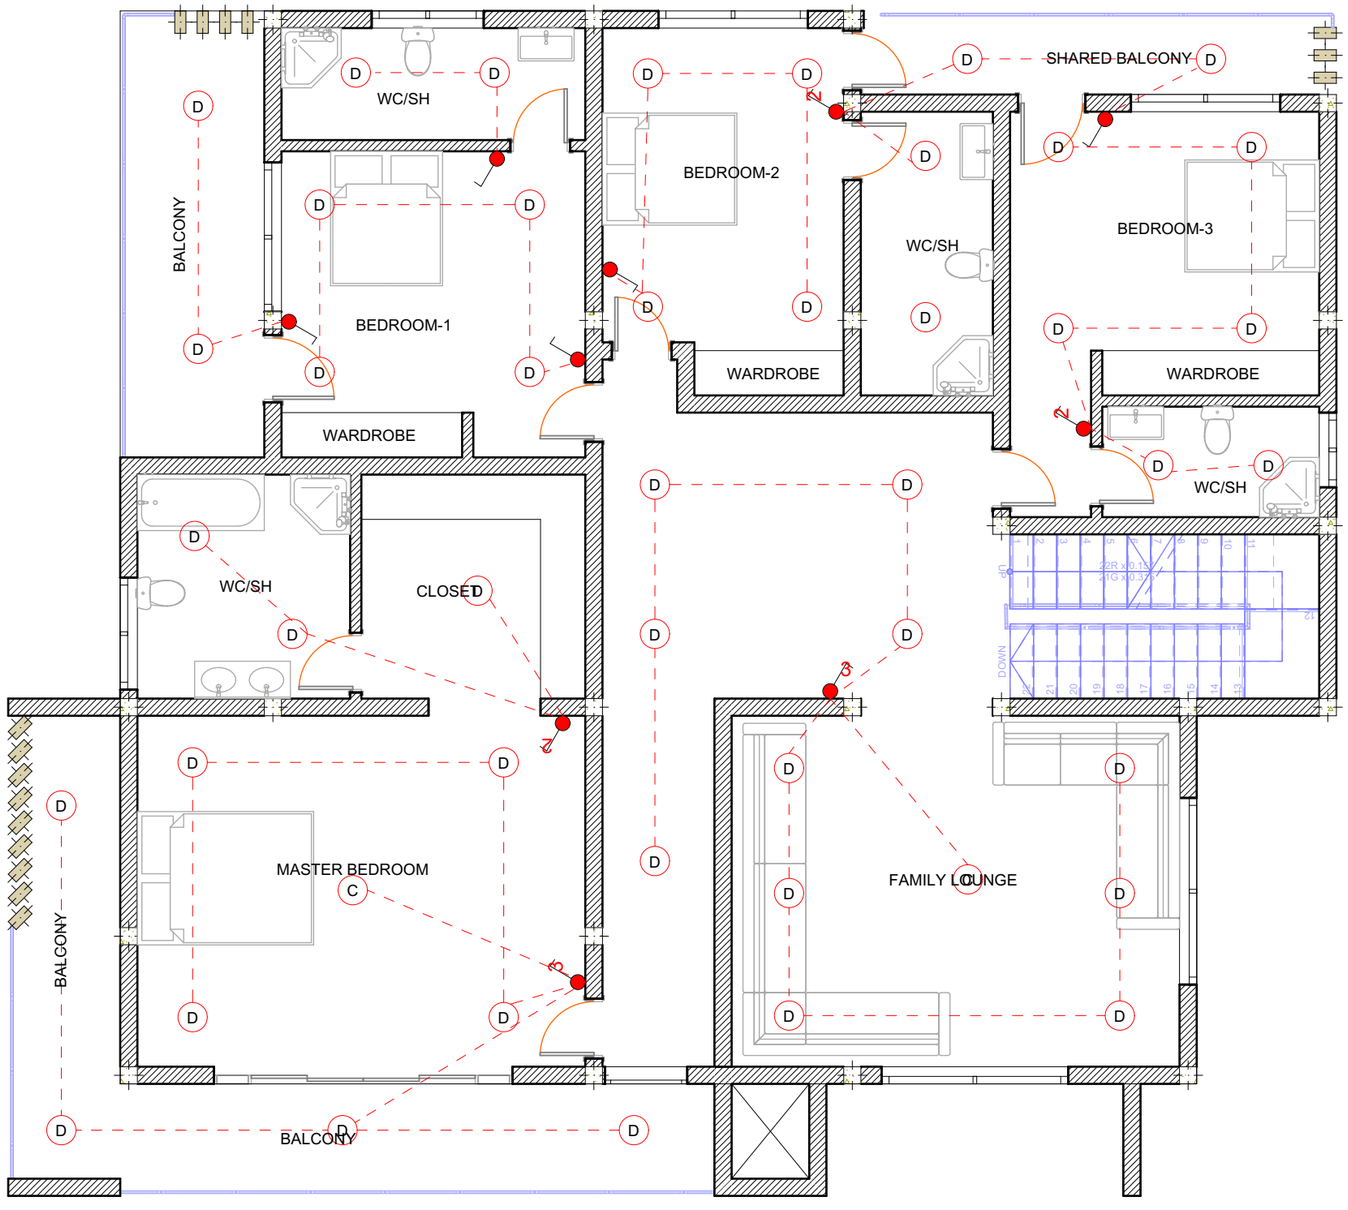

	Single light switch
2	Single pole 2 gang switch
3	Single pole 3 gang switch
D	Down ceiling light
W	Wall light
C	Chandelier light
	Wire connection

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


FIRST FLOOR PLAN
(Electrical - Lighting)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ELEC-04

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA

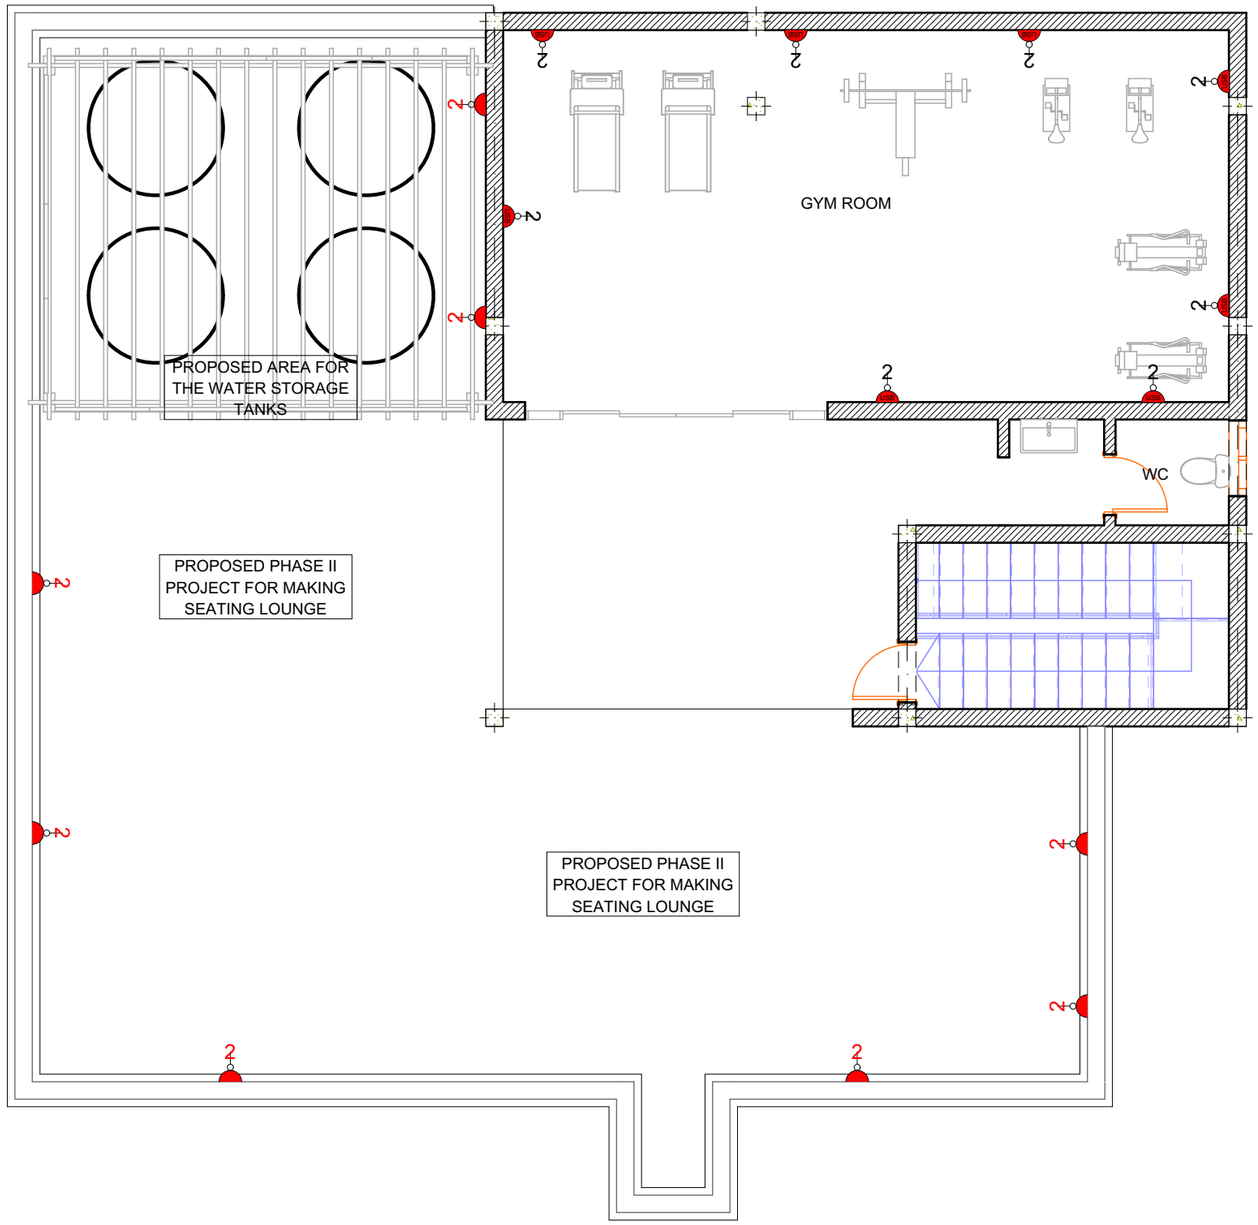

2 USB	Double Socket with USB
2	Double Socket
	Shaver
S	Kitchen Socket
D-4	TV,HDMI,DATA,AUDIO Outlet

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name


ROOF FLOOR PLAN
(Electrical - Power Output)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ELEC-05

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE

+255 (0) 766 718 040
qhonesty@gmail.com
ARUSHA , TANZANIA

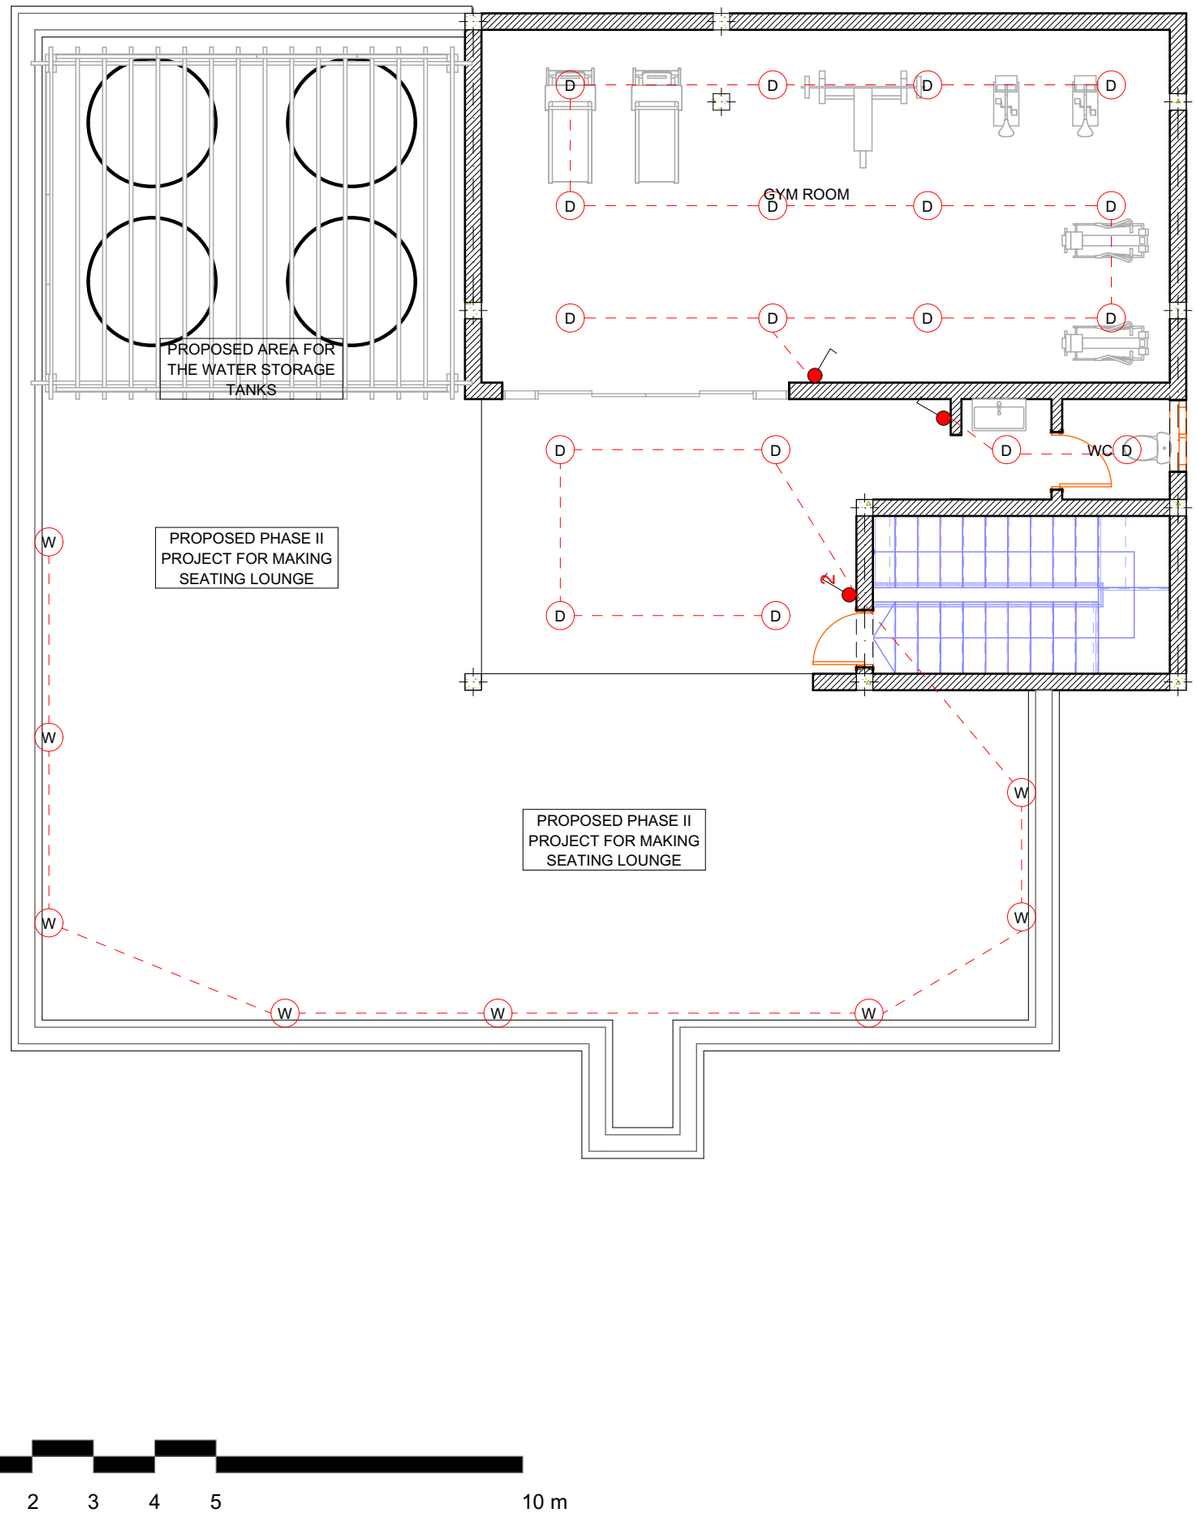

	Single light switch
2	Single pole 2 gang switch
3	Single pole 3 gang switch
D	Down ceiling light
W	Wall light
C	Chandelier light
	Wire connection

GENERAL NOTES

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN METER UNLESS SPECIFIED OTHERWISE.

2. ALL EXTERNAL WALLS ARE WITH 230 MM THICK BLOCKWORK AND ALL INTERNAL WALLS SHALL BE 150 MM THICK BLOCK WORK, UNLESS SPECIFIED OTHERWISE.

3. CLEAR COVER FOR
a. FOOTING = 50MM
b. BEAM = 30MM
c. GRADE SLAB = 30MM
d. COLUMN = 40MM

4. CONCRETE SHALL BE OF GRADE C25/30 WITH CHARACTERISTIC CUBE STRENGTH OF 30 N/mm² AND BLINDING CONCRETE SHALL BE OF GRADE C12/15 WITH CHARACTERISTIC CUBE STRENGTH OF 15 N/mm².

5. 'T' DENOTES HIGH YIELD STRENGTH DEFORMED BARS OF GRADE 500B HAVING YIELD STRENGTH OF 500 N/mm² CONFORMING TO BS4449-2006.

6. LOCATION AND ORIENTATION SHOULD BE DECIDED AT SITE IN CONSULTATION WITH CLIENT.

7. ALL EXTERNAL WALLS AND INTERNAL PARTITION WALL SHALL BE CEMENT SOLID BLOCKS WITH COMPRESSIVE STRENGTH AS PER SPECIFICATION.

8. ANTI TERMITE TREATMENT SHALL BE DONE BELOW FLOOR SLAB AND ALL FOUNDATION BELOW GROUND LEVEL AS PER CONTRACT SPECIFICATION.

9. SAFE BEARING CAPACITY OF SOIL CONSIDERED AS 100kN/m2 AT 1.5m BELOW EXISTING GROUND LEVEL.

Revision History

RevID	ChID	Change Name	Date

Project Title

PROPOSED OF RESIDENTIAL HOUSE
TO BE BUILT AT PLOT NO. 70, BLOCK 41
AT KINONDONI MUNICIPALITY
DAR ES SALAAM.

Client Name

MOHAMED LASEKO
(P.O BOX 6047, DAR ES SALAAM)

Drawing Name

ROOF FLOOR PLAN
(Electrical - Lighting)

Drawn by	Date
Honesty Rwabyo	Jul 2025
Checked by	Date

Drawing Scale	Revision	Drawing No.
1:100	A	ELEC-06

HONESTY
DESIGNS COP
CREATE . CRAFT . INSPIRE
+255 (0) 766 718 040
honesty@gmail.com
ARUSHA , TANZANIA