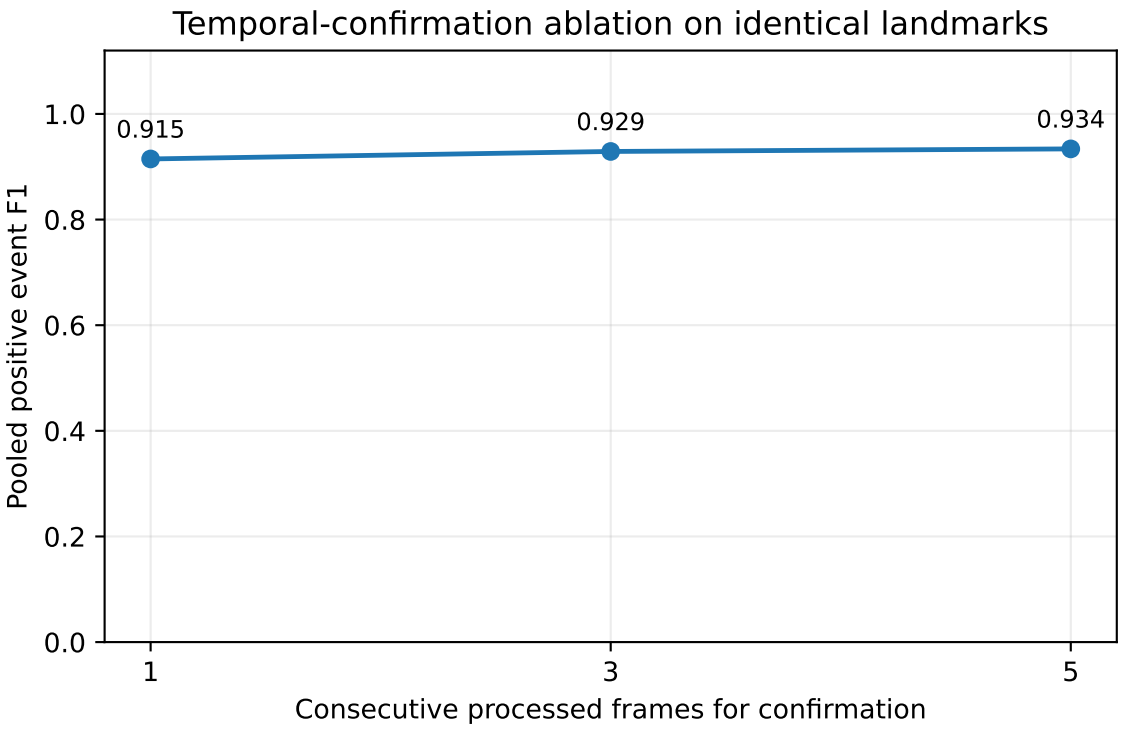
Temporal-confirmation ablation on identical landmarks
Pooled positive event F1
Consecutive processed frames for confirmation
0.915
0.929
0.934
0.0
0.2
0.4
0.6
0.8
1.0
1
3
5