



Figure 4: Augmentation Validity — Real Retinal Fundus Image


(a) Original

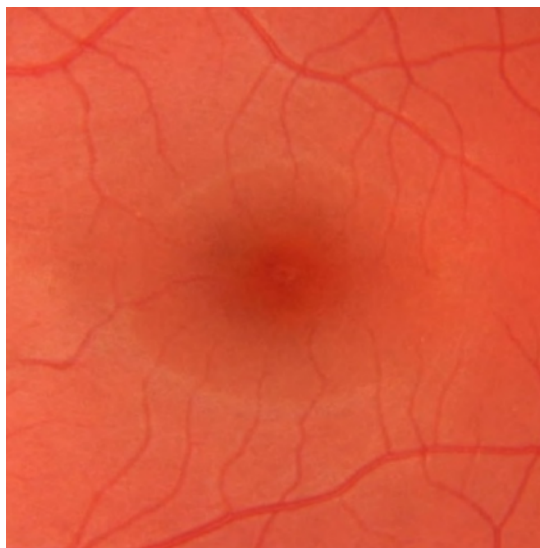


(b) Horiz. Flip
✓ **VALID**

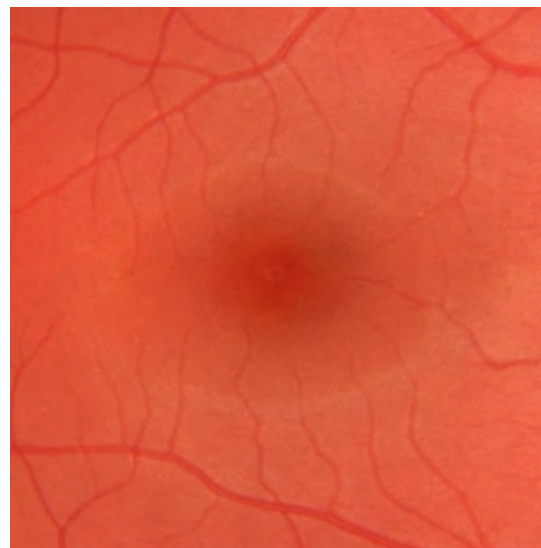


(c) Vert. Flip
✗ **INVALID**

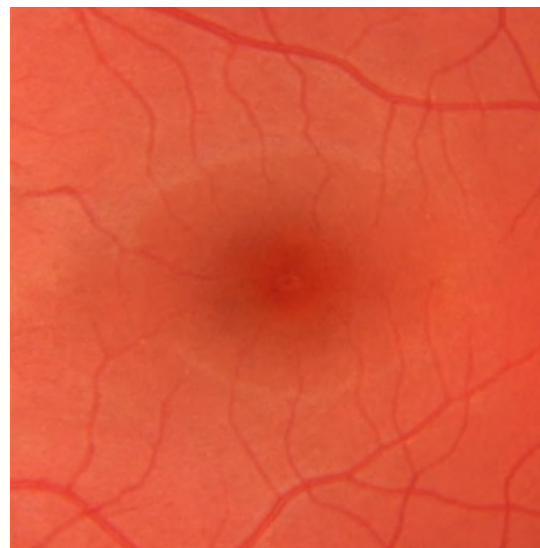

(d) Rotate 15°
✓ **VALID**

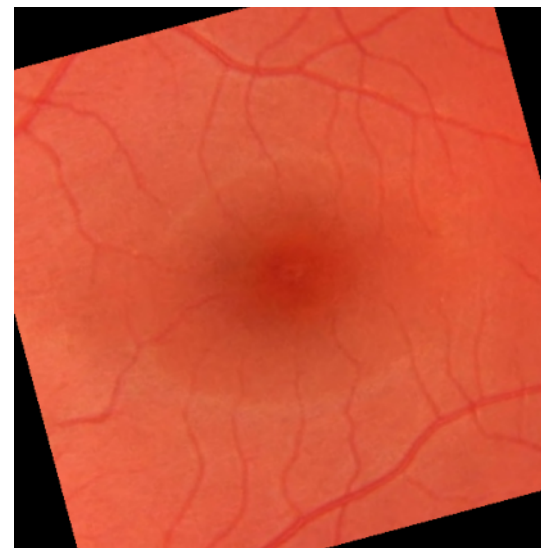

(e) Color Jitter
✗ **RISKY**

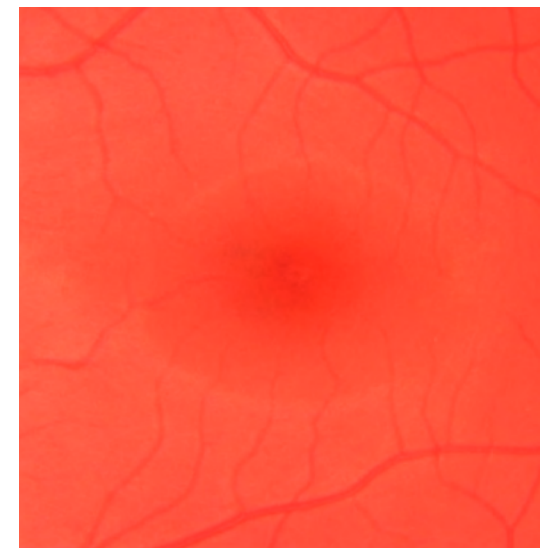

(f) Heavy Blur $\sigma=5$
✗ **INVALID**

