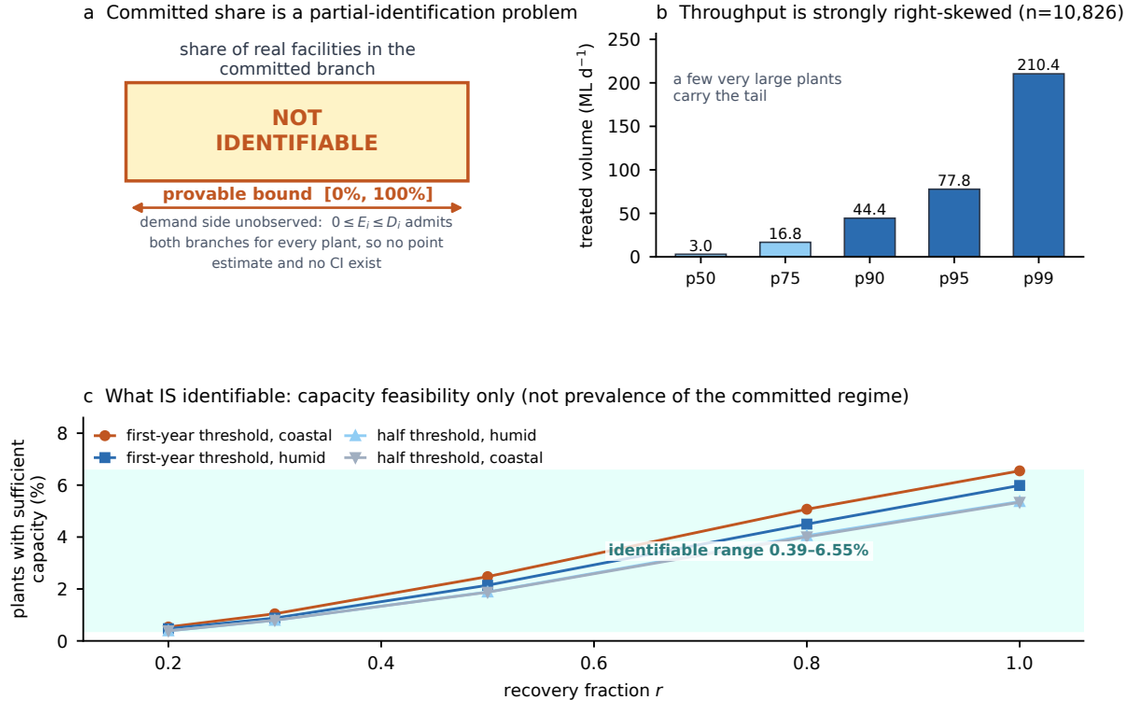

Data: A30_WP0/a24b_partial_id_summary.json (a,b) and a24b_capacity_table.csv (c). The superseded claim 'above 95% of real facilities are fully committed' is WITHDRAWN (status_of_original_claim = WITHDRAWN_AS_UNIDENTIFIED).
n = 10,826 real treatment plants (panels a,b). No point estimate and no confidence interval is reported for the committed share, because the parameter is not identified.
LIMITATION: panel c states CAPACITY FEASIBILITY only - that a plant COULD produce enough reclaimed water to exceed the modelled threshold. It says NOTHING about existing demand. Exactly two claims are permitted: (a) real plant throughput is strongly right-skewed; (b) only ~0.4-7% of plants have capacity for a surplus-type scheme at the modelled threshold.