

Section 04



Industrial Security (Bachelor)

Section 04 – Industrial Protocols

Industrial Protocols

Lecture Notes

Department of Computer Science

- 1 Legacy Heritage
- 2 Modbus
- 3 Siemens, DNP3, EtherNet/IP
- 4 Modern Secure Protocols

By the end of this section you will be able to

- Recognise common industrial protocols and their use cases.
- Understand why legacy protocols typically lack authentication.
- Decode a Modbus TCP frame by hand.
- Compare insecure legacy protocols with secure modern alternatives (OPC UA, MQTT-TLS).
- Identify when secure variants are appropriate.


1

Legacy Heritage

Section 04 – Industrial Protocols

Core fact


Most industrial protocols in production today were **designed before the Internet** and provide no authentication, integrity, or confidentiality.

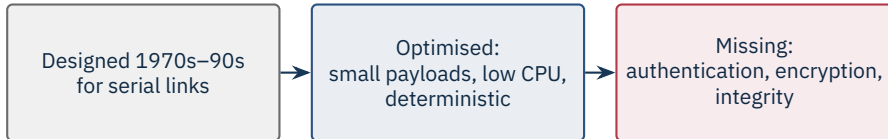

2

Modbus

Section 04 – Industrial Protocols

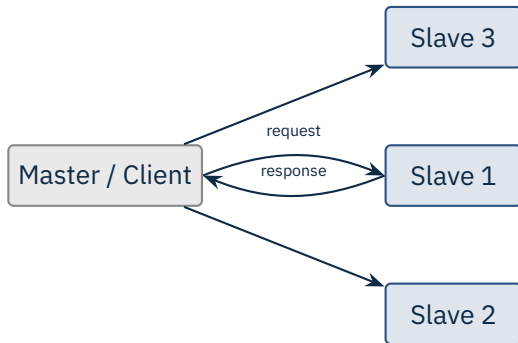

Variants: Modbus RTU (serial), Modbus TCP (port 502)
Address space: coils, discrete inputs, input regs, holding regs
No auth, no encryption – by design (1979)

Source: Modbus Organization, Modbus Application Protocol Specification v1.1b3, 2012.




1 00 01 00 00 00 06 01 03 00 00 00 0A

2 ^TID^ ^PID^ ^LEN^ ^U^ ^FC^ ^Addr^ ^Cnt^ -> Read 10 Holding Regs from 0x0000


3

Siemens, DNP3, EtherNet/IP

Section 04 – Industrial Protocols

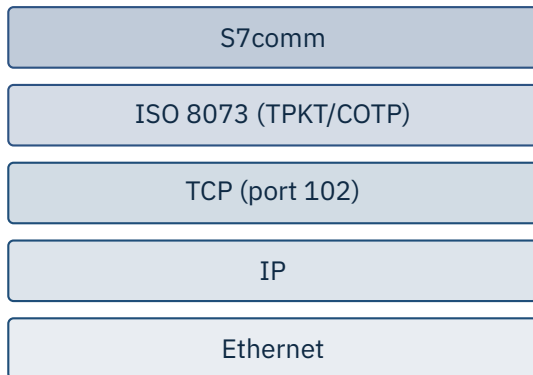


Read/write variables, upload/download programs, start/stop CPU. S7commPlus added session keys
– still broken in practice.

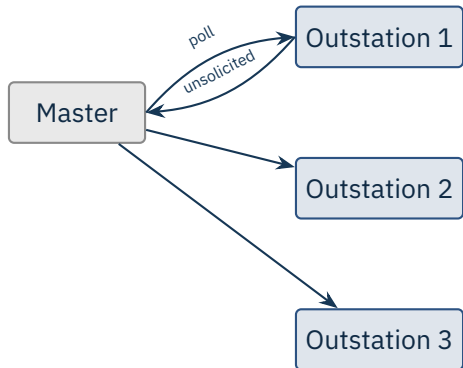

DNP3 dominant in NA utilities; IEC 60870-5-104 in Europe. Both ride TCP today; both added Secure Authentication (SAv5) on top, but encryption is optional.

Source: IEEE 1815-2012 (DNP3) | IEC 60870-5-104:2006 + Amd. 1:2016.

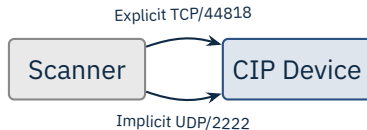

CIP carries object-oriented messages (assemblies, parameters, identity).
CIP Security adds TLS/DTLS and certificate-based authentication.




EtherType 0x8892 – bypasses IP for real time.
IRT needs hardware switching for sub-ms cycles.

4


Modern Secure Protocols

Section 04 – Industrial Protocols

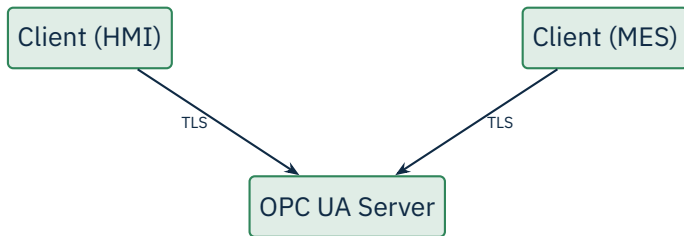


X.509 mutual auth • message signing • encryption
Rich information model • pub/sub since v1.04

Source: IEC 62541 (multipart, OPC Foundation) | OPC UA Specification Part 2 (Security Model).

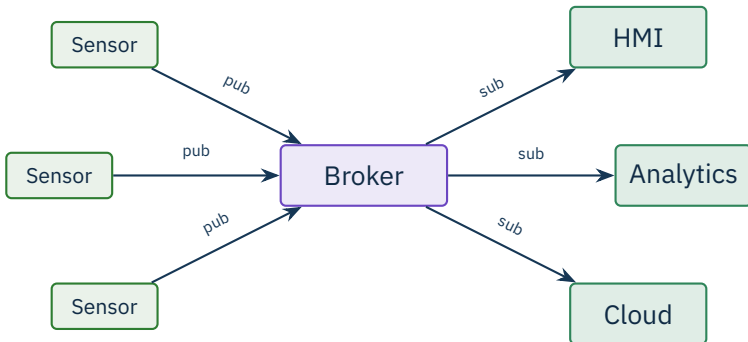

Default 1883 plaintext / 8883 with TLS. Sparkplug B adds OT semantics.

Protocol	Auth	Integrity	Confid.	Notes
Modbus	×	×	×	1979, ubiquitous Siemens-proprietary Utilities Rockwell Siemens / IRT modern default IIoT messaging
S7comm	×	×	×	
DNP3	opt SAV5	opt	×	
EtherNet/IP	opt CIP	opt	opt	
Profinet	weak	×	×	
OPC UA	X.509	sign	TLS	
MQTT	+TLS	TLS	TLS	

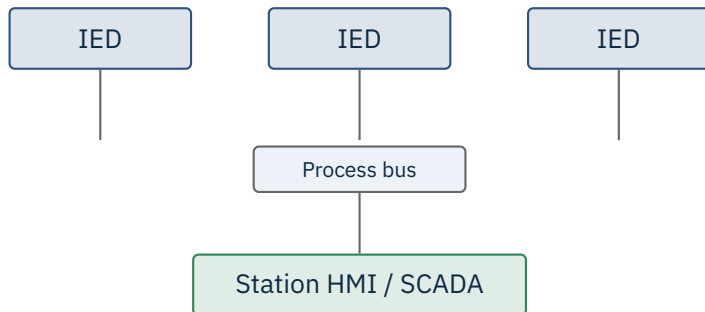

The substation stack

MMS for client/server; **GOOSE** for sub-4 ms trip messages; **Sampled Values** for measurements. Goose has *no* authentication by default.

Source: IEC 61850 (multipart) | IEC 62351 (security for IEC TC 57 protocols).

★ Key Takeaway: What to remember from this section

- Most legacy industrial protocols are unauthenticated and unencrypted by design.
- Modbus is the canonical example – 12 bytes of MBAP and a one-byte function code.
- Modern protocols (OPC UA, MQTT-TLS) bring real cryptography, but require correct configuration.
- Network-layer mitigations (firewalls, segmentation) compensate where the protocol cannot.

End of Section 04



Industrial Protocols

Questions and discussion