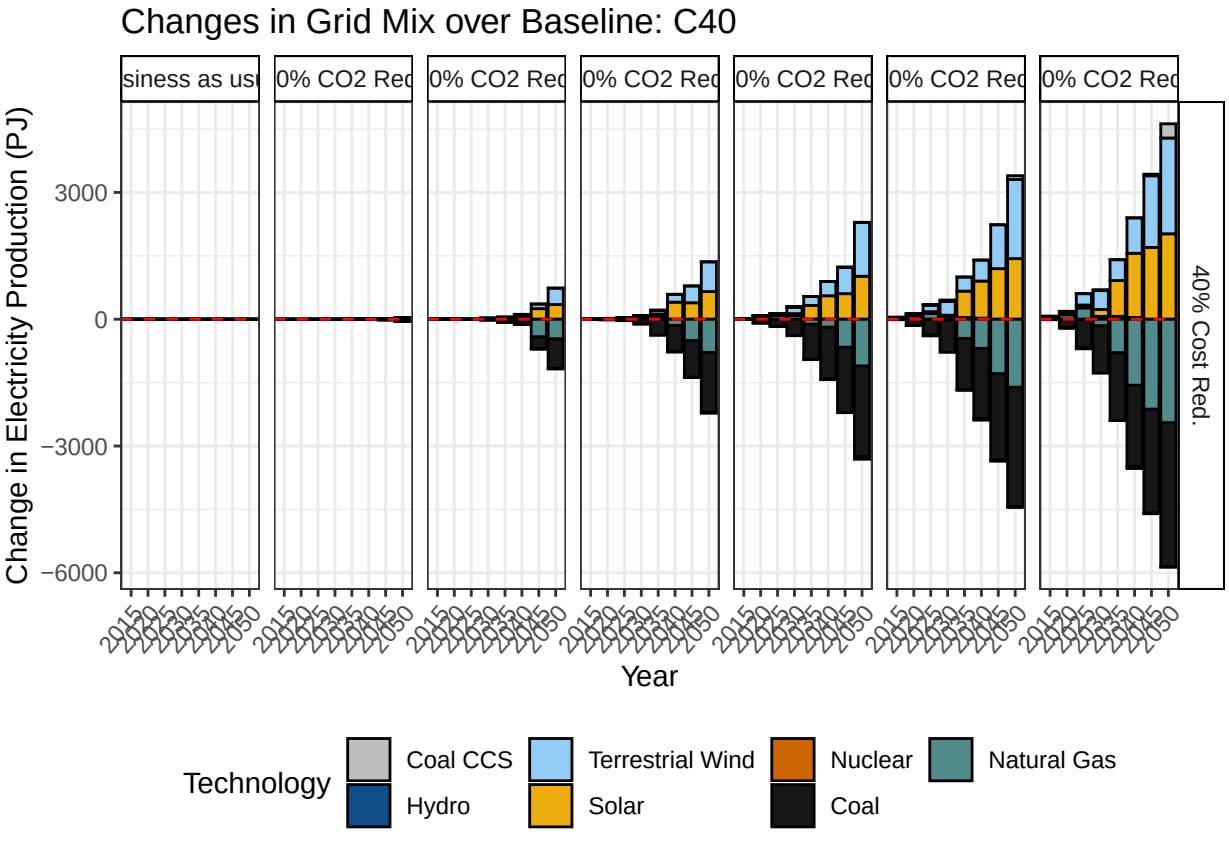
Changes in Grid Mix over Baseline: C40
siness as usu
0% CO2 Red
0% CO2 Red
0% CO2 Red
0% CO2 Red
0% CO2 Red
0% CO2 Red
40% Cost Red.
Change in Electricity Production (PJ)
3000
0
−3000
−6000
2015
2020
2025
2030
2035
2040
2045
2050
Year
Technology
Coal CCS
Hydro
Terrestrial Wind
Solar
Nuclear
Coal
Natural Gas