

RETAIL INTERIOR / COORDINATED DESIGN



Storefront, interior and display details · neutral material tones



STOREFRONT / DESIGN INTENT



INTERIOR / DISPLAY AND COUNTER



MESH / LIGHT



DISPLAY FRAME



PLASTER / SHELF

OVERALL PLAN / SETTING-OUT

Setting-out / coordinated interfaces · 1:20 · finish-face dimensions; site verification pending



SET-OUT DATUMS


A 0 / 0
B 2400 / 0
C 2400 / 3106
D 0 / 3106

STREET-FACING DISPLAY

Dashed line: shelf above


Solid return toward interior

Wall bands graphic only
Thickness TBC #26
Envelope TBC #4

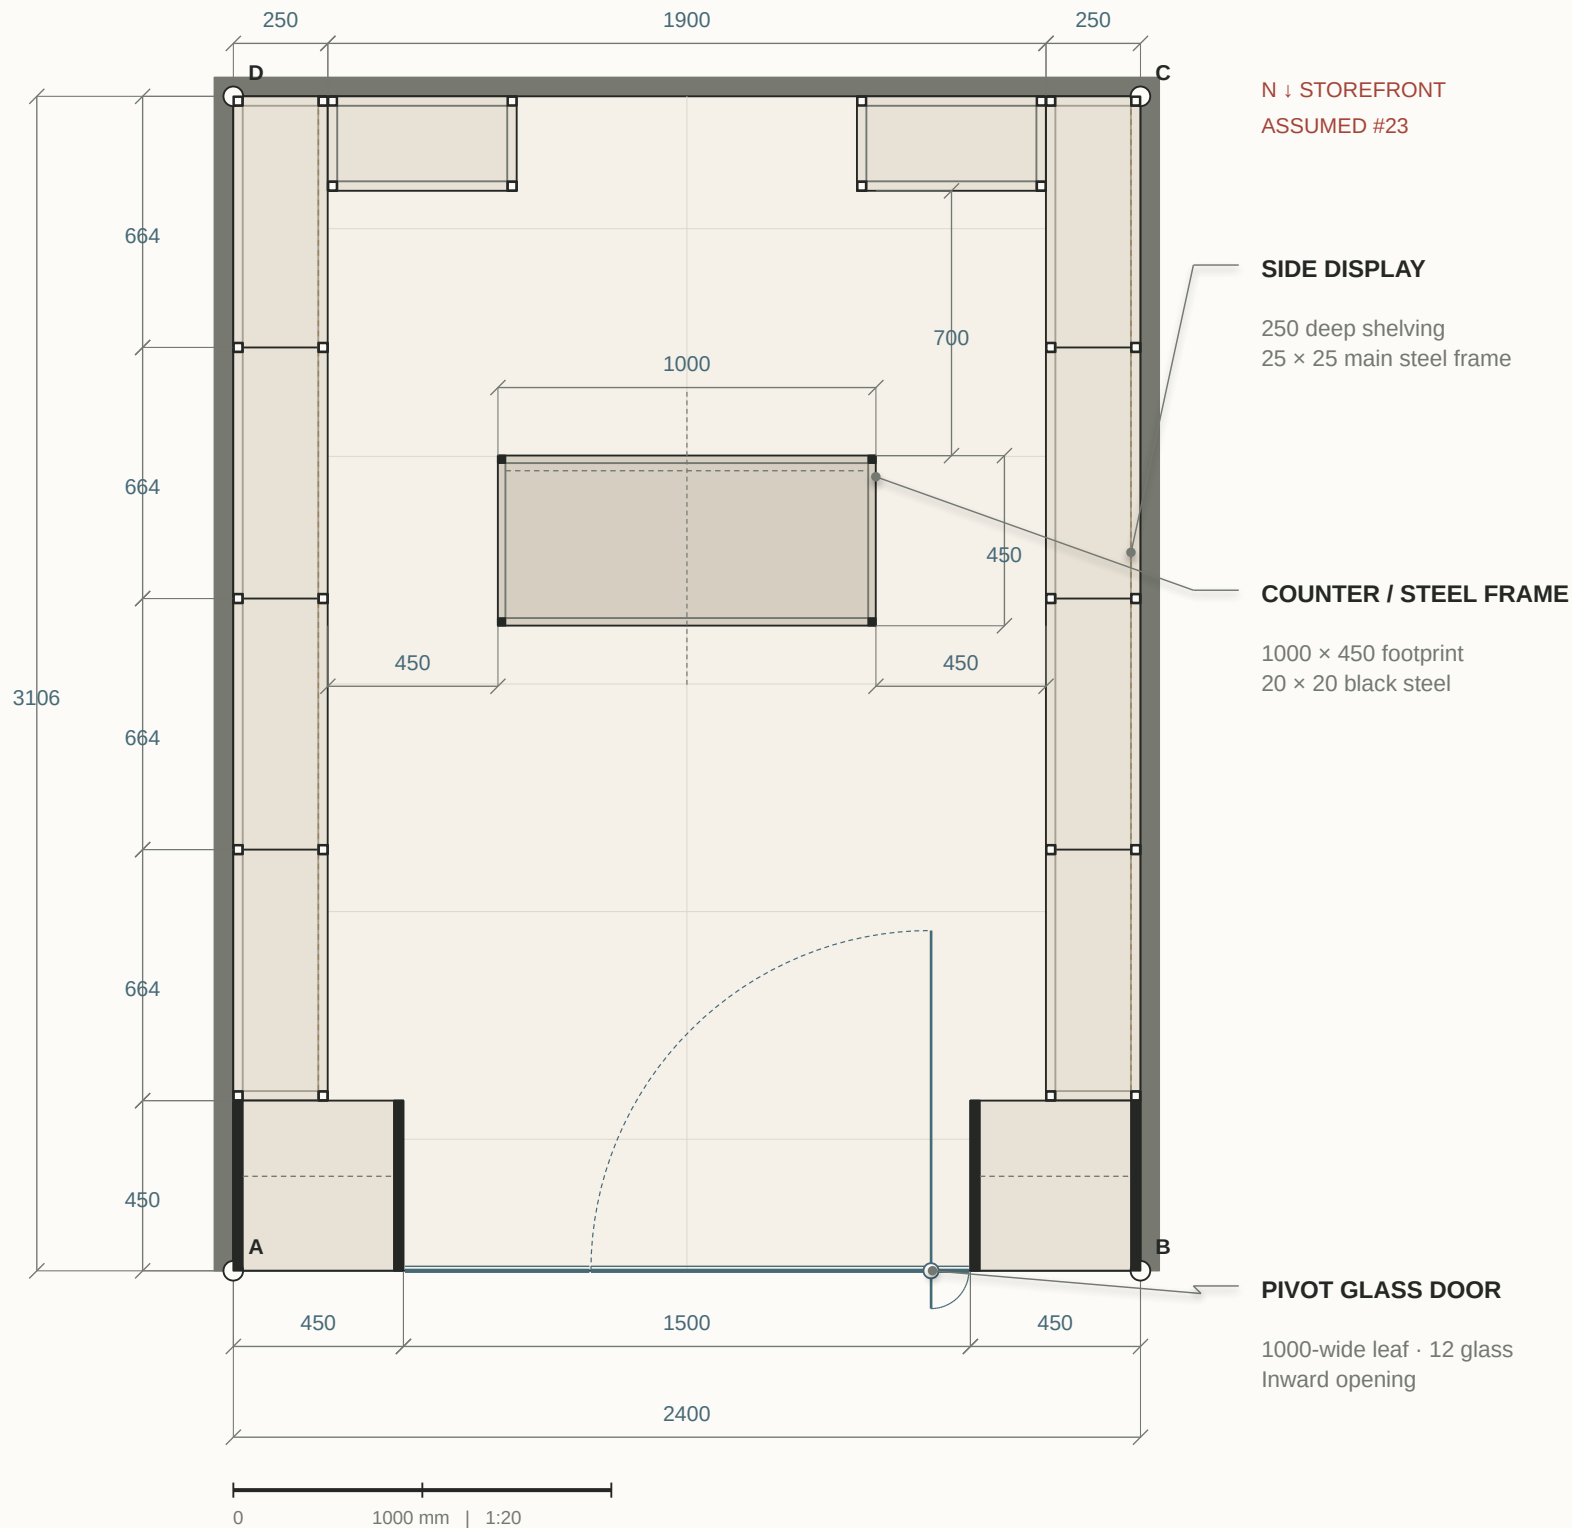


REAR / SIDE JUNCTION

LOCAL PLAN 1:5

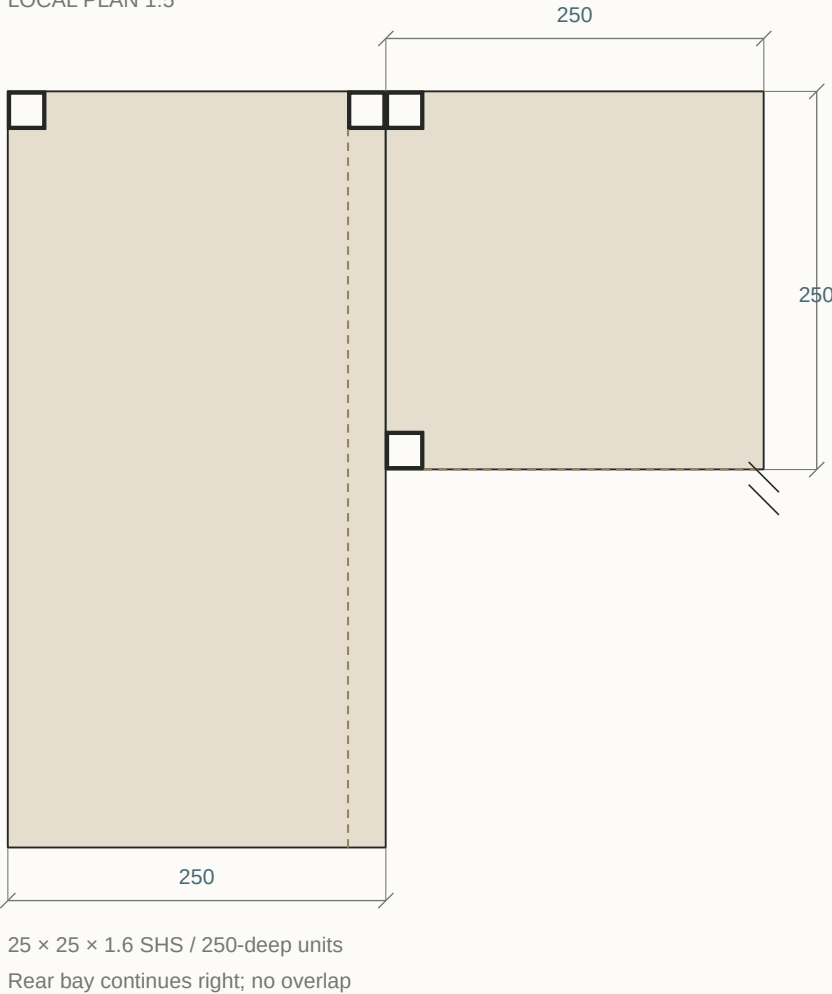

DOOR EDGE / PIVOT


LOCAL PLAN 1:2

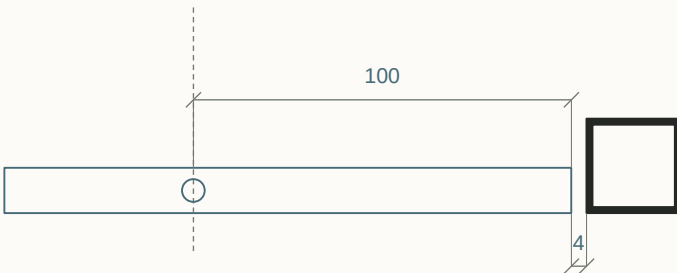

12 glass / 4 gap / 25 SHS · pivot fittings TBC #16


CEILING / LIGHTING COORDINATION

Reflected ceiling plan · lighting, display footprints and dimensional coordination

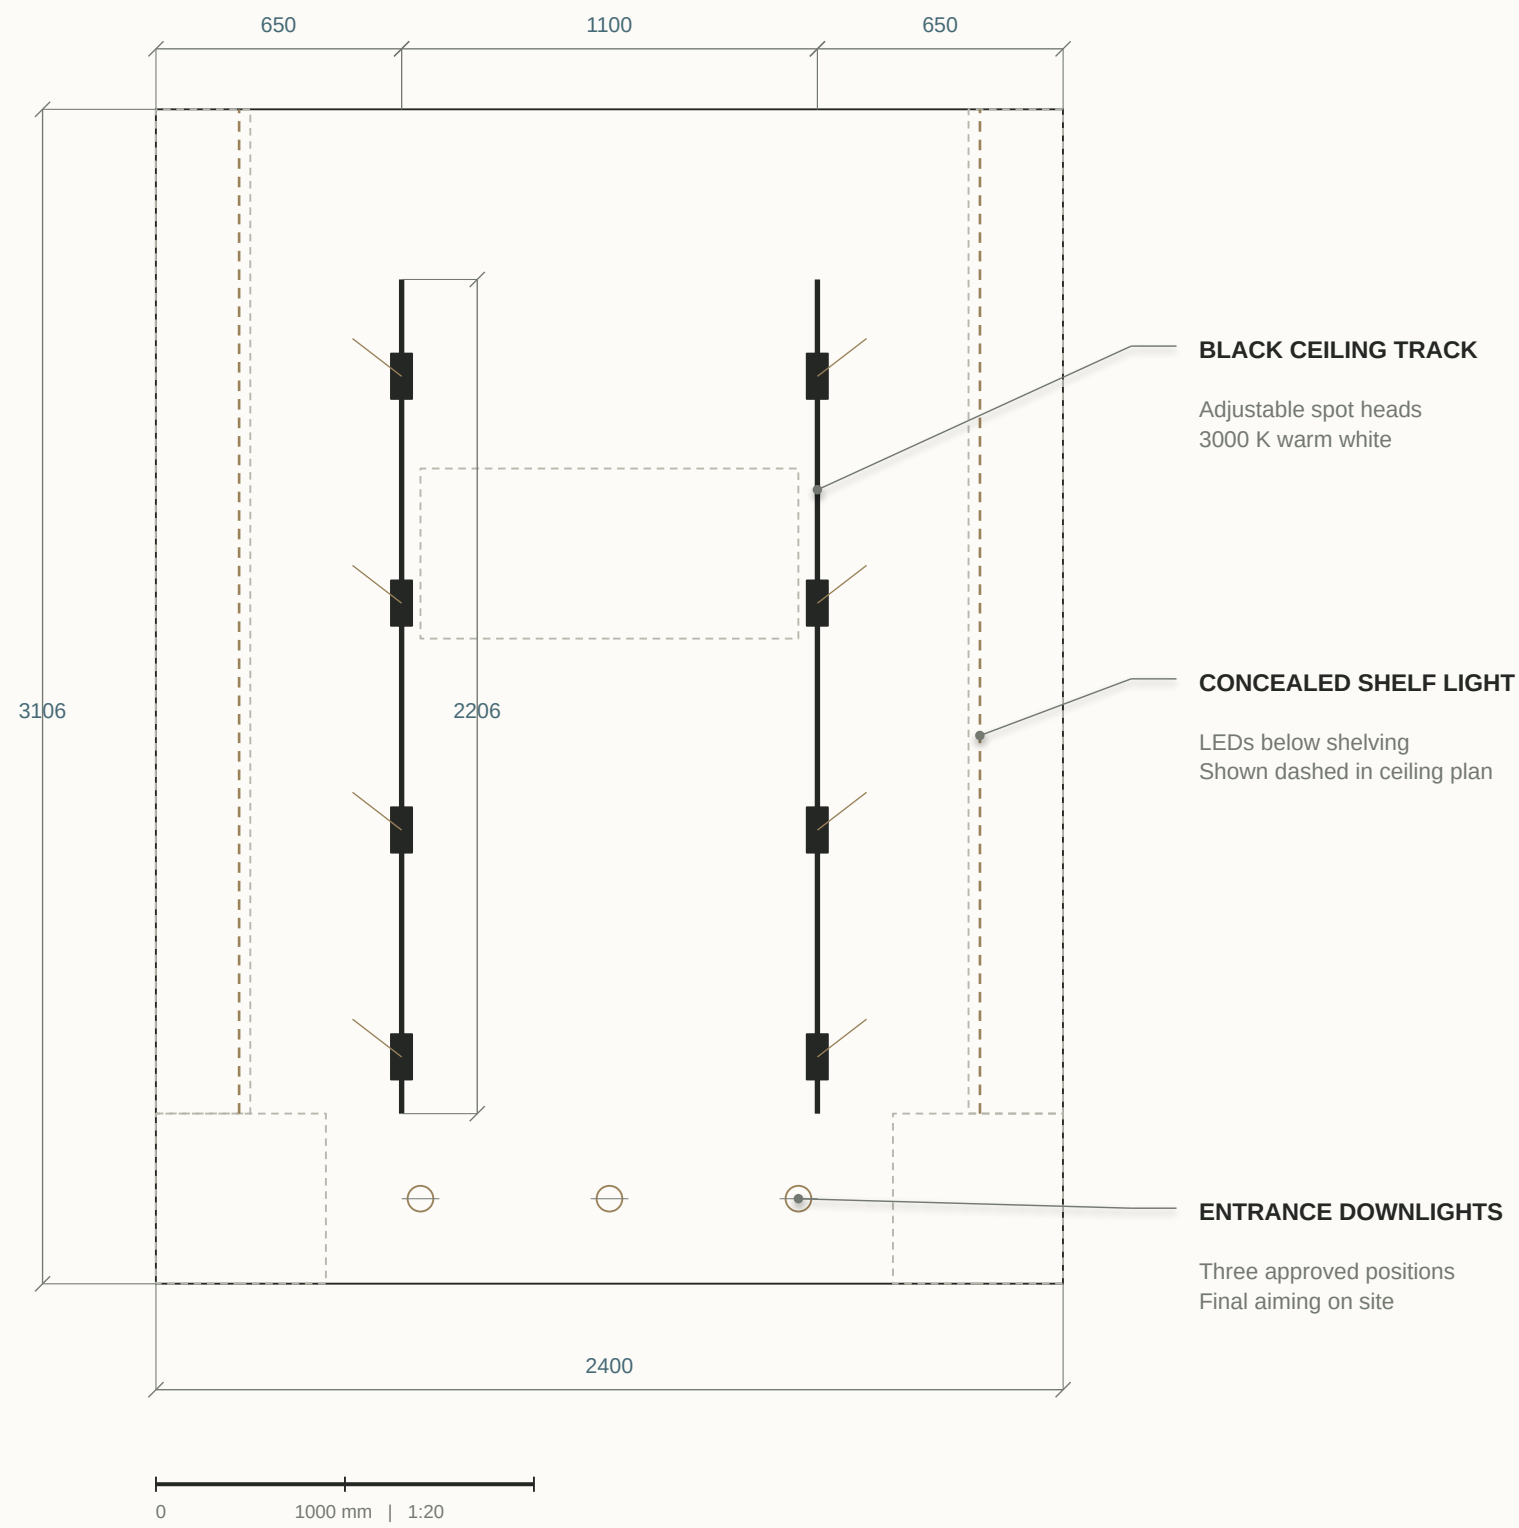

UNIT HEAD / CEILING


SECTION 1:5

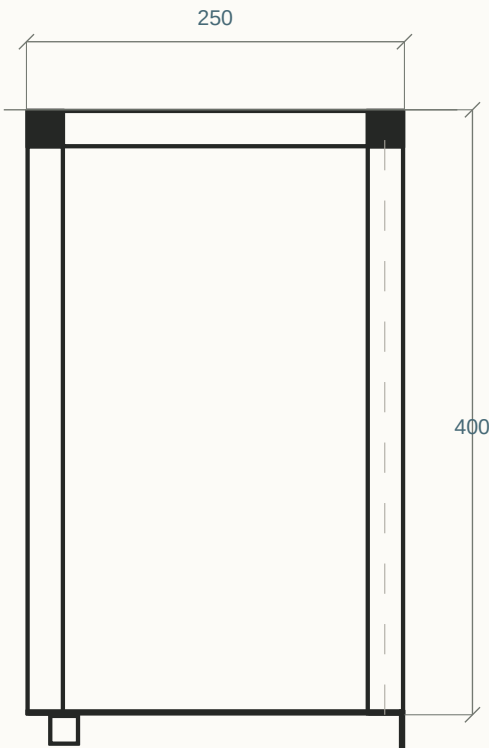

2600 ceiling / frame datum
Mesh zone 2200–2600 at front
Wall fixings TBC #16; no gypsum fixing

FOLDED TRAY / LIGHT

SECTION 1:2

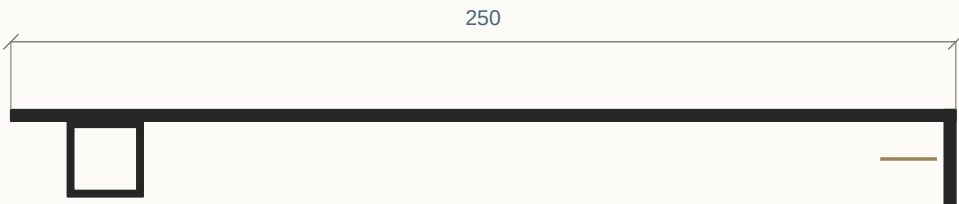


3 mm folded tray · 25 front downstand
20 × 20 × 1.6 support · LED profile TBC #16

STOREFRONT / EXTERNAL ELEVATION




Developed storefront · street-facing displays, glazed entrance and halo-lit brand

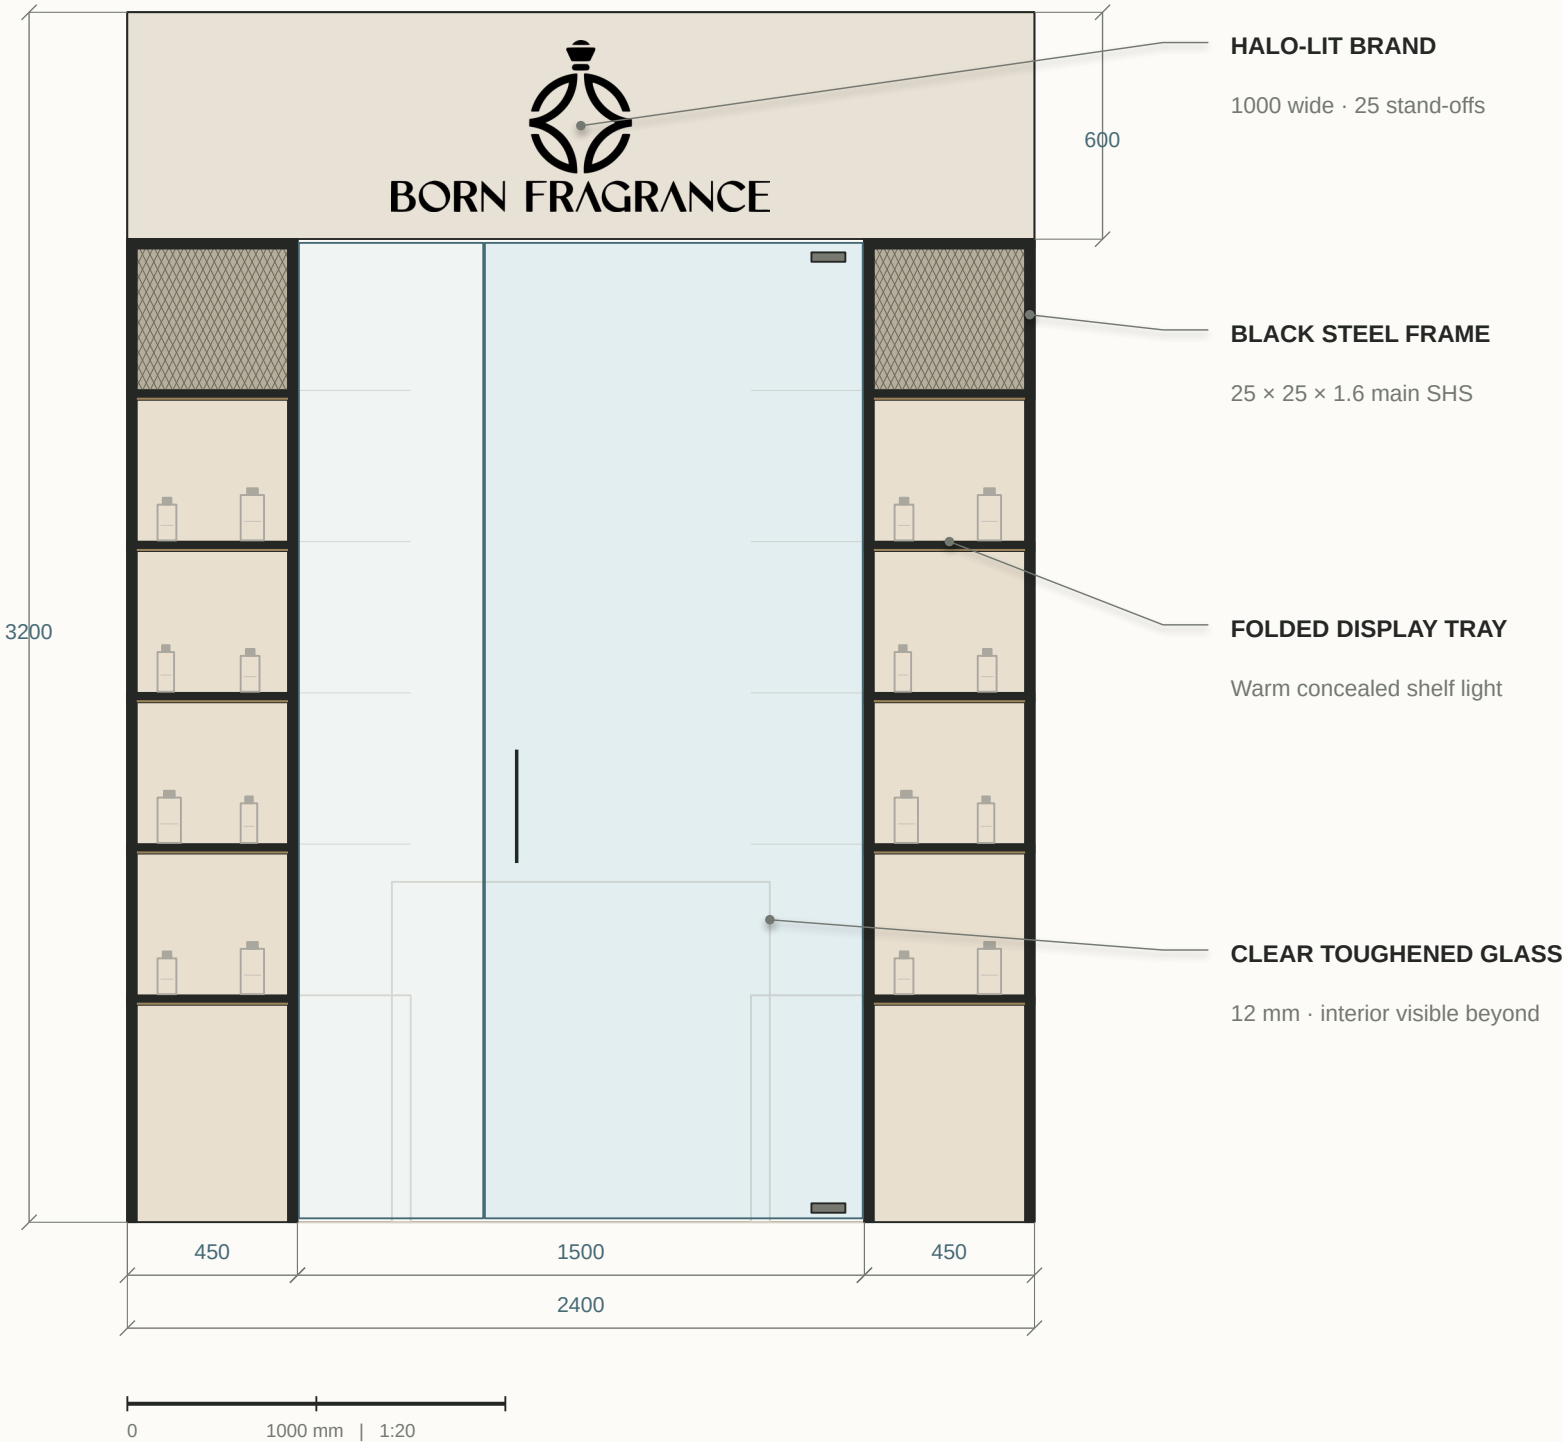

HALO LETTER / BACKING

STAND-OFF SECTION 1:2




25 stand-off · halo behind black letters
Backing / wall support / drivers TBC #16

REAR FOCAL WALL / INTERNAL ELEVATION




Rear focal wall · developed shelving + owner-directed counter front

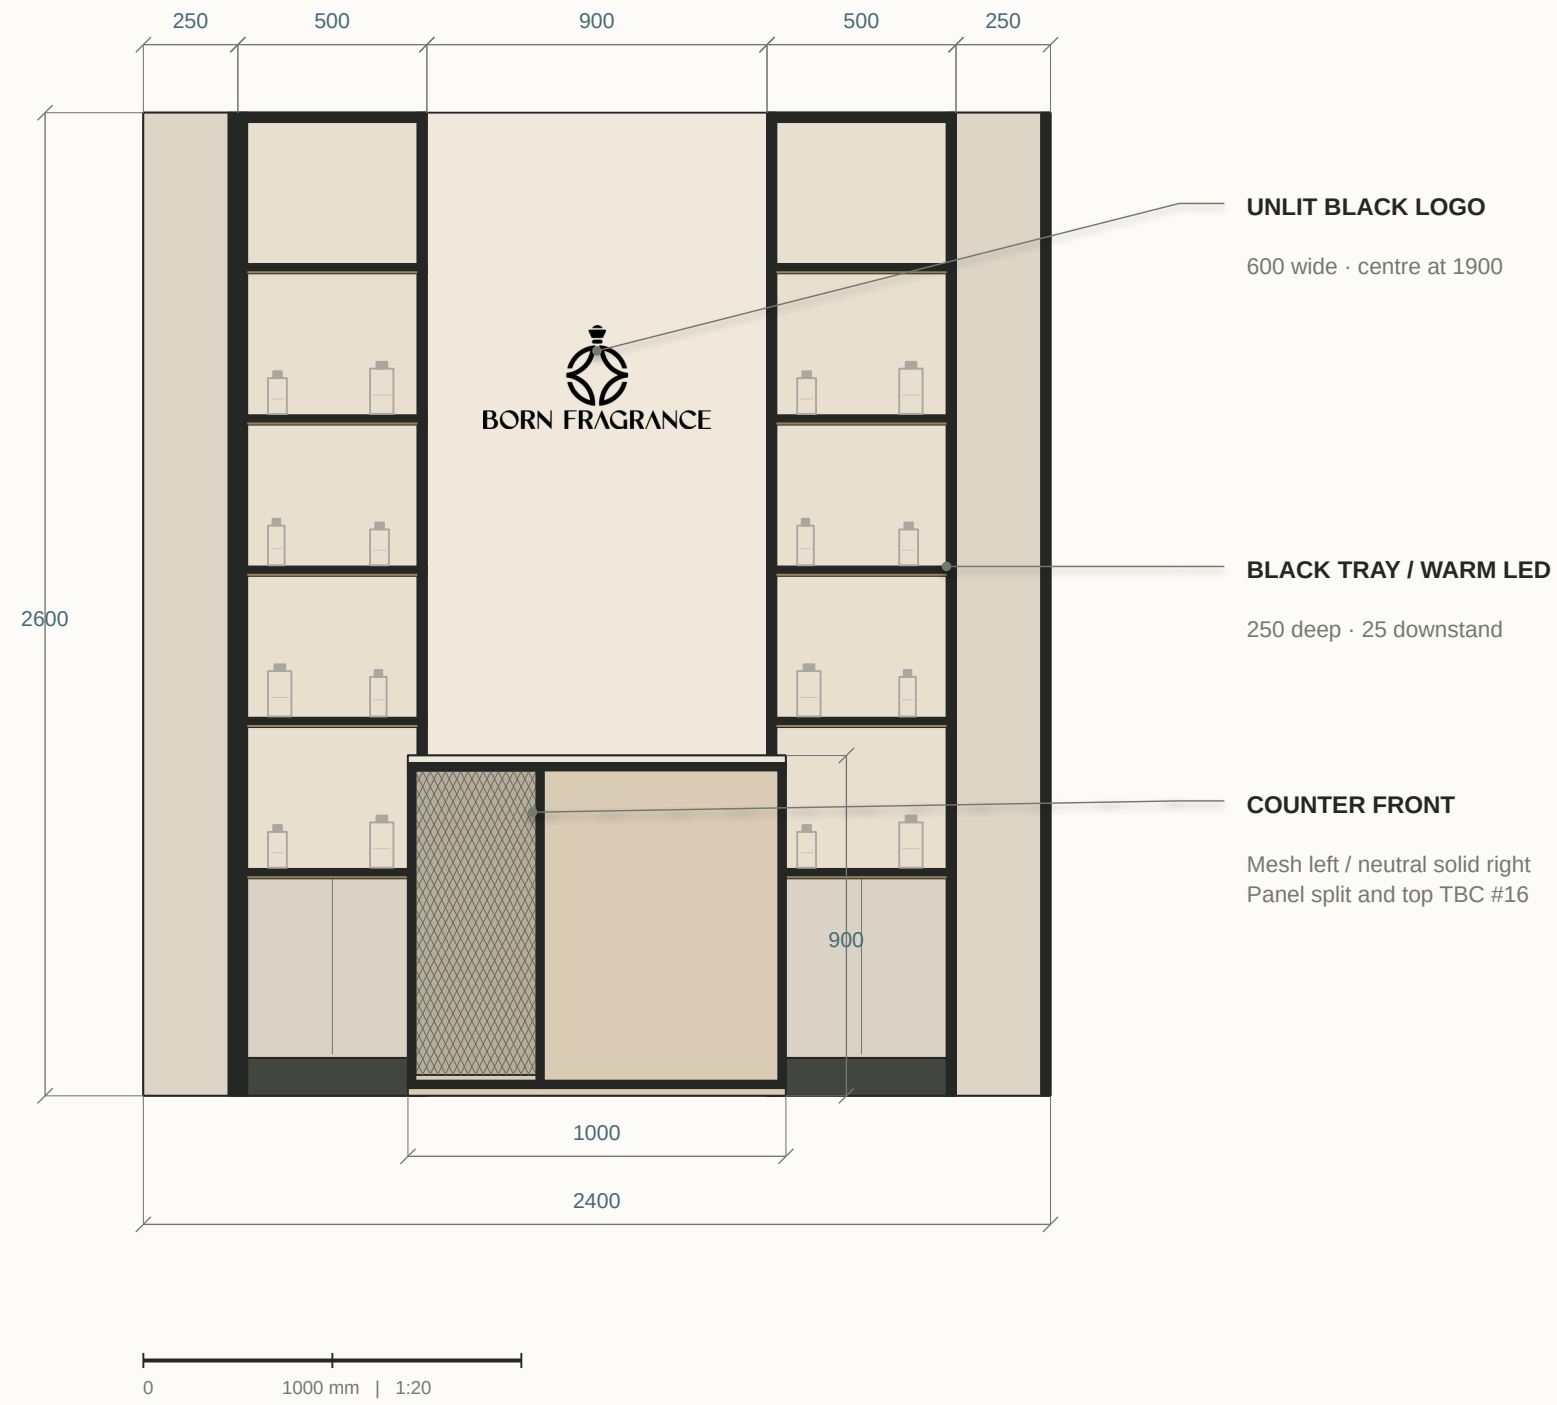


REAR SHELF / FRAME

SECTION 1:2

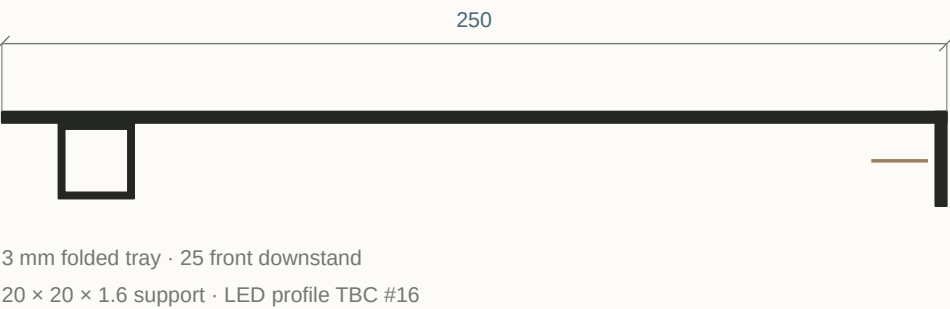

COUNTER / FOOTPRINT

PLAN 1:10

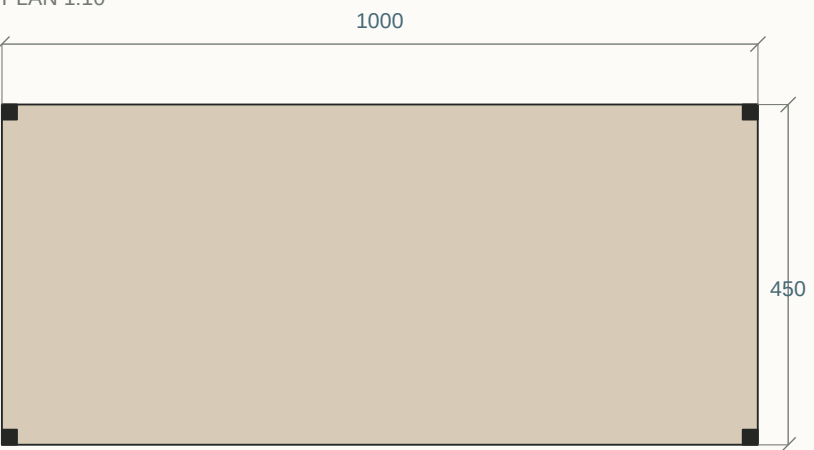



20 × 20 frame · front split TBC #16

LEFT DISPLAY / INTERNAL ELEVATION

Developed display elevation · interfaces + material codes · bottles indicative only

BLACK STEEL / NEUTRAL PPC / EXPANDED MESH / 3000 K LED

SOLID COLUMN
RETURN
Display faces street

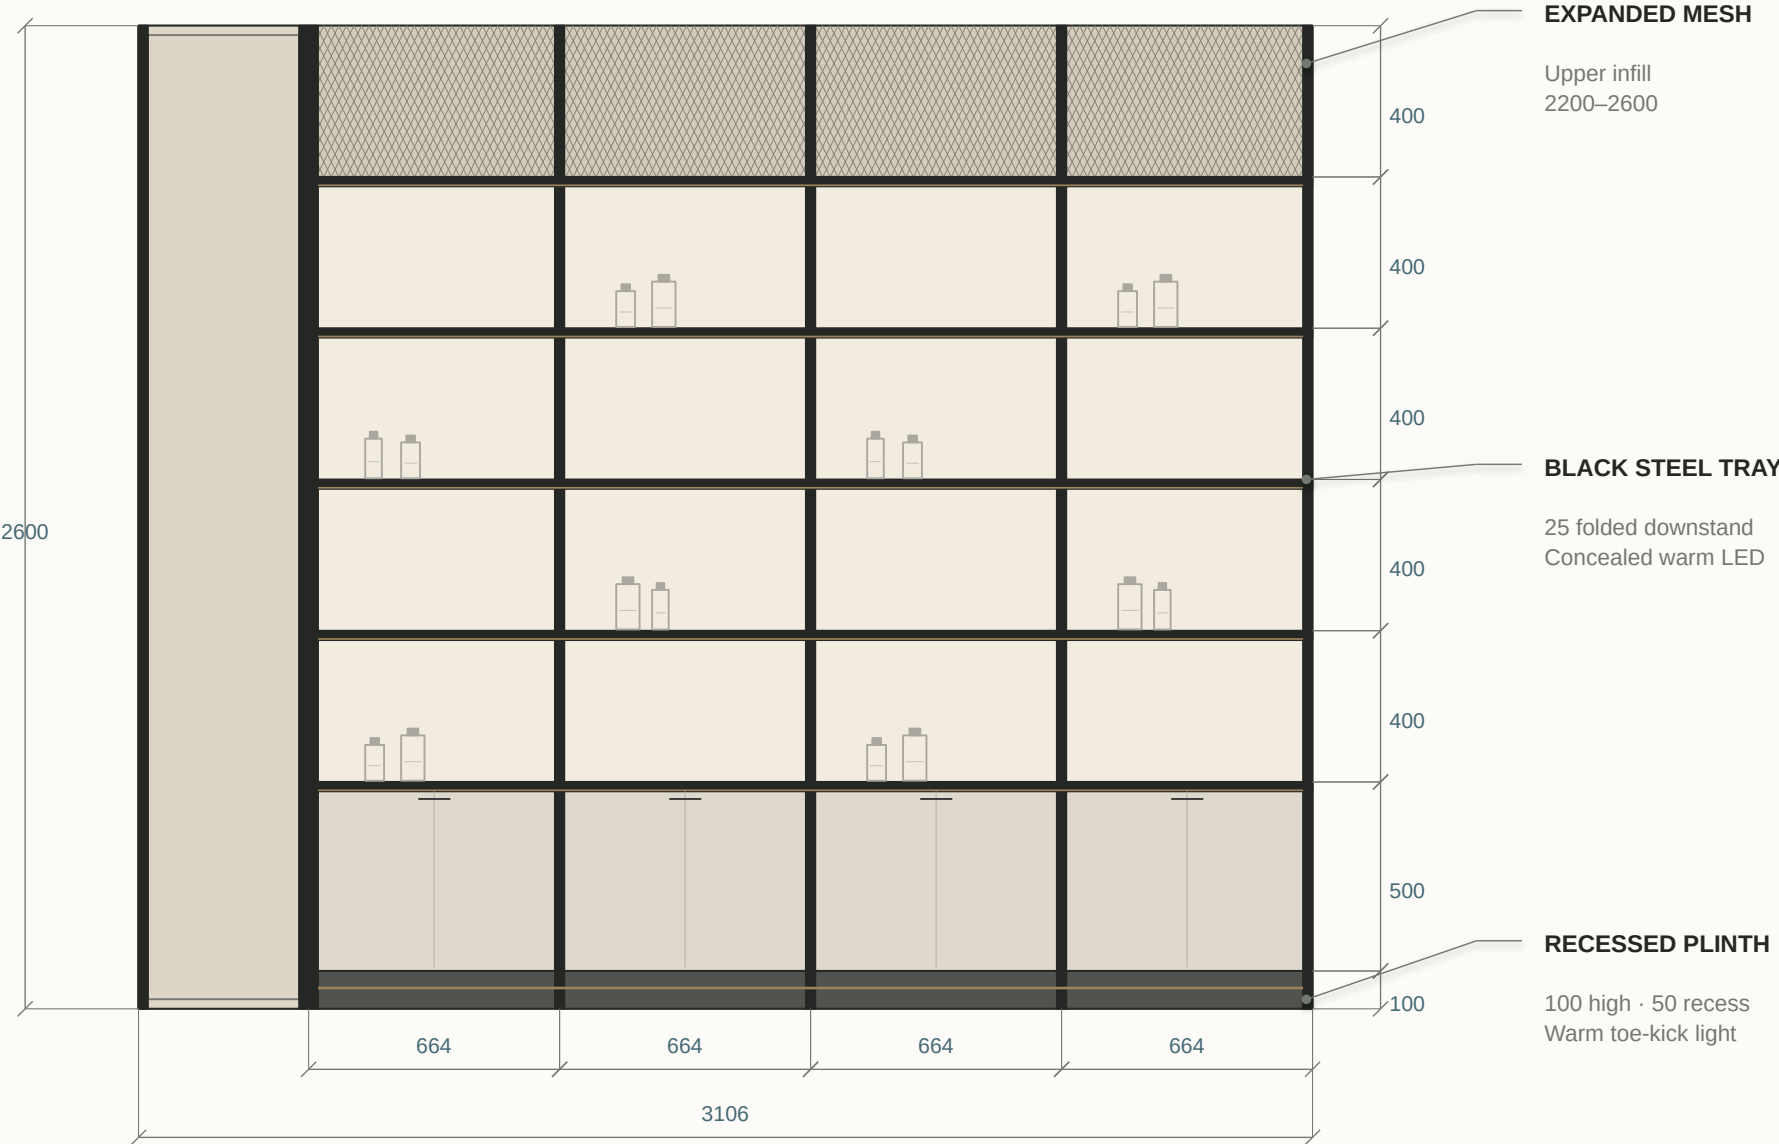

INDICATIVE BOTTLES · NOT A STOCK / CAPACITY SCHEDULE

SHELF / FRONT EDGE


SECTION 1:2



3 mm folded tray · 25 front downstand
20 × 20 × 1.6 support · LED profile TBC #16

CABINET / PLINTH

SECTION 1:5

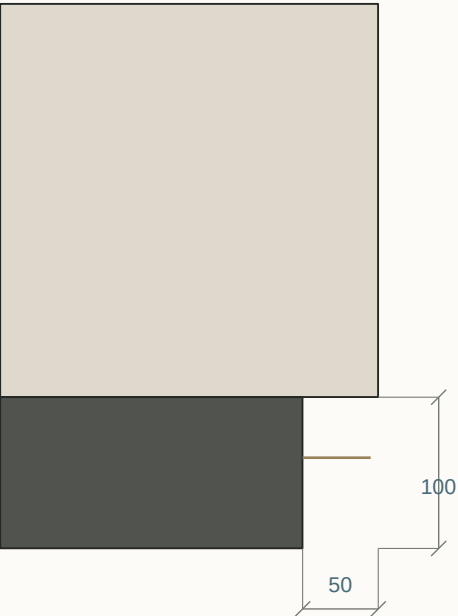


100 high · 50 recess · warm toe-kick LED

RIGHT DISPLAY / INTERNAL ELEVATION


Developed display elevation · interfaces + material codes · bottles indicative only

BLACK STEEL / NEUTRAL PPC / EXPANDED MESH / 3000 K LED

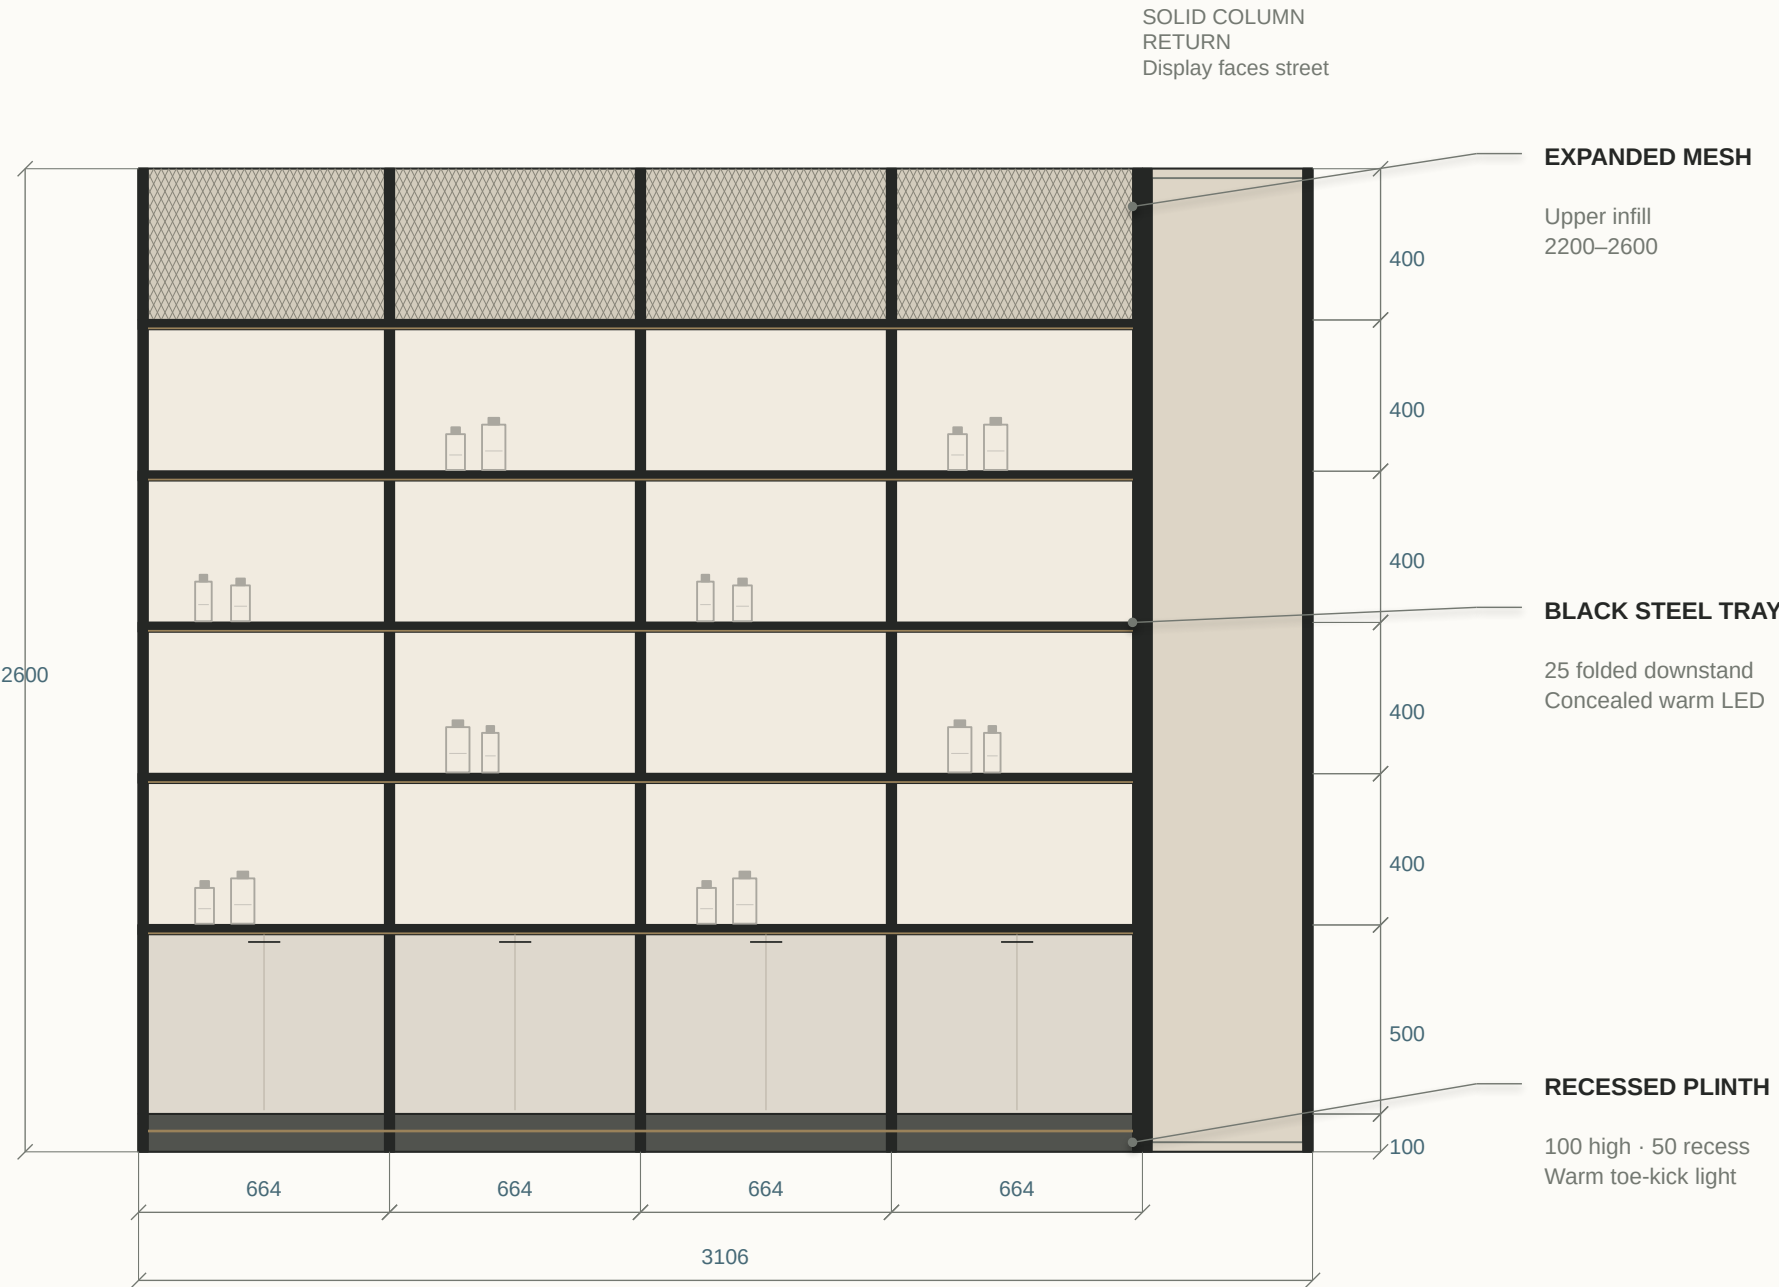


SHELF / FRONT EDGE

SECTION 1:2

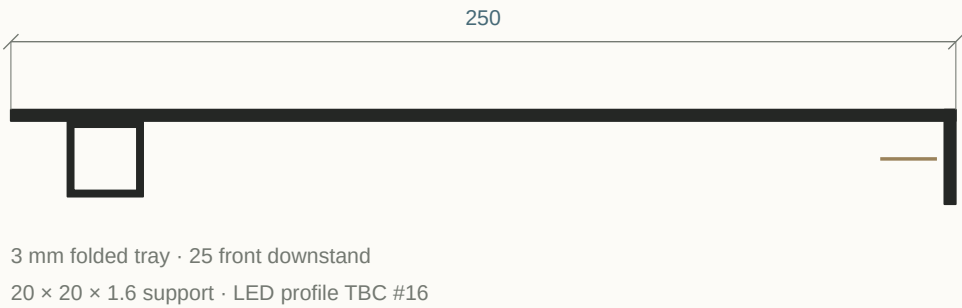

CABINET / PLINTH

SECTION 1:5

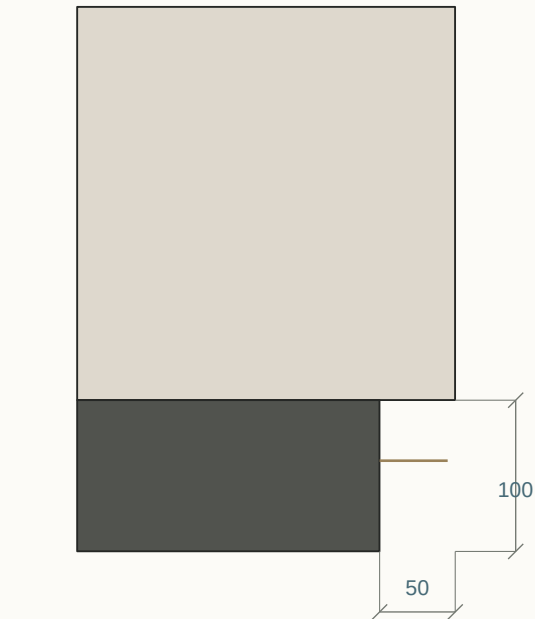


100 high · 50 recess · warm toe-kick LED

INDICATIVE BOTTLES · NOT A STOCK / CAPACITY SCHEDULE

SPATIAL ASSEMBLY / CUTAWAY AXONOMETRIC



Spatial cutaway · orthographic projection · direct material and interface annotations

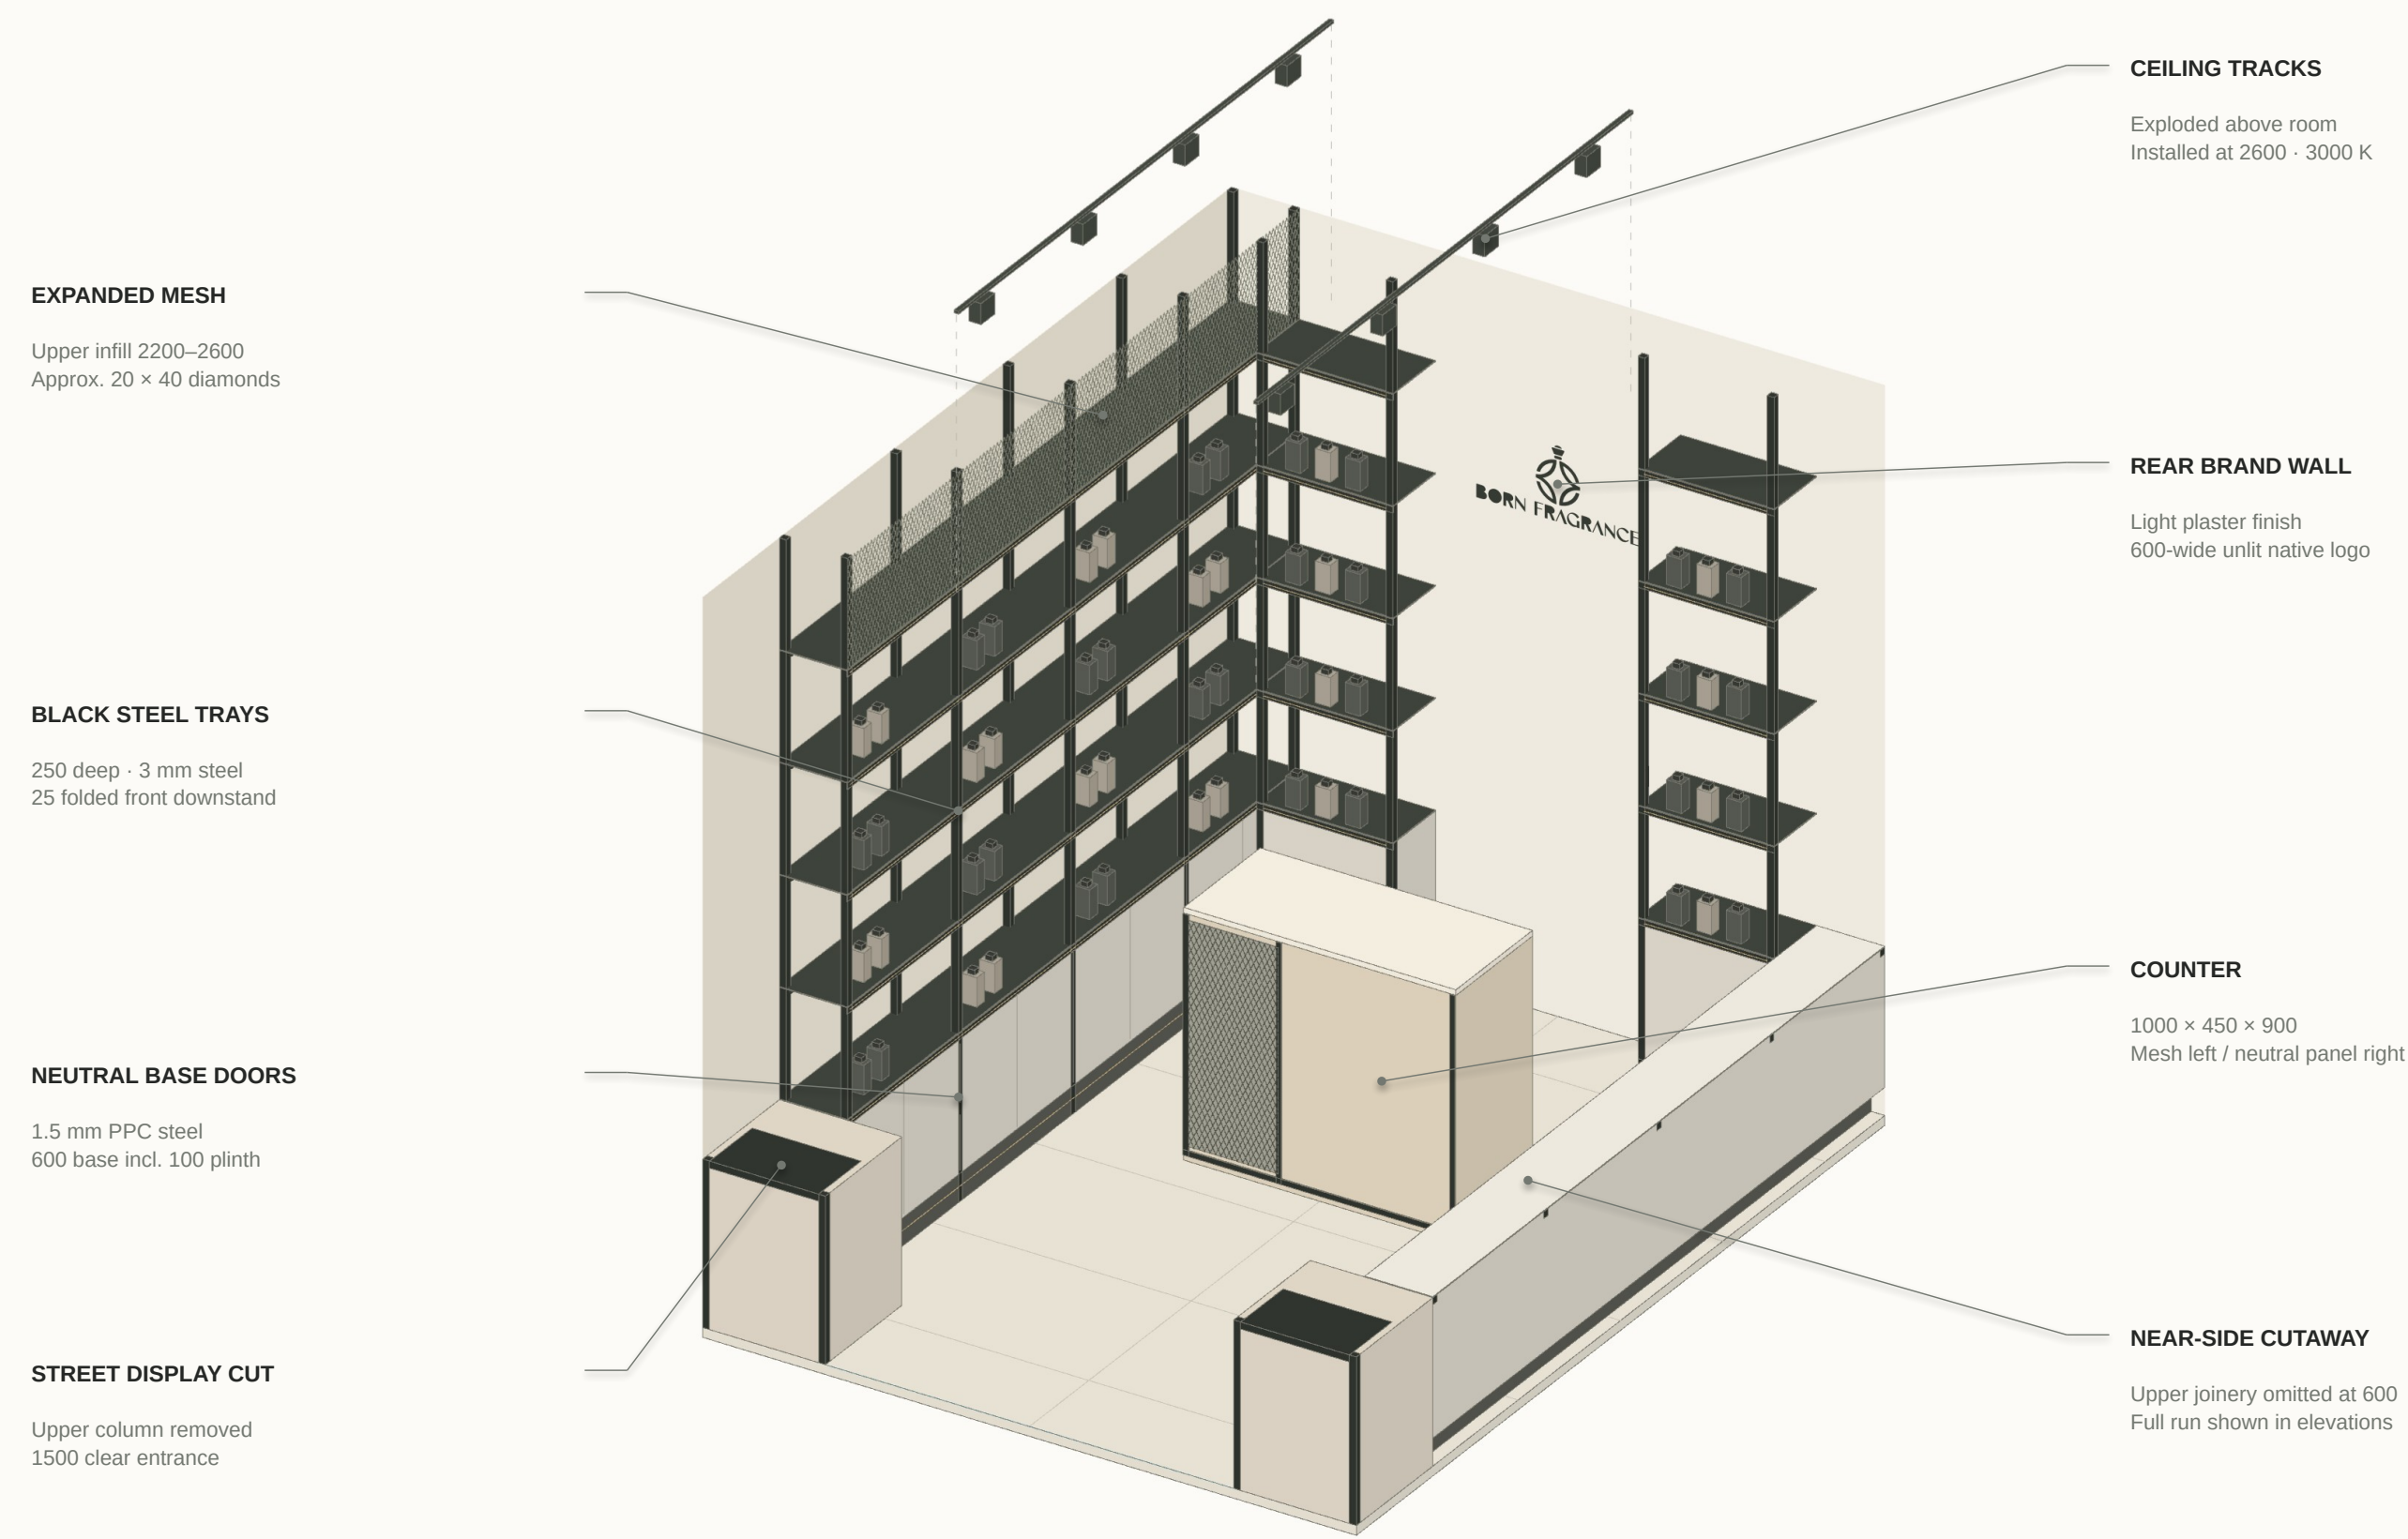

EXPANDED MESH

Upper infill 2200–2600
Approx. 20 × 40 diamonds

BLACK STEEL TRAYS

250 deep · 3 mm steel
25 folded front downstand

NEUTRAL BASE DOORS

1.5 mm PPC steel
600 base incl. 100 plinth

STREET DISPLAY CUT

Upper column removed
1500 clear entrance

CEILING TRACKS

Exploded above room
Installed at 2600 · 3000 K

REAR BRAND WALL

Light plaster finish
600-wide unlit native logo

COUNTER

1000 × 450 × 900
Mesh left / neutral panel right

NEAR-SIDE CUTAWAY


Upper joinery omitted at 600
Full run shown in elevations

ORTHOGRAPHIC CUTAWAY · NTS · ceiling plane removed

Display module / fabrication logic

AP-12 · typical module and installation sequence

LOWER MODULE / UPPER ZONE CONTINUES

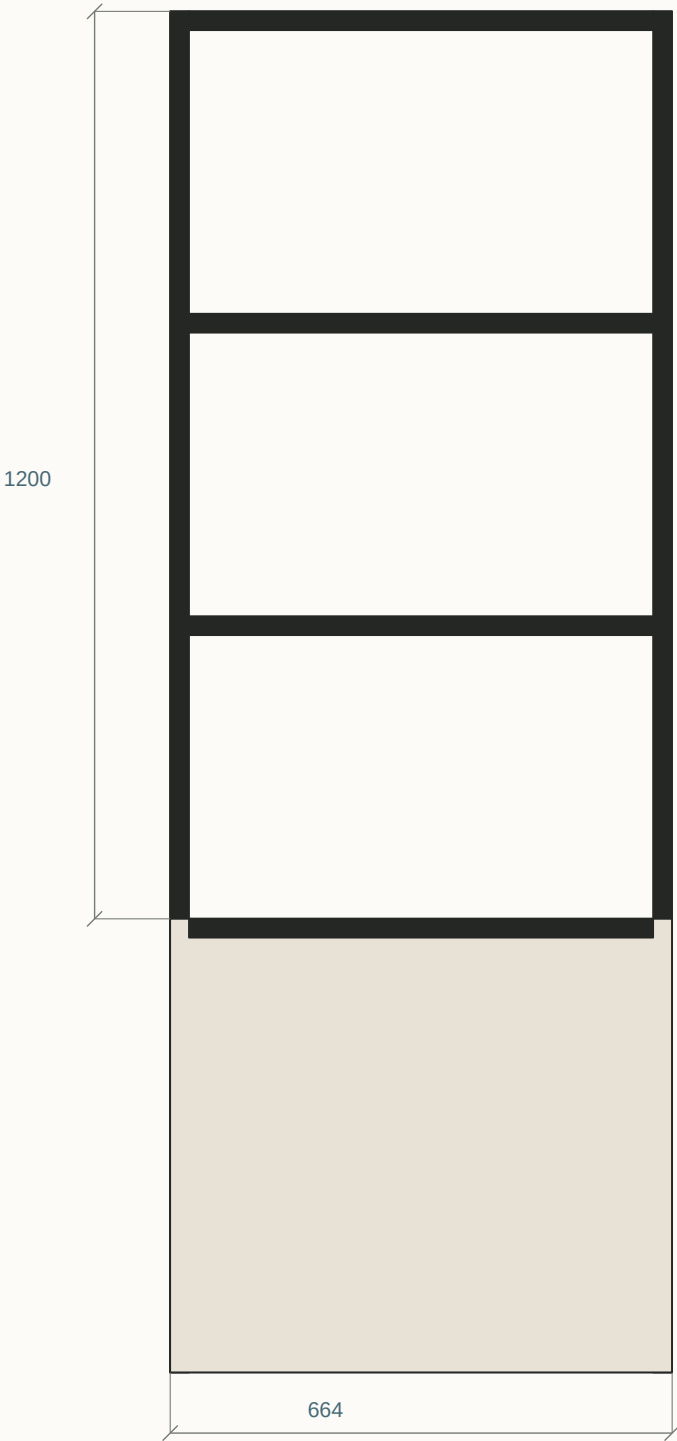

PROPOSED #16

Drawing shows an isolated module.
Do not copy 614 clear to shared-post bays.

Shelf fit clearance and frame segmentation require fabricator approval.

Full elevation: AP-08 / AP-09.

MODULE ≠ CUT SIZE

664 is the module allocation. Shared 25 posts are centred at internal boundaries; end posts are inside run ends.

UPRIGHT CENTRES

y=462.5 / 1114 / 1778 / 2442 / 3093.5. Clear spans: 626.5 / 639 / 639 / 626.5 before fit allowances.

WORKSHOP

Weld frames on jigs; deburr; prepare and coat. Confirm weld size, distortion allowance and coating buildup #16.

SITE

Survey → dry fit → level/adjust → anchor to verified floor/wall
→ connect services → fit removable trays and mesh. No gypsum anchorage.

Shelf / frame / concealed LED

AP-13 · section through 250-deep display shelf

01 TRAY + DOWNSTAND 02 SUPPORT SHS 03 REMOVABLE LED CHANNEL



TBC #16 — LED housing drawn as an indicative envelope. Confirm housing, fixing and setback against the selected product. No drilling schedule released.

CONFIRMED

3 mm folded MS tray. 25 front downstand. 250 total shelf projection. 20 × 20 × 1.6 support SHS.

LIGHTING STRATEGY

Removable aluminium LED channel beneath tray; diffuser screened by downstand. 3000 K. Profile, setback and wattage TBC #16.

SERVICE ACCESS


Tray/channel accessible from below. Concealed cable follows rear upright with protected holes, grommets and strain relief.

LOAD / FIT

Shelf loading, span deflection, welds, fasteners and actual LED housing dimensions require fabricator/consultant confirmation.

Mesh / lighting / service access

AP-14 · removable components and segregated service routes

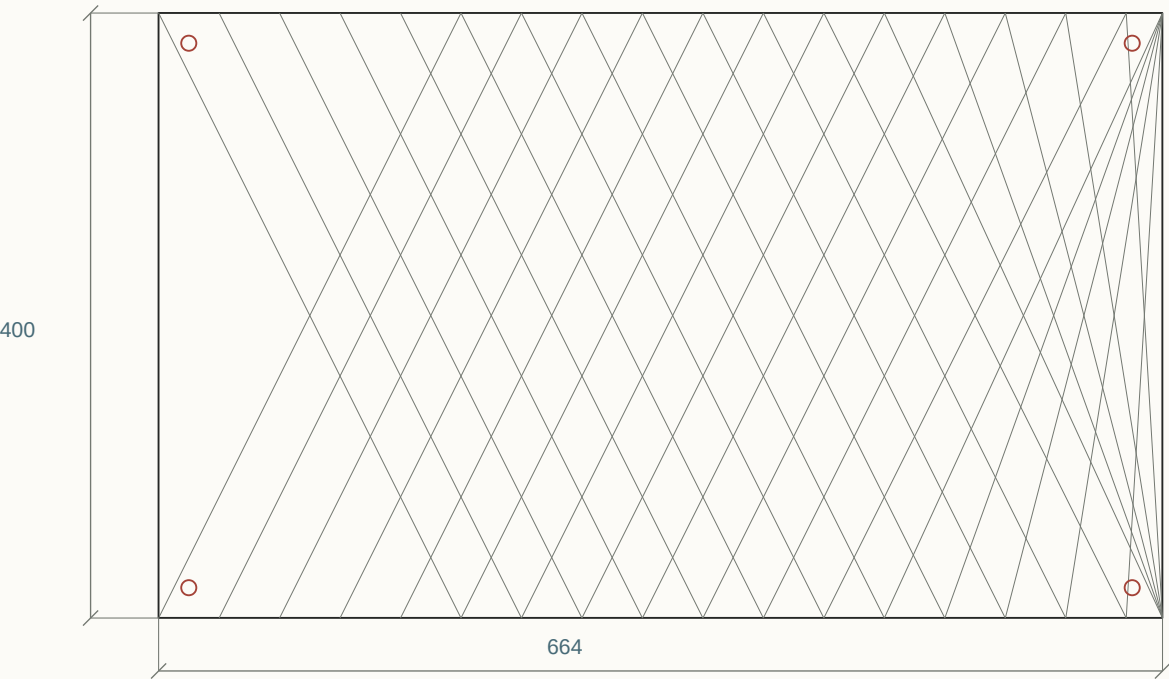

TBC #16 — PANEL + SERVICE STRATEGY

Workshop-welded steel subframe → deburr and coat → demountable mesh cassette.

Accessible mains isolation → ventilated driver zone → protected LV route in upright → shelf channels.

Fixing centres, panel gauge and ventilation area are unapproved. Diagram is not a product specification.

MESH PANEL

2200–2600 front infill only. Approx. 20 × 40 diamond mesh; gauge, strand width and open area TBC #16.

EDGE / REMOVAL

Capture cut mesh edges in removable perimeter frame. Screw-fix accessible panel to main structure; no sharp exposed edges.

LED DRIVERS

Locate in accessible ventilated cabinet service zone. Keep maintenance reachable without dismantling the display.


ELECTRICAL

Separate mains/data/low-voltage routes as required by consultant. Driver rating, cable sizes, ventilation and circuits remain #16.

Storefront head / structural interface

AP-15 · glazing head and pivot reinforcement strategy

VERIFIED STRUCTURE — TYPE / DEPTH TBC

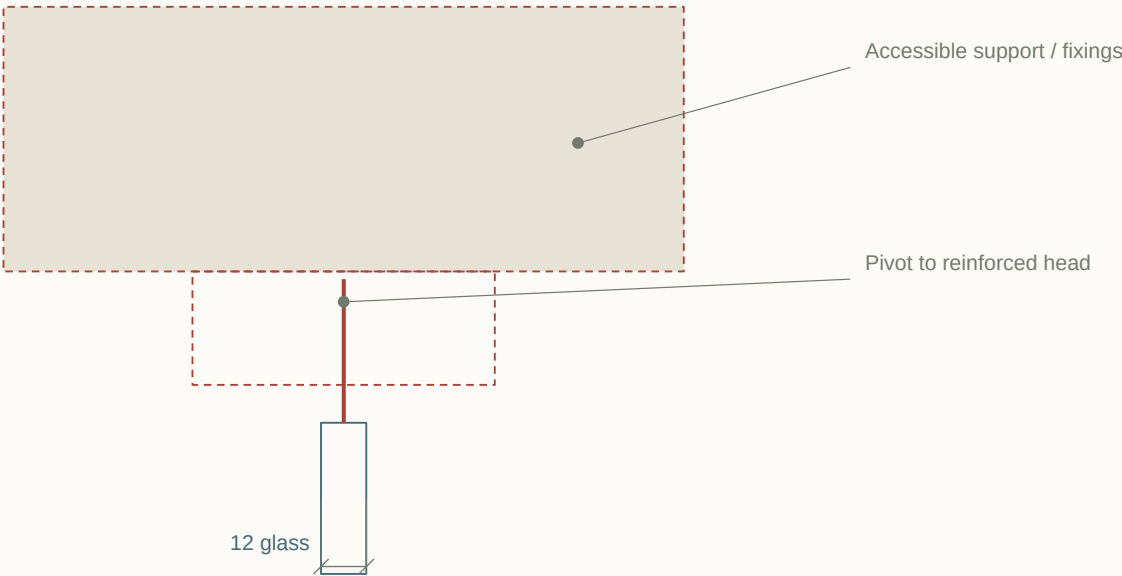

TBC #16 / #26 — reinforcement, pivot housing and substrate shown diagrammatically. No anchor size or structural capacity specified. Head detail coordinates with AP-16 / AP-17.

DOOR HEIGHT

2580 door within 2600 opening leaves 20 total vertical allowance. Propose 10 top / 10 bottom; glazier to confirm #16.

LOAD PATH

Top pivot fixed to engineered steel support tied to verified structure. Plaster / gypsum and fascia are not structural supports.

FASCIA ACCESS

Removable internal access panel for pivot inspection and sign driver. Panel size and backing construction TBC #16/#26.

GLASS RELEASE


Confirm door mass, hardware capacity, deflection limits, hole positions and approved glass fabrication drawings before cutting.

Glazed entrance / jamb and pivot

AP-16 · horizontal joint chain and operation envelope



FIXED PANE → DOOR JUNCTION / PARTIAL LEAF

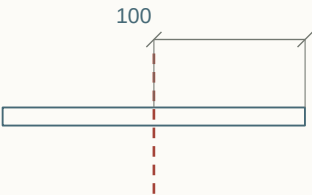

PIVOT ZONE / RIGHT EDGE

TBC #16 — supplier to resolve pane edge support, seal pockets, pivot footprint and operating clearances before glass order.

WIDTH CHAIN

$4 + 488 + 4 + 1000 + 4 = 1500$. Nominal gaps are design allowances, not approved glass fabrication dimensions.

PIVOT

100 from right door edge, viewed externally. Inward opening. Long-side sweep radius 900; short tail radius 100.

SEALS / EDGES


Compatible removable gaskets, setting blocks and edge protection. Seal thickness and compression to glazier details #16.

COORDINATION

Confirm effective clear opening, short-tail sweep, handles and stops. 1000 leaf width does not certify a 1000 clear escape opening.

Flush threshold / floor interface

AP-17 · accessible level transition and recessed hardware

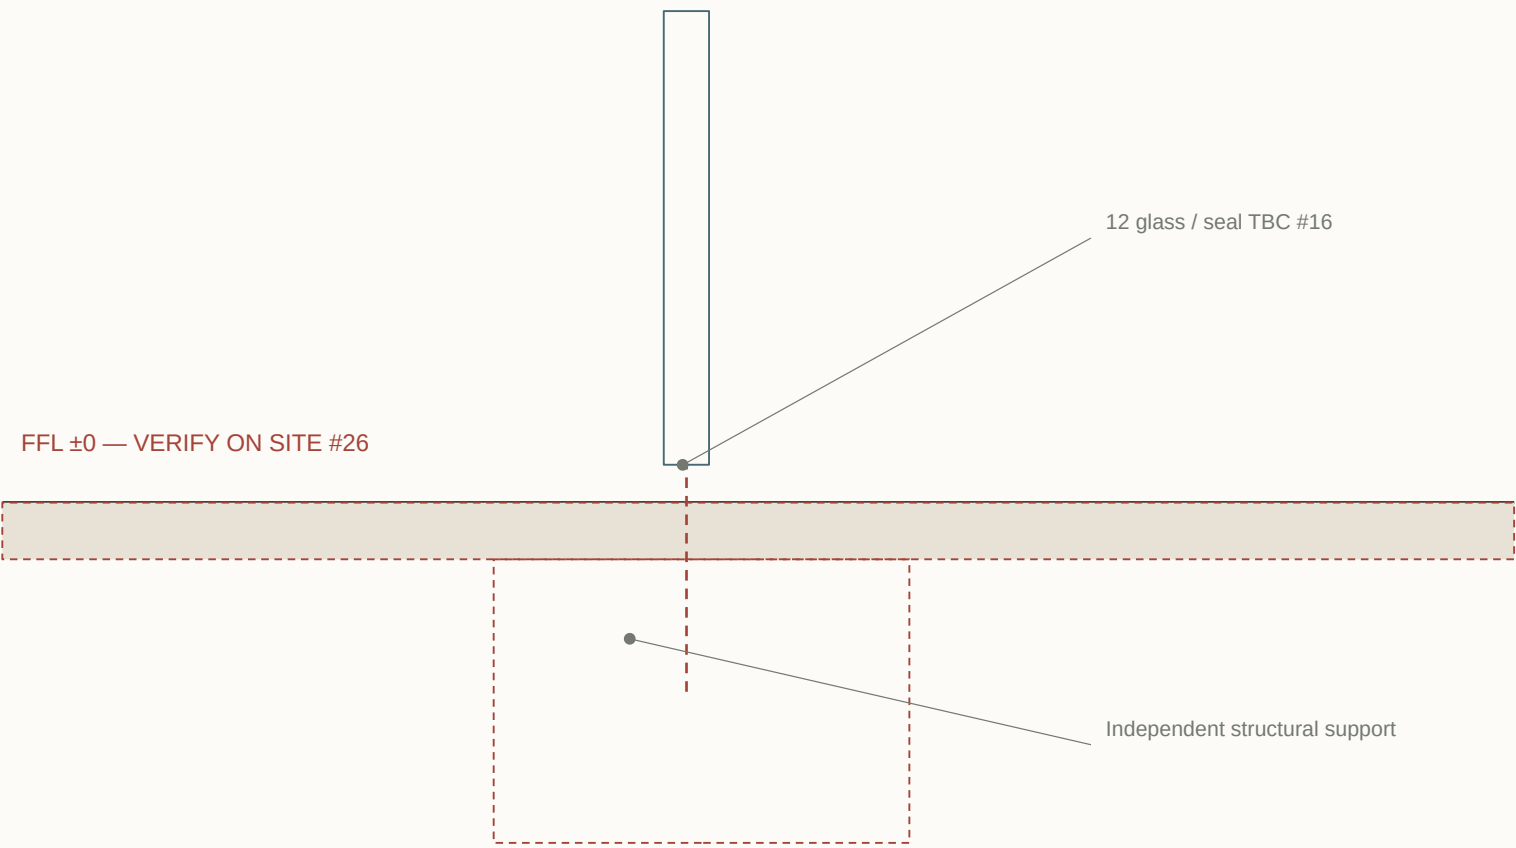

DESIGN LEVEL

No step or raised sill. Internal and external finished surfaces meet flush; external levels require survey #26.

FLOOR PIVOT

Recessed pivot/closer supported by verified structural substrate. Independent of tile and adhesive; removable cover flush with FFL.

MOVEMENT / SEAL

Maintain 5 perimeter movement allowance where applicable. Compatible flexible seals; do not bridge joints with rigid grout.

SITE CONFIRMATION


Slab depth, services, damp protection and external drainage must be verified before recessing hardware or setting threshold level.

TBC #16 / #26 — tile/adhesive/slab thicknesses and hardware pocket are indicative. Preserve the flush finished level; coordinate seals and maintenance access.

Halo-lit sign / demountable backing

AP-18 · external logo section and maintenance access

STRUCTURAL BACKING / ACCESS PANEL TBC

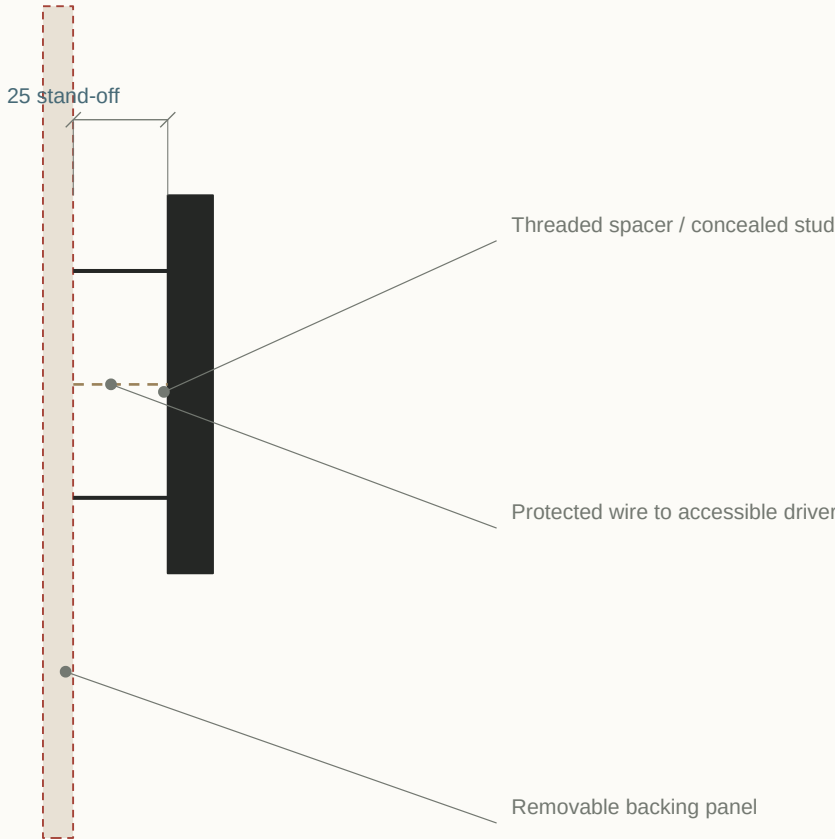

BRAND / FINISH

1000 W black logo; uniform native SVG geometry. Halo-lit, 3000 K visual intent. No brass elements.

STAND-OFF

25 stand-off behind logo. Concealed threaded spacers to engineered backing; fastener size and count remain #16.

POWER / ACCESS

Protected cable penetration to accessible driver on removable internal backing panel. Strain relief and isolation accessible.

FABRICATION

Confirm return depth, LED spacing, weather exposure, fixing template, driver enclosure and backing capacity with sign specialist.

TBC #16 / #26 — backing thickness and logo return depth are indicative. Show a removable driver-access panel; do not permanently seal the service compartment.

Rear wall / display-to-wall connection

AP-19 · maintainable back-panel and service junction



TBC #16 / #26 — this is a partial-height panel strategy. Confirm actual panel extent, reveal and wall finish build-up. Separate demountable metal from plaster; no load transfer to gypsum ceiling.

CENTRAL ZONE

900 design zone, 875 clear between shared 25 uprights. 600 logo leaves 137.5 each side within that clear width.

NON-ILLUMINATED

Rear logo remains black and non-illuminated. Cable routes serve adjacent shelf LEDs only.

WALL FIXING

Floor/wall-fixed structure. Adjustable brackets to verified substrate; isolate finish from structural fixings.


MAINTENANCE

Removable central light-neutral metal panel on accessible clips/screws. Panel gauge, fasteners and reveals TBC #16/#26.


Counter / plan, elevation and section

AP-20 · 1000 × 450 × 900H retained


01 PLAN — 1000 × 450

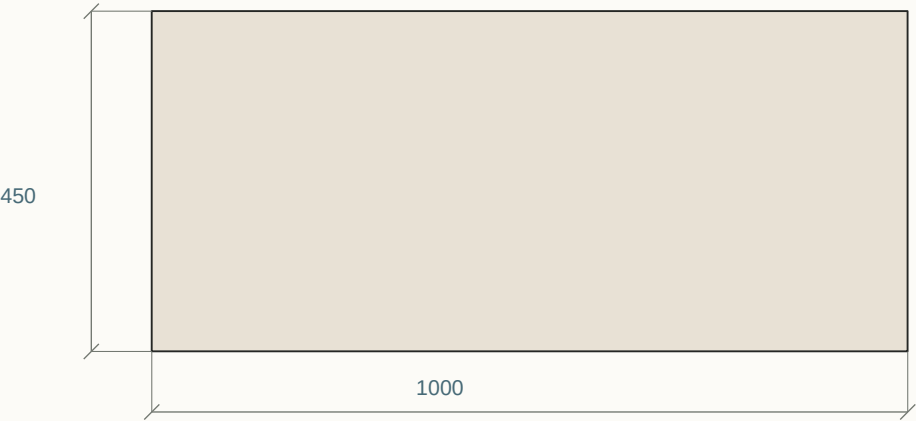

02 FRONT ELEVATION

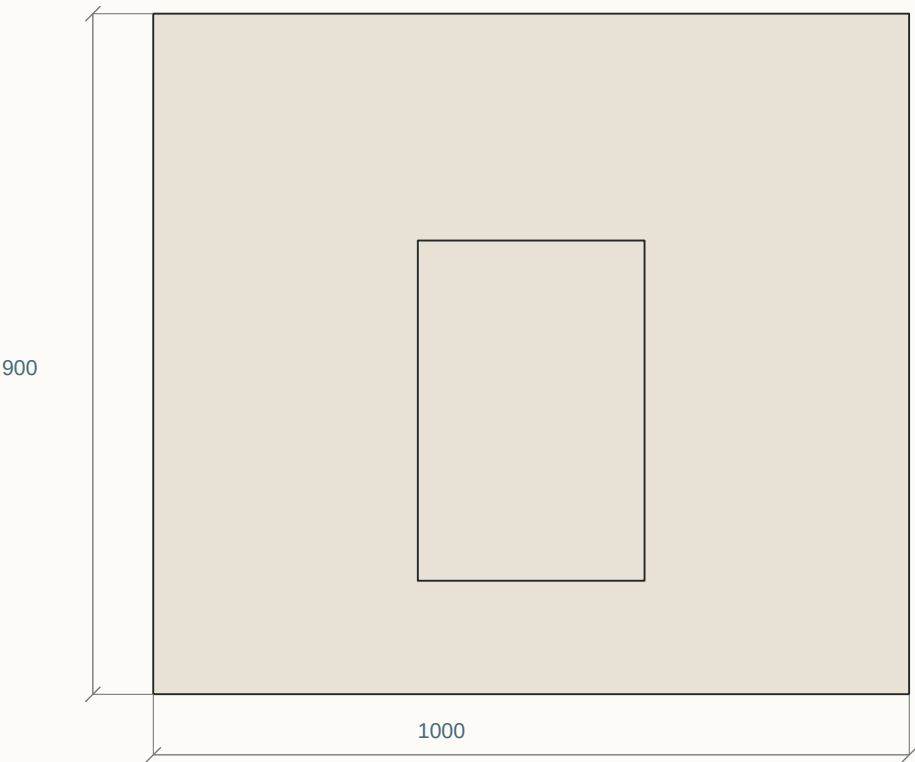


03 SECTION

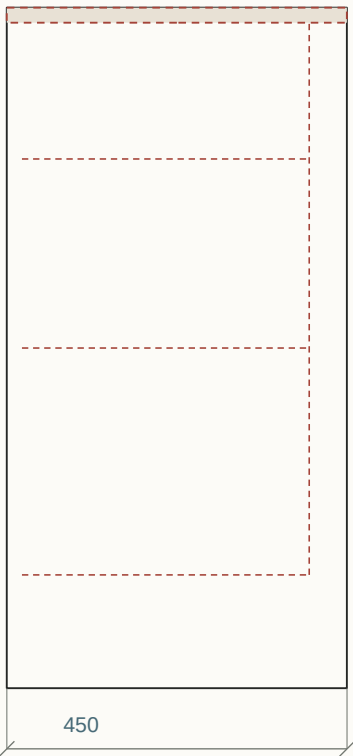

TBC #16 / #26 — counter interior is a proposed arrangement: 20 top, steel carcass/frame, removable storage trays, rear service chase and adjustable feet. Confirm all new thicknesses, storage layout, service clearances and feet before fabrication. External 1000 × 450 × 900 and 300 × 450 mesh insert remain confirmed.

Counter / services and removable access

AP-21 · section through proposed service compartment

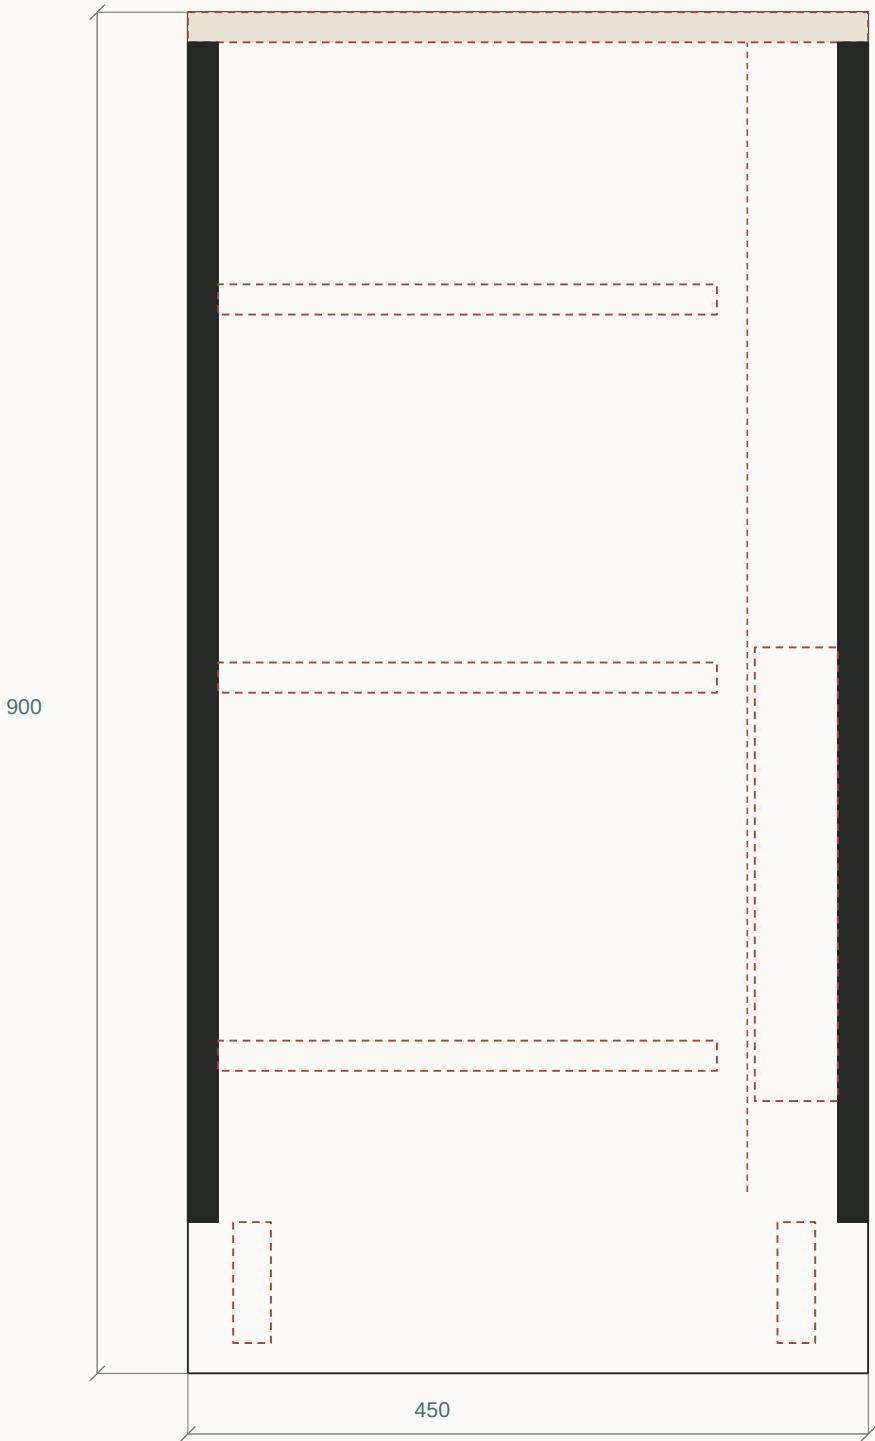

TBC #16 / #26

Internal dimensions are proposed.
Confirm selected grommet, service chase, drawer slides and feet.
Staff access remains a separate open issue.

TOP / FRONT

Simple light-coloured top; light-neutral steel front. Proposed 20 solid-surface top on steel support; material/thickness approval #16.

STORAGE

Removable steel trays/drawers, avoiding timber or heavy joinery. Slide specification, payload and usable depth TBC #16.

POWER / DATA

Proposed rear grommet to segregated service chase; accessible isolation and removable panel on staff side.


LEVELLING

Concealed adjustable feet bear on verified floor. Finish to remain at 900H. Foot travel and point loads require consultant confirmation.

Finish junctions / controlled terminations


AP-22 · four typical coordination details

01 FLOOR / WALL

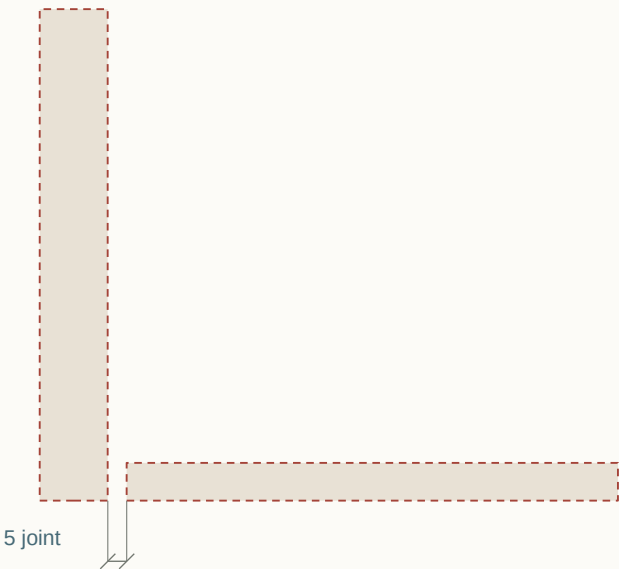


Flexible compatible seal
Build-up TBC

02 WALL / CEILING

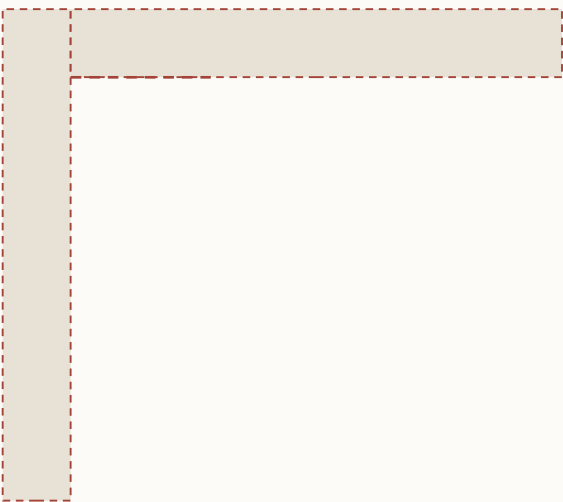


Controlled reveal TBC
Independent ceiling support

03 DISPLAY / WALL

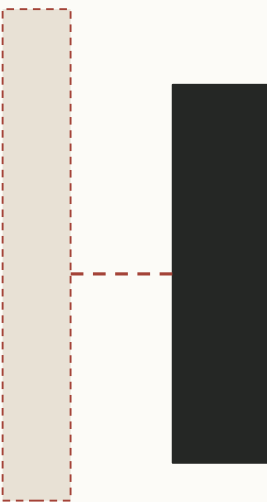

Adjustable wall bracket
Accessible fastener / packer

04 INTERNAL CORNER

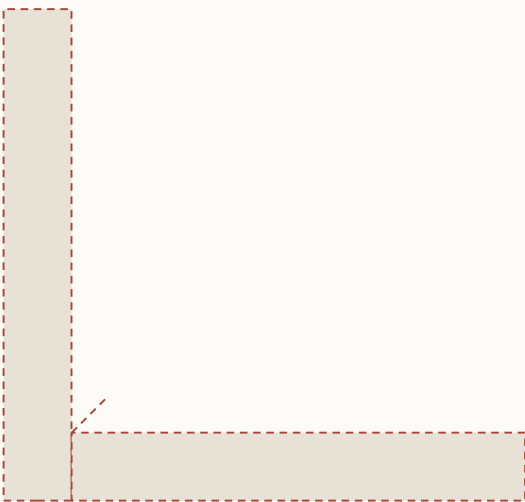

Plan / internal return
Reinforced plaster corner
Movement treatment TBC

TBC #16 / #26 — all build-ups and bracket/reveal geometries shown provisionally. Retain the confirmed 5 floor perimeter allowance. Confirm movement, substrate, finish stops, fixing capacity and visible sample before construction.

Technical specification / coordinated schedule

AP-23 · performance decisions remain with the responsible specialists

CODE	ASSEMBLY	DESIGN BASIS	CONFIRM BEFORE FABRICATION
M01	Main / secondary steel	25×25×1.6 / 20×20×1.6 SHS; matte black PPC	Weld/anchor design, corrosion prep and loading #16
M02	Doors / neutral panels	1.5 mm PPC steel doors; flush, handleless	Hardware, reveals and durability sample #16
M03	Wall / ceiling	Raw light plaster; smooth off-white gypsum ceiling	Substrate, thickness and fire requirements #26/#16
M04	Floor / sealants	1200×600 porcelain; 2 grout; 5 perimeter	Adhesive, slip suitability, sealant compatibility #16/#26
G01	Glazing / hardware	1000×2580×12 toughened pivot leaf; 488 fixed pane	Fixed pane thickness, gaps, hardware capacity #16
M05	Mesh	Approx. 20×40 diamond; black; framed removable edges	Gauge, perimeter channel and screw centres #16
M06	Shelf	3 mm MS tray; 25 downstand; 250 deep	Load, tray fit and LED extrusion selection #16
L01	Lighting / access	3000 K; two tracks; shelf and plinth LEDs	Photometry, wattage, drivers, circuits, ventilation #16
S01	Logo / fixings	External halo-lit at 25 stand-off; internal unlit	Backing, studs, maintenance opening and IP needs #16
C01	Counter / joints	1000×450×900; 300×450 mesh; light top	Proposed 20 top, storage, feet, grommet, reveals #16

Installation / quality and maintenance sequence

AP-24 · hold points before release to fabrication

01 / SURVEY

Confirm finished envelope, FFL, substrate, wall construction and site north. Record measured values separately from design dimensions.

02 / CONSULTANT

Resolve 450 side routes; assess pivot clear opening, fire / MEP coordination, structure and fixing loads. Sign off TBC #16.

03 / SHOP DRAWINGS

Fabricator resolves cut sizes, shared posts, welds, glass gaps, tolerances and adjustment. Release supplier templates only after approval.

04 / SAMPLE + FABRICATE

Approve finishes, edge conditions and light concealment. Workshop weld and coat; protect completed finishes during transport.

05 / SITE ASSEMBLY

Set out → level → anchor to verified structure → route/test services → install trays, panels, glass and logo → adjust and protect.

06 / COMMISSION

Test door sweep, access, lighting and isolation. Demonstrate panel removal; hand over wiring, maintenance instructions and surveyed as-builts.

Open decisions / consultant coordination

AP-25 · retain clouds until documented approval

#4 FINISHED ENVELOPE / Surveyor / owner

Survey 2400 × 3106 after plaster; check diagonals, plumb and ceiling height.

#16 COUNTER / ESCAPE / Fire / access consultant

450 side gaps vs 900 project assumption. Confirm compliant staff/customer route; retain centred design pending decision.

#16 GLASS / HARDWARE / Glazier / engineer

2580 door height leaves 20 vertical allowance. Confirm split, fixed-pane thickness, operating gaps and pivot capacity.

#16 SERVICES / FIXINGS / MEP / structural / fabricator

No anchor capacities, lighting circuits or driver ventilation established. Review proposed AP-13 to AP-22 assemblies.

#23 ORIENTATION / Surveyor

North toward storefront is assumed. No surveyed north is represented in this package.

#26 WALL / DATUM / FINISHES / Surveyor / architect

100 wall is historical assumption; plans show finish lines only. Verify wall/ceiling/floor build-ups, levels and movement joints.



Drawing register / dimensional close-out

AP-26 · presentation consistency audit and next release

SHEET REGISTER

AP-01 Retail interior / coordinated design

AP-02 Drawing basis / document hierarchy

AP-03 Overall plan / setting-out

AP-04 Floor finish / module setting-out

AP-05 Ceiling / lighting coordination

AP-06 Storefront / external elevation

AP-07 Rear focal wall / internal elevation

AP-08 Left display / internal elevation

AP-09 Right display / internal elevation

AP-10 Spatial assembly / cutaway axonometric

AP-11 Material palette / visible finishes

AP-12 Display module / fabrication logic

AP-13 Shelf / frame / concealed LED

AP-14 Mesh / lighting / service access

AP-15 Storefront head / structural interface

AP-16 Glazed entrance / jamb and pivot

AP-17 Flush threshold / floor interface

AP-18 Halo-lit sign / demountable backing

AP-19 Rear wall / display-to-wall connection

AP-20 Counter / plan, elevation and section

AP-21 Counter / services and removable access

AP-22 Finish junctions / controlled terminations

AP-23 Technical specification / coordinated schedule

AP-24 Installation / quality and maintenance sequence

AP-25 Open decisions / consultant coordination

AP-26 Drawing register / dimensional close-out

CHECKED: $450 + 1500 + 450 = 2400$ | $488 + 1000 + 3 \times 4 = 1500$ | $450 + 4 \times 664 = 3106$
 $100 + 500 + 5 \times 400 = 2600$ | $3106 - 250 - 2156 = 700$ | counter $1000 \times 450 \times 900$
Surveys and fabrication decisions remain open. Detailed read-back audit accompanies this presentation.