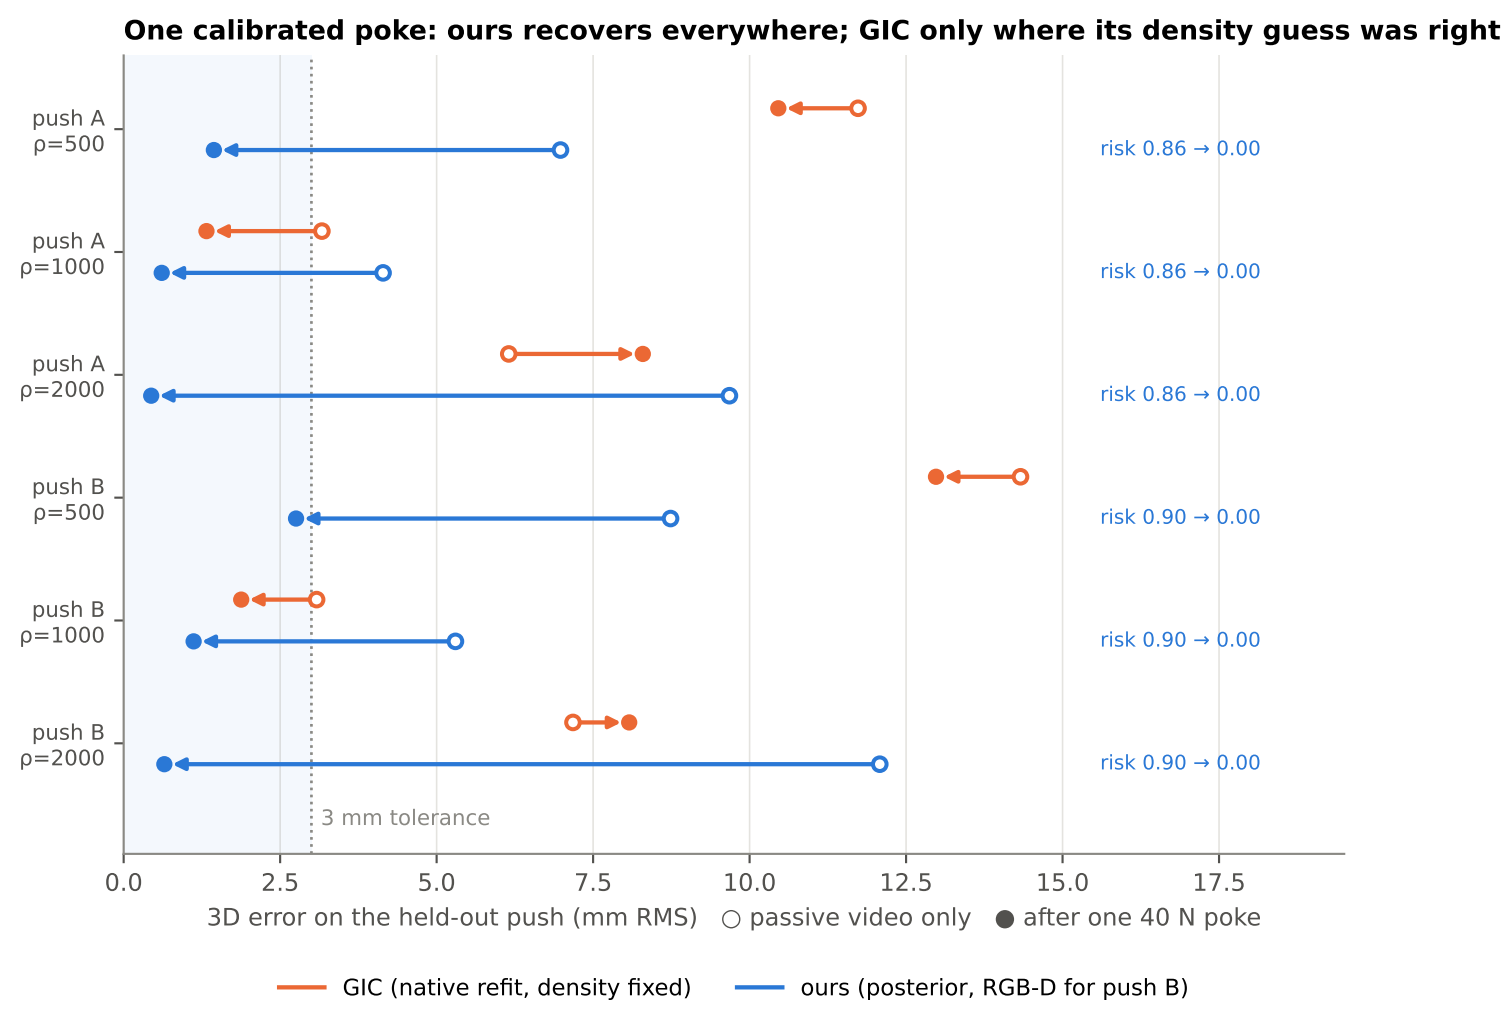
One calibrated poke: ours recovers everywhere; GIC only where its density guess was right
push A ρ=500
push A ρ=1000
push A ρ=2000
push B ρ=500
push B ρ=1000
push B ρ=2000
risk 0.86 → 0.00
risk 0.86 → 0.00
risk 0.86 → 0.00
risk 0.90 → 0.00
risk 0.90 → 0.00
risk 0.90 → 0.00
3 mm tolerance
0.0
2.5
5.0
7.5
10.0
12.5
15.0
17.5
3D error on the held-out push (mm RMS)
○ passive video only
● after one 40 N poke
GIC (native refit, density fixed)
ours (posterior, RGB-D for push B)