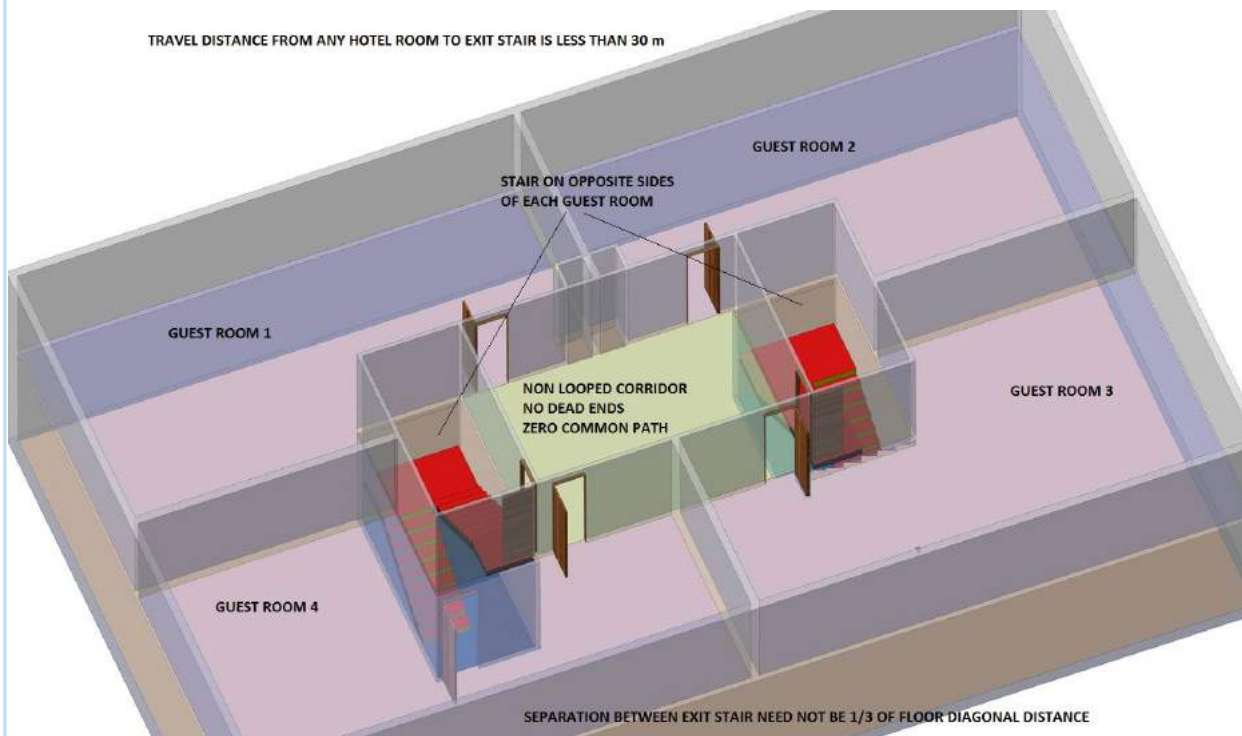


**Table 3.30.: Hotel, Group A, C. (Hotels, Hotel Apartments, Resorts)**

ITEMS	REQUIREMENTS
<b>11. REMOTENESS OF EXITS</b>	<ul style="list-style-type: none"> <li>i. The remoteness of exit stairs required by <b>Section 4.4. Remoteness of Exits</b> does not apply to Hotels, Hotel Apartments, provided all the following conditions are met. <ul style="list-style-type: none"> <li>a. Exit corridor is not looped</li> <li>b. Every guest room doors are arranged such that the common path and dead ends are zero.</li> <li>c. Exit stairs are available on opposite sides of every guest room door.</li> <li>d. Travel distance from guest room door to exit stair is less than 30 m.</li> </ul> </li> </ul>
<b>12. EXITS FROM PODIUM</b>	<ul style="list-style-type: none"> <li>i. Hotel occupancies having open podiums for assembly purposes, shall ensure 2 exits remotely located as per <b>Section 4.4.</b></li> <li>ii. Such required 2 exits shall be any of the following. <ul style="list-style-type: none"> <li>a. Exits leading back into building, to the building exit stairs.</li> <li>b. Enclosed exit stairs to exterior discharge from the podium.</li> <li>c. Open or outside exterior stairs as per <b>Table 3.4., 14.</b>, discharging directly outside to publicway.</li> <li>d. Combinations of above options a, b, and c.</li> </ul> </li> </ul>



**Figure 3.32.: Non applicability of Stair remoteness of 1/3 diagonal of floor area.**