

Table 3.33.: Mall, Group A, (Covered Mall)

| ITEMS                | REQUIREMENTS  |
|----------------------|---|
| <b>6. SEPARATION</b> | <ul style="list-style-type: none"> <li>i. The wall dividing the tenant spaces shall have a 1-hour fire-resistance-rated and such separation shall extend from the floor to the floor deck above, to the roof, or to the ceiling where the ceiling is constructed to limit the transfer of smoke.</li> <li>ii. No separation is required between tenant front and the mall pedestrian way.</li> <li>iii. Corridors and exit passageways shall be separated from equipment rooms, service elevators, janitor closets by 1 hour fire resistance rated construction.</li> </ul> |

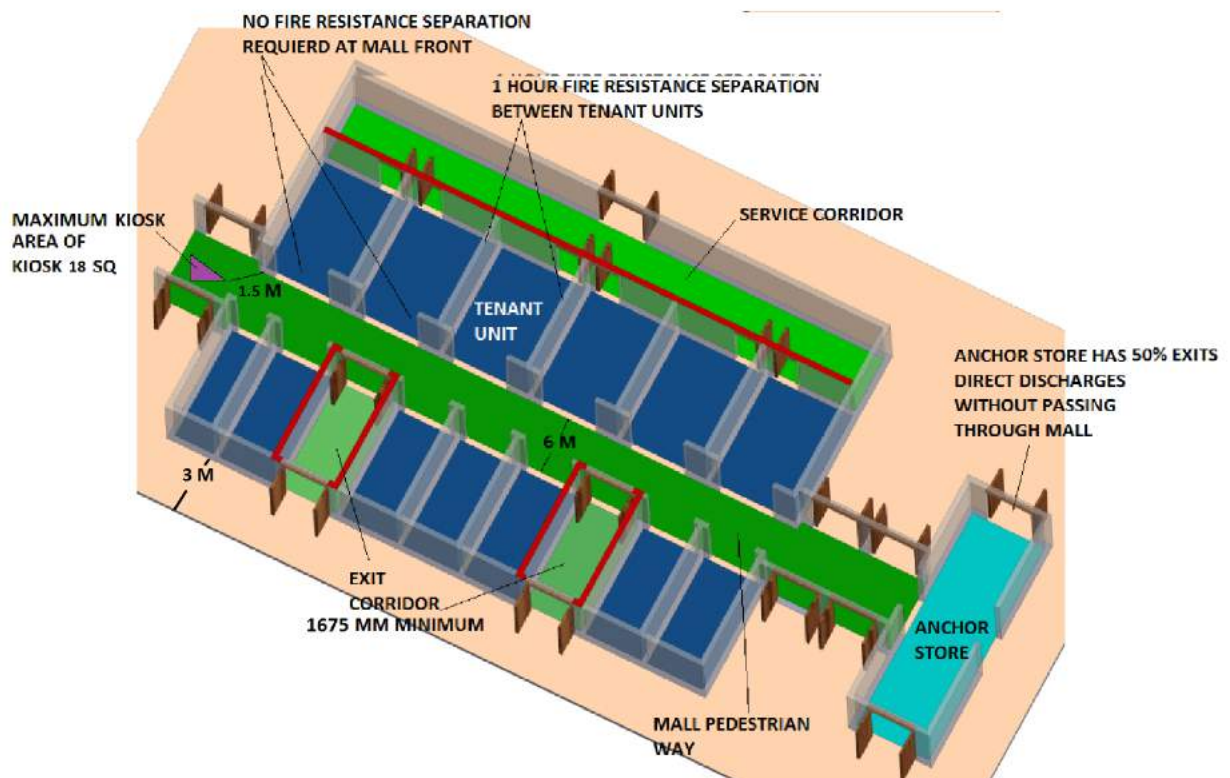


Figure 3.34.: Mall