


Table 10.4.: Stair Pressurization Requirements

ITEMS	REQUIREMENTS
11. STAND-BY FAN	i. Back-up (Stand-by) fans shall not be required for stair pressurization systems.
12. STAND-BY POWER	i. Stairwell pressurization system, Control panel, a fan shall be provided with emergency power.

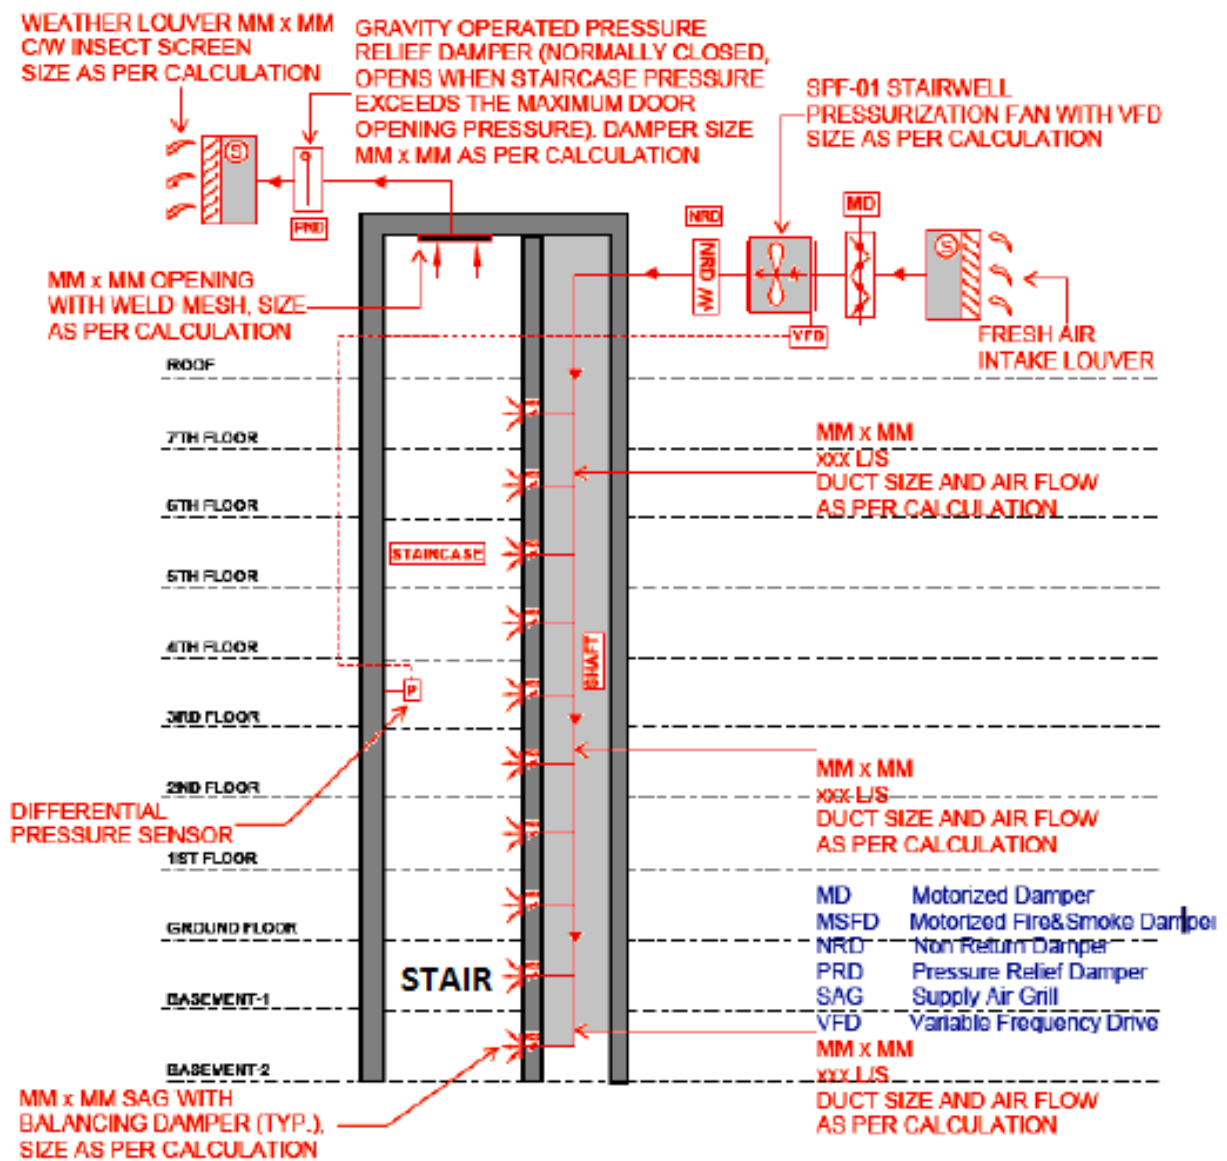

Schematic 10.16: Stair Pressurization System Schematic