



Table 1.9.: Fire Resistance Separation and other requirement of incidental accessory /Occupancies.

| INCIDENTAL ACCESSORY ROOMS AND OCCUPANCIES | REQUIRED SEPARATION WITH AUTOMATIC FIXED FIRE PROTECTION SYSTEM | REQUIRED SEPARATION WITHOUT AUTOMATIC FIXED FIRE PROTECTION SYSTEM | OTHER CONSTRUCTION AND PROTECTION REQUIREMENTS (See Chapter 9 for Fire Protection requirements Chapter 10 for smoke control requirements) |
|---|---|--|--|
| 5. ASSEMBLY GROUP A (THEATER, CINEMA, CONCERT HALL, NIGHTCLUBS ETC.) | 1 Hour | 2 Hour | <ul style="list-style-type: none"> i. Separation and Compartmentation shall be complete with walls, floor, doors and opening protection. ii. Where entrance access to Assembly Group A is from other occupancies, it shall be protected with fire doors. iii. Where a lobby between Assembly Group A and other occupancies is required, such lobby shall be 1 hour fire resistance rated with self closing door, 1 hour fire rated. |

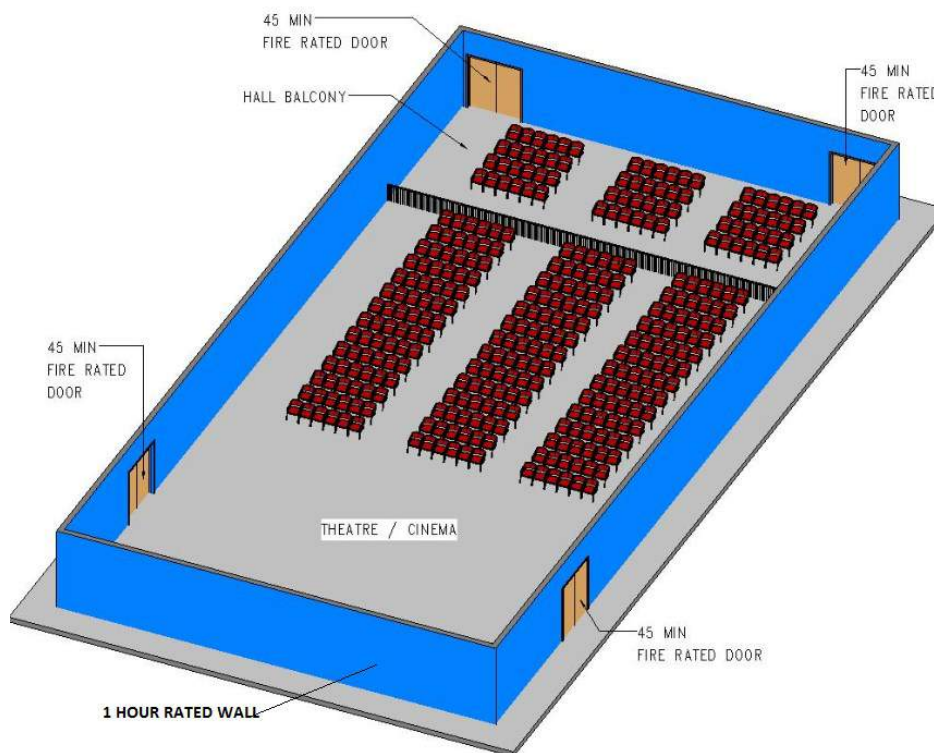


Figure 1.5: Separation of Cinema, Nightclub, Concert Hall