


Table 10.6.: Corridor and Open Circulation Spaces Smoke Purging System

| ITEMS             | REQUIREMENTS  |
|-------------------|---|
| 8. STAND-BY FAN   | i. Back-up (Stand-by) fans shall not be required for corridor and open circulation area smoke management systems.   |
| 9. STAND-BY POWER | i. Corridor and open circulation area smoke management system, Control panel, automatic Smoke curtains, if any, Fans and related equipment shall be provided with an emergency power. |

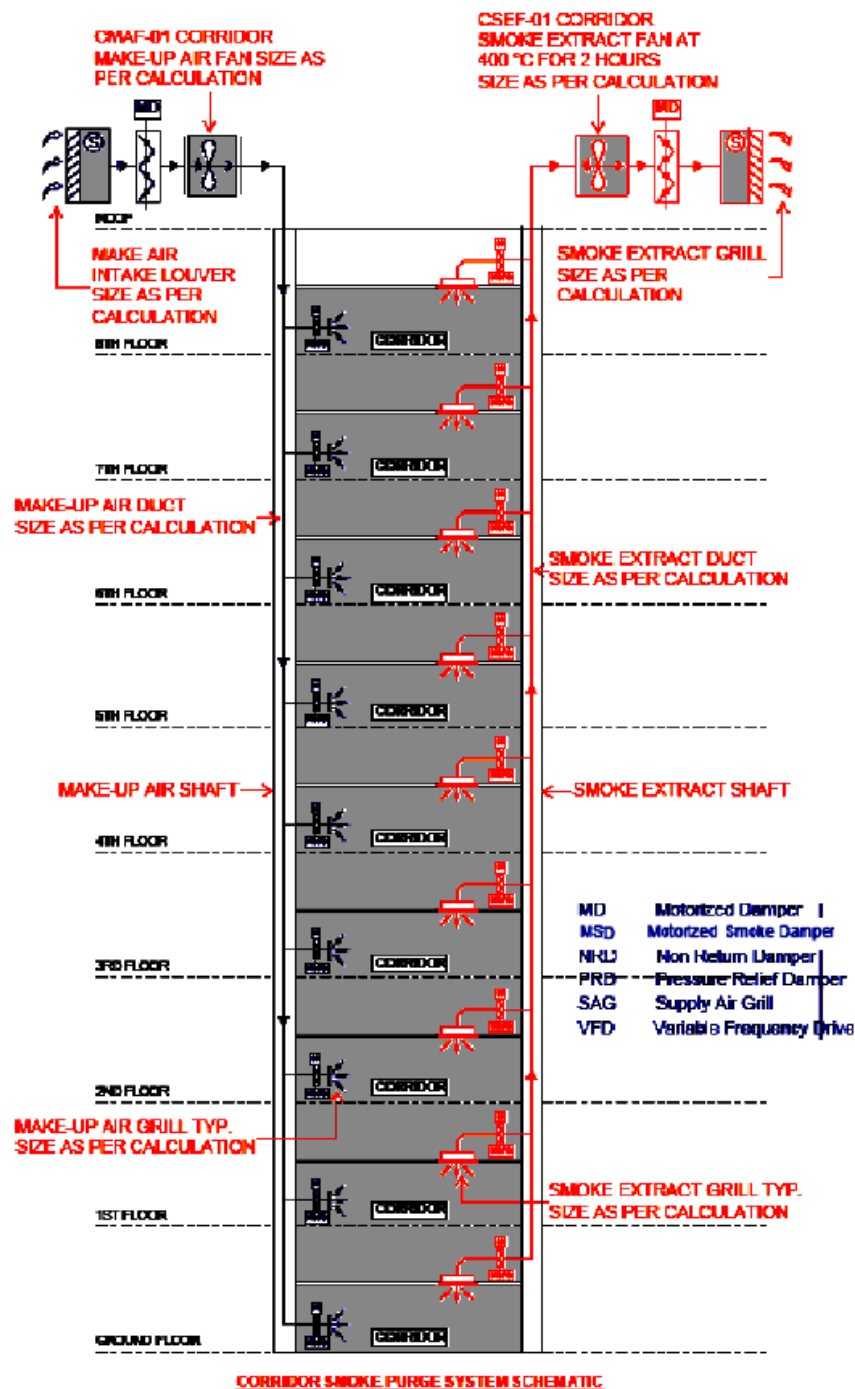

Schematic 10.25.a.: Corridor and Open circulation area Mechanical Smoke Purge System Schematic