



Table 1.9: Fire Resistance Separation and other requirement of incidental accessory /Occupancies.

INCIDENTAL ACCESSORY ROOMS AND OCCUPANCIES	REQUIRED SEPARATION WITH AUTOMATIC FIXED FIRE PROTECTION SYSTEM	REQUIRED SEPARATION WITHOUT AUTOMATIC FIXED FIRE PROTECTION SYSTEM	OTHER CONSTRUCTION AND PROTECTION REQUIREMENTS (See Chapter 9 for Fire Protection requirements Chapter 10 for smoke control requirements)
31. MULTI-TENANT WAREHOUSE AND MULTITENANT FACTORIES	1 Hour	2 Hour	<ul style="list-style-type: none"> i. Separation and Compartmentation shall be complete with walls, floor, roof and opening protection. ii. Separation between warehouse units shall extend above the roof to 760 mm. iii. Door shall be 60 minutes fire rated and self closing. iv. Rolling shutters shall be 60 minutes rated and shall be closed automatically upon receiving fire signal. v. Where sandwich panels are used for wall systems, it shall comply with Section 4.9. of this chapter. vi. Steel structure fire rating shall not be required.

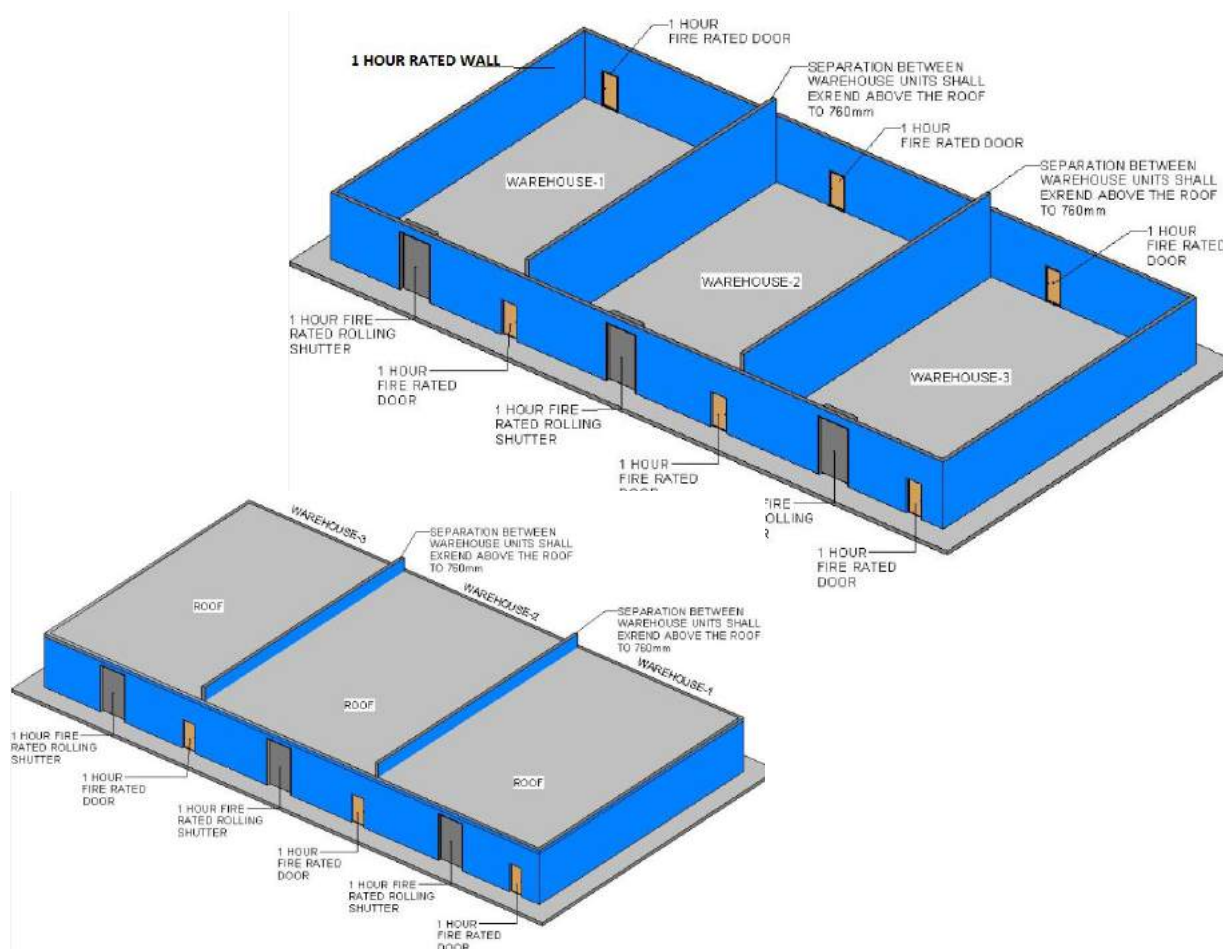


Figure 1.6: Separation of multitenant warehouses with sprinklers