

A2. Drawing Submission Requirements

A2.7. Infrastructure submissions

FIRE PUMP SET			
COMBINED SPRINKLER & FIRE FIGHTING SYSTEM			
DUTY	DRIVER	FLOW	HEAD
		GPM	BAR
MAIN PUMP (HORIZONTAL TYPE)	ELECTRIC	1000 gpm	30 bars
STANDBY PUMP (HORIZONTAL TYPE)	DIESEL ENGINE	1000 gpm	30 bars
JOCKEY PUMP	ELECTRIC	50 gpm	30 bars

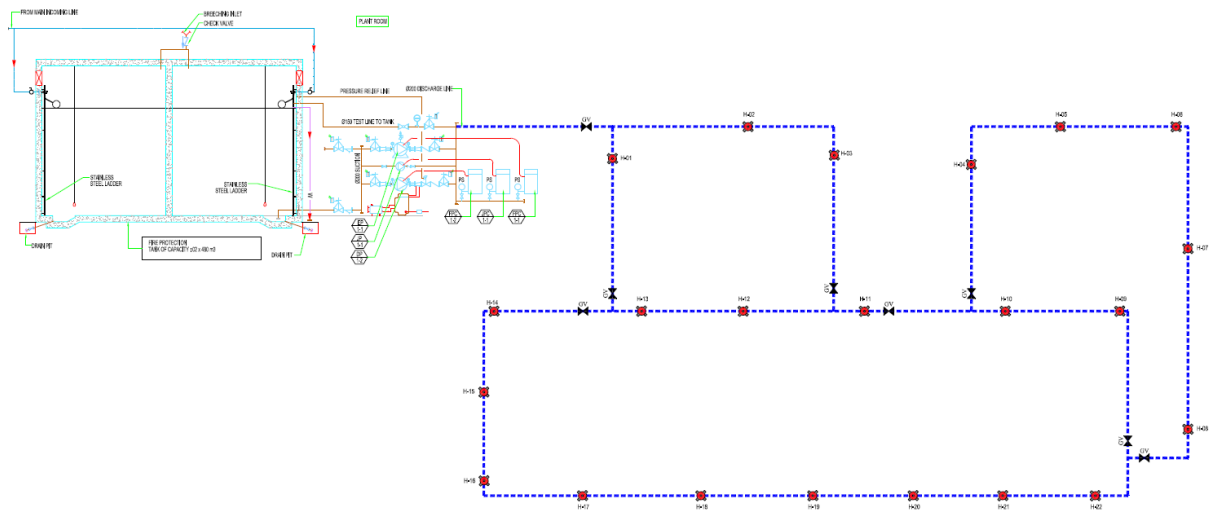


Figure A2.5.: INFRASTRUCTURE SUBMISSIONS