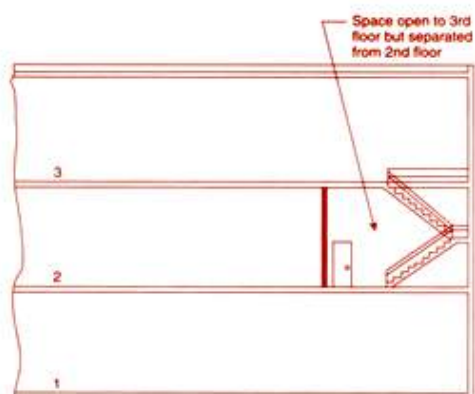


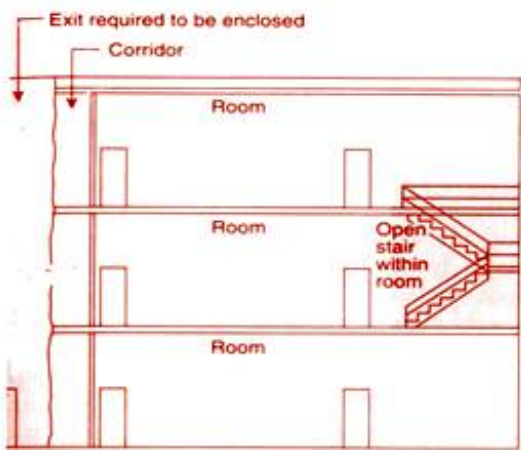


Table 1.9: Fire Resistance Separation and other requirement of incidental accessory /Occupancies.



INCIDENTAL ACCESSORY ROOMS AND OCCUPANCIES	REQUIRED SEPARATION WITH AUTOMATIC FIXED FIRE PROTECTION SYSTEM	REQUIRED SEPARATION WITHOUT AUTOMATIC FIXED FIRE PROTECTION SYSTEM	OTHER CONSTRUCTION AND PROTECTION REQUIREMENTS (See Chapter 9 for Fire Protection requirements Chapter 10 for smoke control requirements)
40. CONVENIENCE OPENINGS	0 Hour	1 Hour	<ul style="list-style-type: none"> i. Separation is between convenience opening and protected corridors and fire compartments. ii. Convenience openings shall pierce only one floor and not connect more than 2 adjacent floors. iii. Such openings shall be separated from unprotected vertical openings serving other floors. iv. Such openings shall be separated from corridors, other fire compartments or smoke compartments on the same floor. v. Such openings shall not serve as required means of egress.



SEPARATED CONVENIENCE OPENING



NON SEPARATED CONVENIENCE OPENING

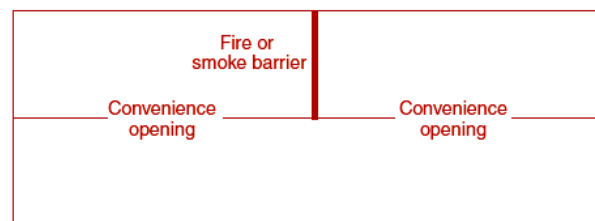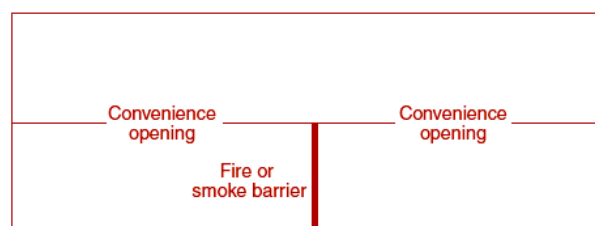

CONVENIENCE OPENING ARRANGEMENT

Figure 1.10.: Convenience Opening