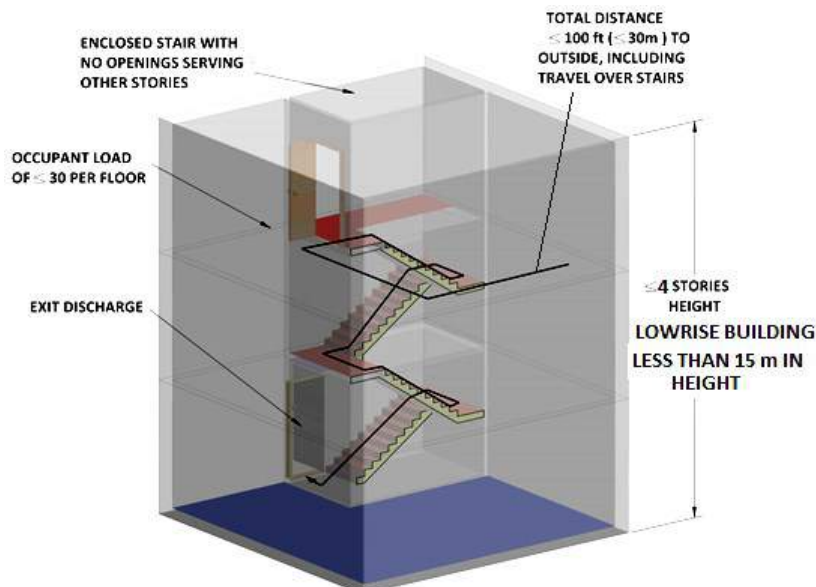


## 5.2. Business, Group A, B, C.

**5.2.1.** The Business occupancies shall comply with **Table 3.19.** along with all other sections of this chapter. Where conflicts arise between this section and other sections of the Chapter or code, the requirements of this section shall prevail.

**Table 3.19.: Business, Group A, B, C.**

ITEMS	REQUIREMENTS
<b>1. SINGLE EXIT DOOR PERMISSION</b>	<ul style="list-style-type: none"> <li>i. A single exit door shall be permitted for a room or area with a total occupant load of less than 100 persons, provided the exit discharges directly to outside at level of exit discharge and such travel to outside is not more than 30 m.</li> <li>ii. If stair is involved, it shall be either enclosed interior stair or outside stair with total travel distance to outside, including travel distance within the stair, shall not exceed 30 m.</li> <li>iii. A single outside stair shall be permitted to serve multiple stories, provided such stairs are not more than 4570 mm in height from the fire access level.</li> <li>iv. Rooms exceeding 280 m<sup>2</sup> in area requires 2 exit doors from that room, remotely located as per <b>Section 4.4.</b></li> </ul>
<b>2. SINGLE EXIT STAIR PERMISSION</b>	<ul style="list-style-type: none"> <li>i. A single exit Stair, separate to each storey shall be permitted for Lowrise building with a total occupant load of less than 30 persons per floor, provided the exit stair discharges directly to outside at level of exit discharge and such travel to outside is not more than 30 m.</li> <li>ii. Such a stair, if interior, shall be fully enclosed and shall not serve any other stories.</li> <li>iii. Such a stair, if exterior and it is an outside stair, shall be permitted to serve all stories.</li> <li>iv. A single means of egress shall be permitted from a mezzanine within a business occupancy, provided that the common path of travel does not exceed (S 30 m, NS 23 m)</li> <li>v. A single open Stair shall be permitted for a 2 storey, Single tenant, fully sprinklered building, provided that full travel distance to outside including the travel distance within stair does not exceed 30 m.</li> </ul>



**Figure 3.23.: Single Exit Permission in Business Occupancy**