


Table 10.1.: Components of Smoke Control and HVAC Systems

ITEMS	REQUIREMENTS
6. FIRE CURTAINS	<ul style="list-style-type: none"> i. Listed and approved fire curtains shall be permitted to achieve the desired compartmentation. ii. Fire curtains, where utilized shall comply with the fire resistance rating required to establish the particular fire compartment in accordance with the construction fire rating required by Chapter 1. Construction. iii. Fire curtains shall also be permitted to be used as guiding channels for the smoke compartment to enhance the performance of smoke control strategies. iv. Fire curtains shall be automatic, tested and approved in accordance with the test standards mentioned in Section 6.



FIRE CURTAIN FOR ILLUSTRATION

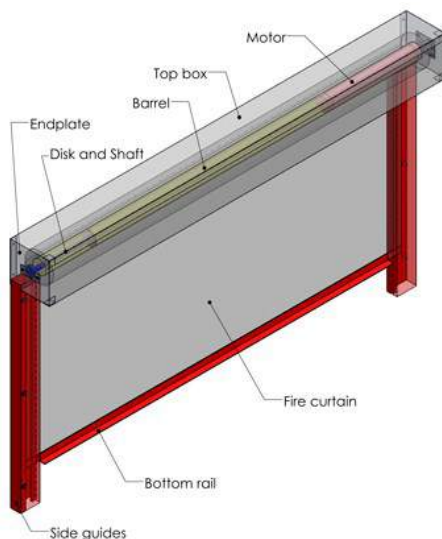

FIRE CURTAIN IN OPERATION FOR ILLUSTRATION