

4.5. Commonpath, Dead end and Travel Distance

- 4.5.1. Exit access shall be arranged such that there are no dead ends or dead ends are within allowable length in corridors.
- 4.5.2. The travel distance to an exit shall be measured on the floor or other walking surface shall be along the centerline of the natural path of travel, starting from the most remote point subject to occupancy, terminating at the center of the doorway or other exits and keeping a distance of 305 mm clearance from corner, curves and obstructions.
- 4.5.3. Where measurement includes stairs, the measurement shall be taken in the plane of the tread nosing.
- 4.5.4. Limitations of Commonpath, Dead ends and Travel Distance in buildings shall be as per [Table 3.16](#). Where “S” is building protected by sprinkler system, “NS” is building not protected with sprinkler system, “NR” is No Requirements and “NA” is Not Applicable.

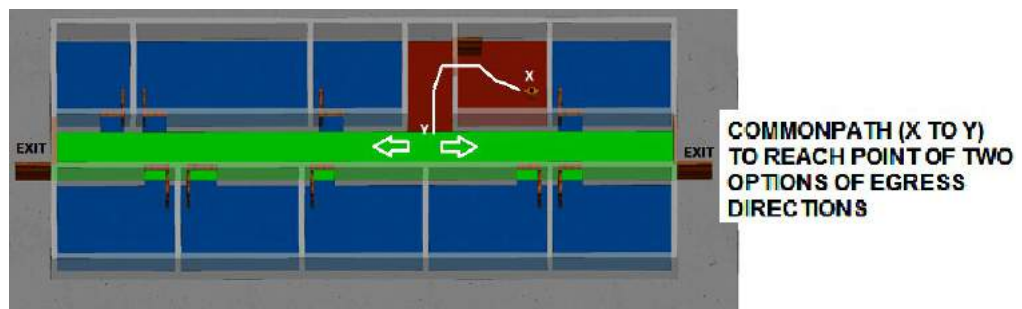


Figure 3.21.a.: Commonpath

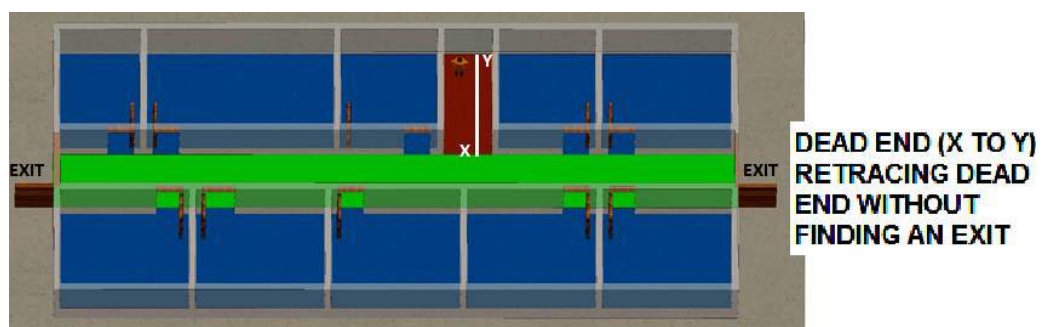


Figure 3.21.b.: Dead End

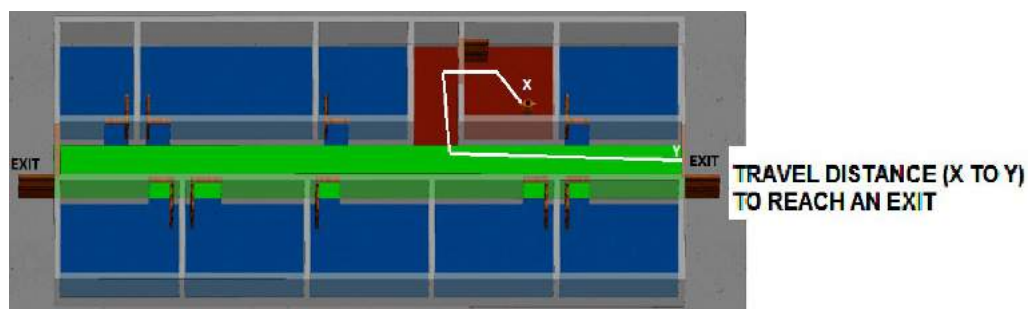


Figure 3.21.c.: Travel Distance