

Table 3.12.: Exit Discharge

ITEMS	REQUIREMENTS
6. DISCHARGE TO ROOF	i. Discharge to roof is allowed only if the building is sprinklered and a continuous and safe means of egress from the roof is available. Additionally, the roof/ceiling assembly construction shall have a fire resistance rating not less than that required for the exit enclosure.
7. SEPARATION AT LEVEL OF DISCHARGE	i. Stairs that continue to levels below the level of exit discharge, shall be interrupted at the level of exit discharge by partitions, walls or fences, such that occupants are guided outside the exit discharge and do not continue using stairs and miss the level of exit discharge.
8. MARKING	i. The exit discharge shall be arranged and marked to make clear the level of exit discharge, direction of egress to a public way. Stairs markings shall be arranged so as to make clear the level and direction of egress to a public way.

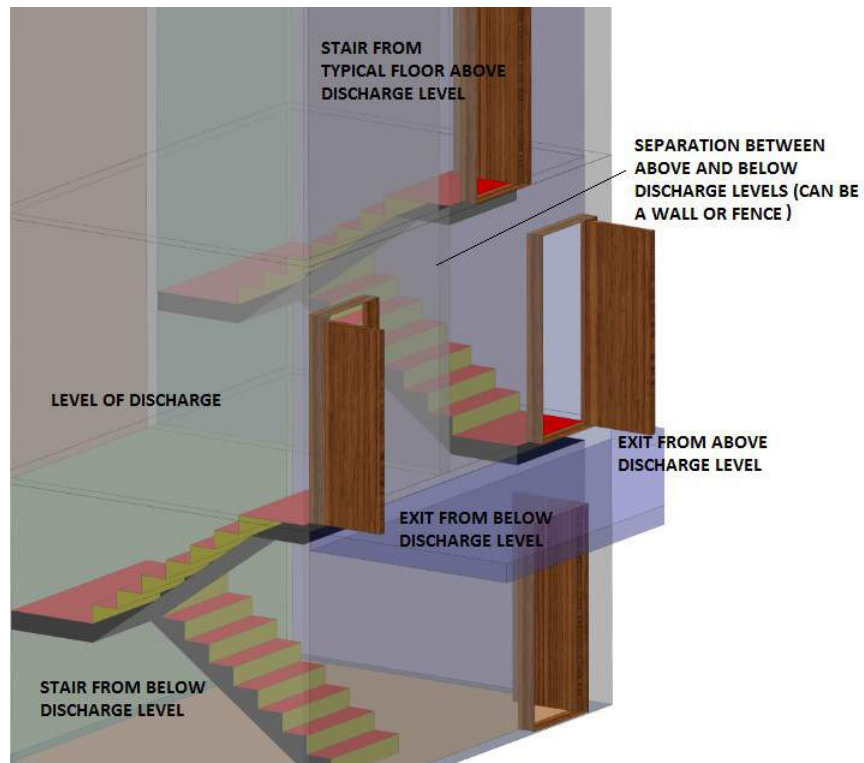


Figure 3.17.: Exit Separation between discharge from basement and discharge from floors above

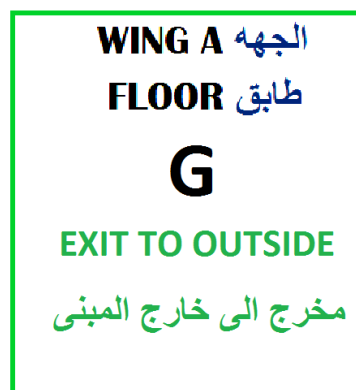


Figure 3.18.: Exit Discharge Sign inside Stair enclosure at Exit Discharge Level