

Table 13.3.: Storage and Usage of Liquids in Warehouses and Industrial Occupancies

ITEM	REQUIREMENTS
3. STORAGE ARRANGEMENT	<ul style="list-style-type: none"> i. Palletized and solid pile storage arrangement for indoor liquid storage shall be as per Figure 13.9. ii. Rack storage arrangement for indoor liquid storage shall be as per Figure 13.8.a. iii. Rack depths and aisle arrangements for liquids in warehouses shall comply with Figure 13.8.b. iv. All warehouses storing flammable and combustible liquids shall be provided with Automatic Sprinkler System in accordance with Chapter 9.

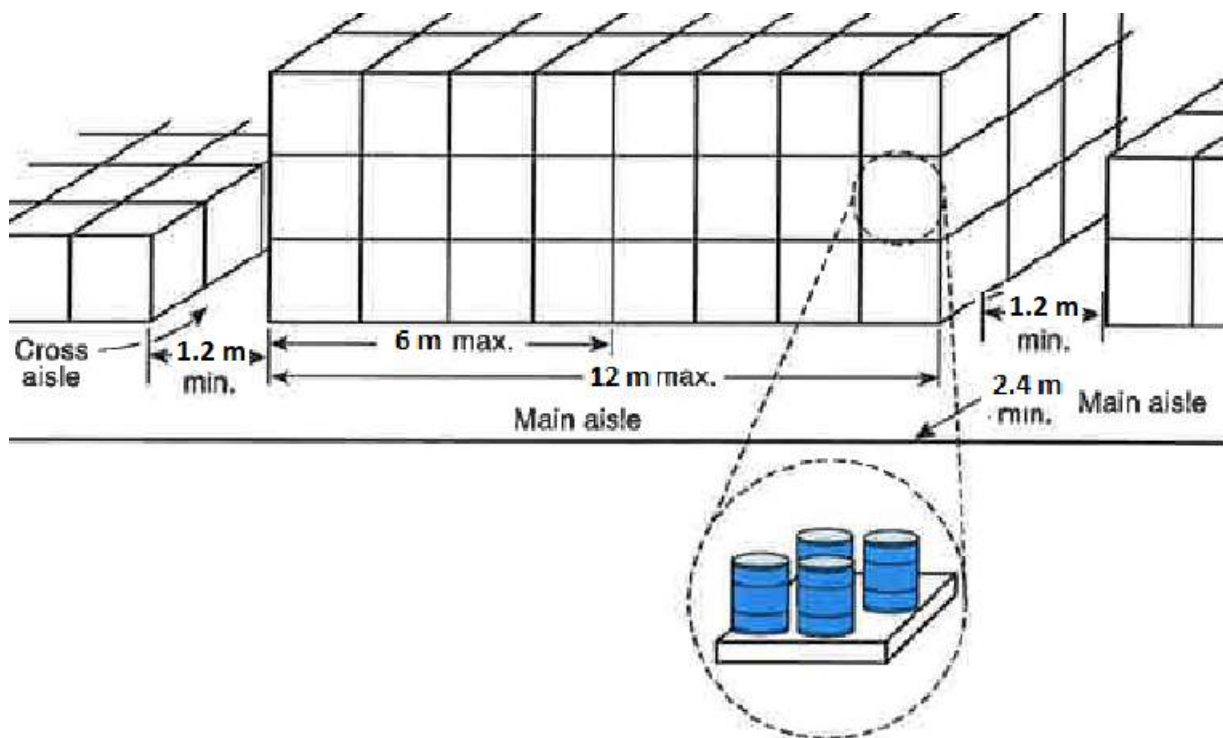


Figure 13.8.a.: Aisles, stacks and Rack arrangement for Containers

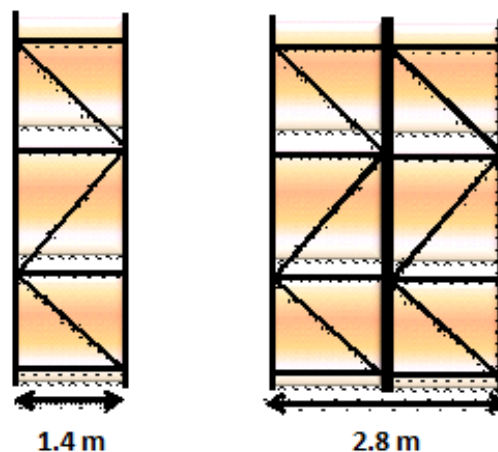


Figure 13.8.b.: Permitted Rack Depth