


Table 3.30.: Hotel, Group A, C. (Hotels, Hotel Apartments, Resorts)

ITEMS	REQUIREMENTS
7. DOORS	<ul style="list-style-type: none"> i. Balcony and terrace access shall be restricted with door having child lock or latch. ii. Window opening shall be restricted to 100 mm opening with windows safety latch. (See Chapter 1, section 2.17. Balcony, Terrace and Windows) iii. Doors in resident or guest sleeping rooms or internal rooms shall not be less than 810 mm in width. iv. The main exit door for the unit shall not be less than 915 mm in clear width. v. Bathroom doors shall not be less than 710 mm, unless they are not serving persons with severe mobility impairments, where the required width shall not be less than 810 mm. vi. Minimum door width of a balcony, not used for assembly, shall not be less than 810 mm.
8. EXIT DISCHARGE	<ul style="list-style-type: none"> i. The distance of travel from the termination of the exit enclosure to an exterior door leading to a public way through enclosed corridor shall not exceed 30 m.
9. HAZARDOUS AREA SEPARATION	<ul style="list-style-type: none"> i. Boiler and fuel fired Heater rooms shall be separated by fire barriers having 1 hour fire resistance rating and sprinklers. ii. Employee locker rooms shall be separated by fire barriers having 1 hour fire resistance rated construction. iii. Gift shops shall be separated by fire barriers having 1 hour fire resistance rated construction and sprinklers. iv. Bulk and central Laundry shall be separated by fire barriers having 1 hour fire resistance rating and sprinklers.. v. Plant maintenance, paint shops shall be separated by fire barriers having 1 hour fire resistance rating and sprinklers. vi. Soiled linen rooms shall have 1-hour fire resistance rating and shall be sprinklered. vii. Garbage rooms shall be separated by fire barriers having 1 hour fire resistance rating and sprinklers. Garbage chutes shall have 2 hour fire resistance rating. viii. Storage rooms shall be separated by fire barriers having 1 hour fire resistance rating and sprinklers. ix. LPG tanks shall be provided with deluge water spray system.
10. FURNISHINGS	<ul style="list-style-type: none"> i. Draperies, curtains, and other similar loosely hanging furnishings and decorations shall meet the flame propagation performance criteria and shall be listed and approved by Civil Defence. See Section 7 for Material Approval. ii. Upholstered Furniture, Mattresses , Carpets shall be listed and approved by Civil Defence. See Section 7 for Material Approval.

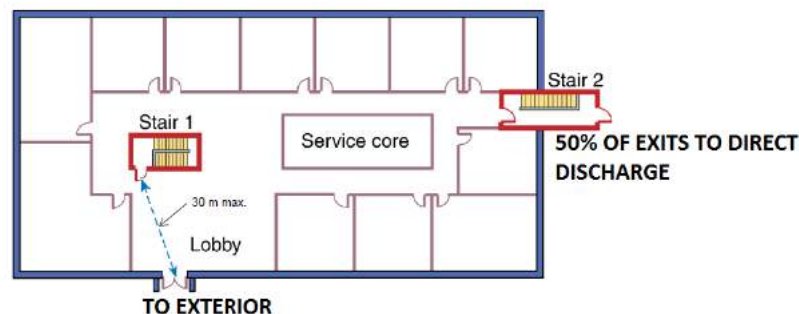

TERMINATION OF 50% OF THE ALLOWED INTERIOR EXITS SHALL NOT BE MORE THAN 30 M FROM AN EXTERIOR EXIT DOOR

Figure 3.32.: Termination of Interior Exit Stairs in Hotels