

Table 13.9.: Requirements for Fuel Dispensing Facilities

OCCUPANCY	REQUIREMENTS
4. ELECTRICAL CLASSIFIED AREA	i. Classified area adjacent to Fuel dispensing shall be in accordance with Figure 13.18.
5. CONSTRUCTION	i. Construction shall meet the requirements of Chapter 1. Table 1.9.33. ii. Where fuel dispensing is indoors, the fuel dispensing area shall not be located more than 15 m from the vehicle exits and entrances from the exterior wall, outside of the building.

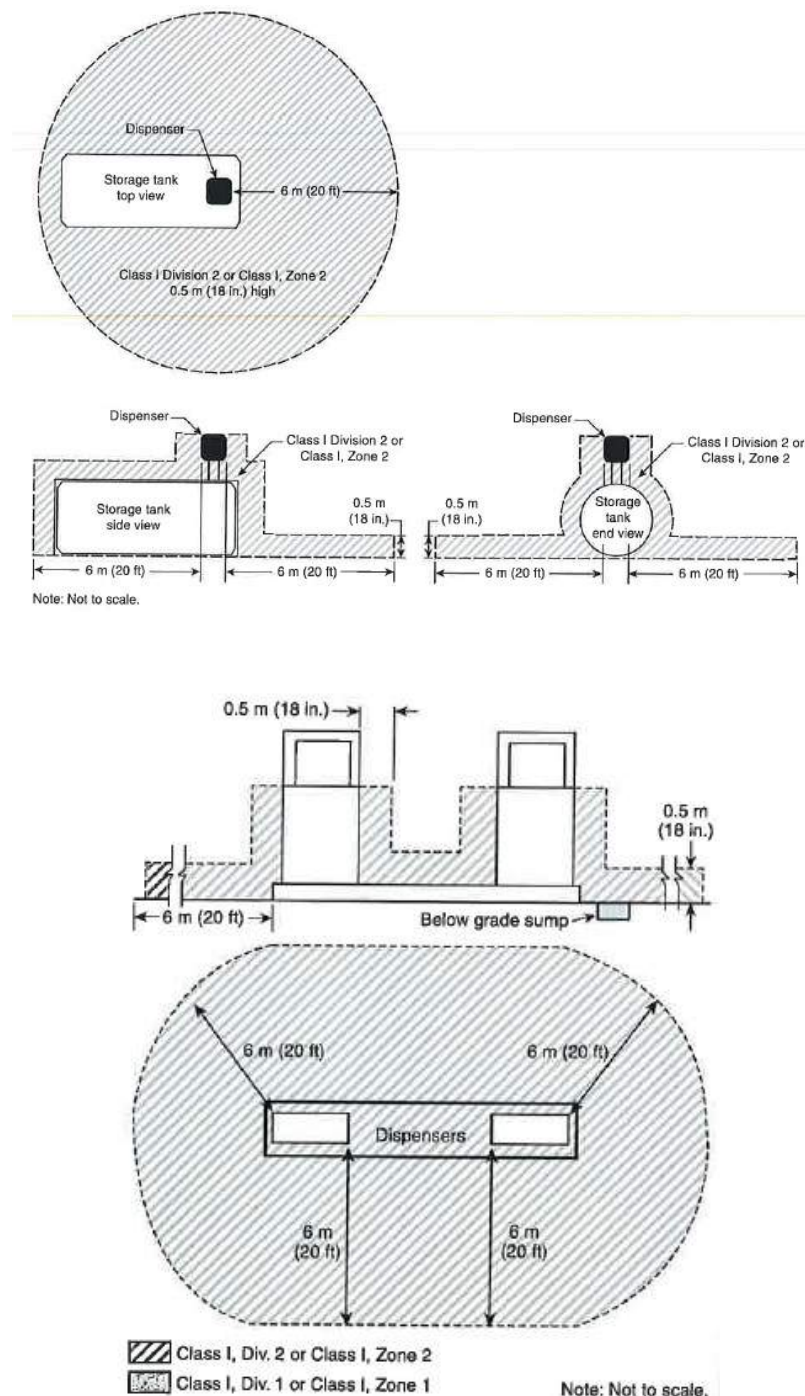


Figure 13.18.: Electrical Classified Area adjacent to Fuel Dispensers