



Table 1.9: Fire Resistance Separation and other requirement of incidental accessory /Occupancies.

INCIDENTAL ACCESSORY ROOMS AND OCCUPANCIES	REQUIRED SEPARATION WITH AUTOMATIC FIXED FIRE PROTECTION SYSTEM	REQUIRED SEPARATION WITHOUT AUTOMATIC FIXED FIRE PROTECTION SYSTEM	OTHER CONSTRUCTION AND PROTECTION REQUIREMENTS (See Chapter 9 for Fire Protection requirements Chapter 10 for smoke control requirements)
39. COMMUNICATING SPACE	0 Hour (Smoke Barrier is required)	1 Hour	<ul style="list-style-type: none"> i. Communicating space shall not connect more than 3 floors. ii. The lowest or next to lowest floor within communicating space shall be a discharge street floor. iii. Egress capacity of communicating space shall be sufficient for all occupants within communicating space/levels to egress simultaneously. iv. Each occupant within communicating space/level shall have access to at least one exit within communicating space from each level. v. Occupants outside communicating space shall have at least one exit independent of communicating space. vi. Shall have ordinary hazard content (Group B,C) and sprinklered.

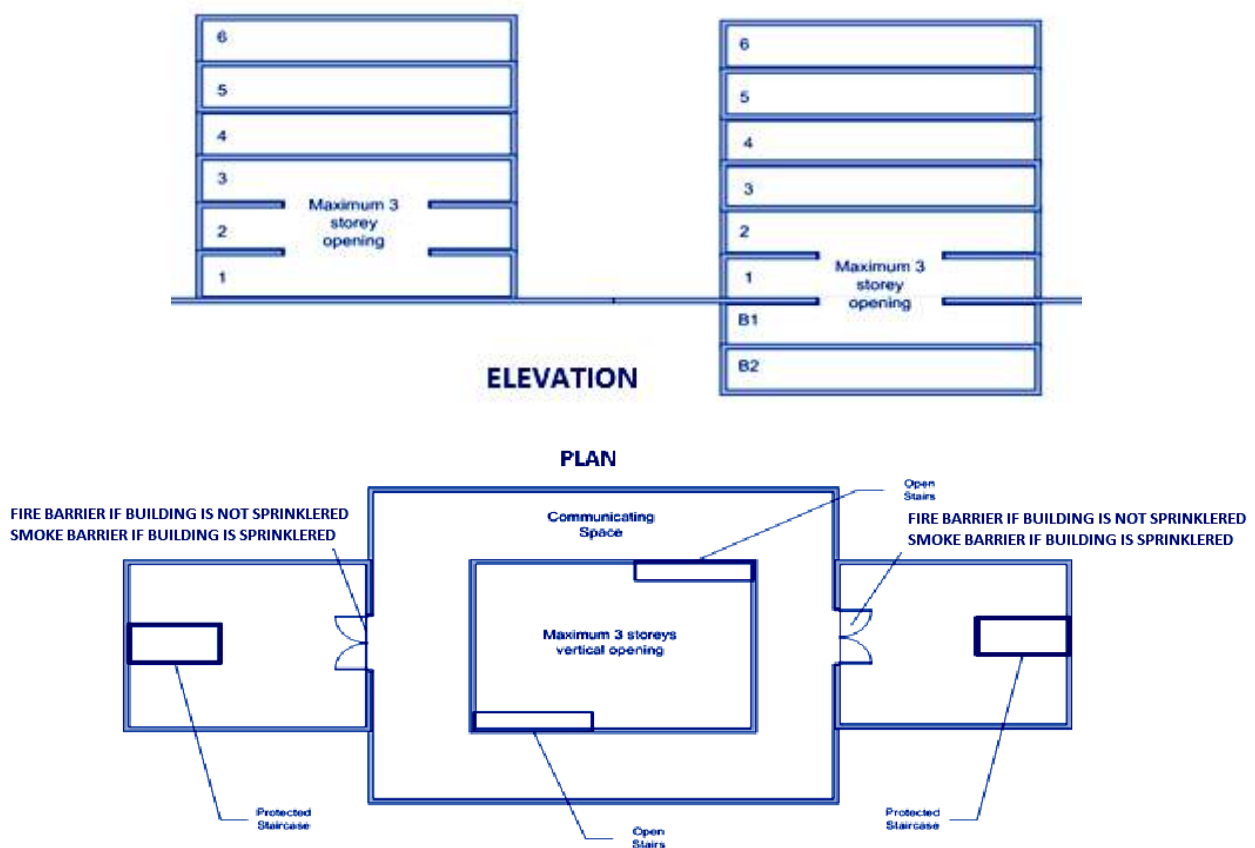


Figure 1.9.: Communicating Space