

Table 3.4: Stair

ITEMS	REQUIREMENTS
15. SCISSOR OR INTERLOCKED STAIR	<ul style="list-style-type: none"> i. Interlocking or scissor stairs shall be considered as a single exit. ii. Scissor Stairs shall be enclosed by a 2 hour fire resistance rated construction, with block wall for non high rise buildings and with RCC in Highrise buildings. iii. Both sections of a Scissor Stairs are not required to be fire separated from each other as the scissor stair is considered as a single exit. iv. Penetrations or communicating openings are allowed between two sections of Scissor Stairs. v. Doors shall be 90 minutes fire protection rated in Scissor Stairs.

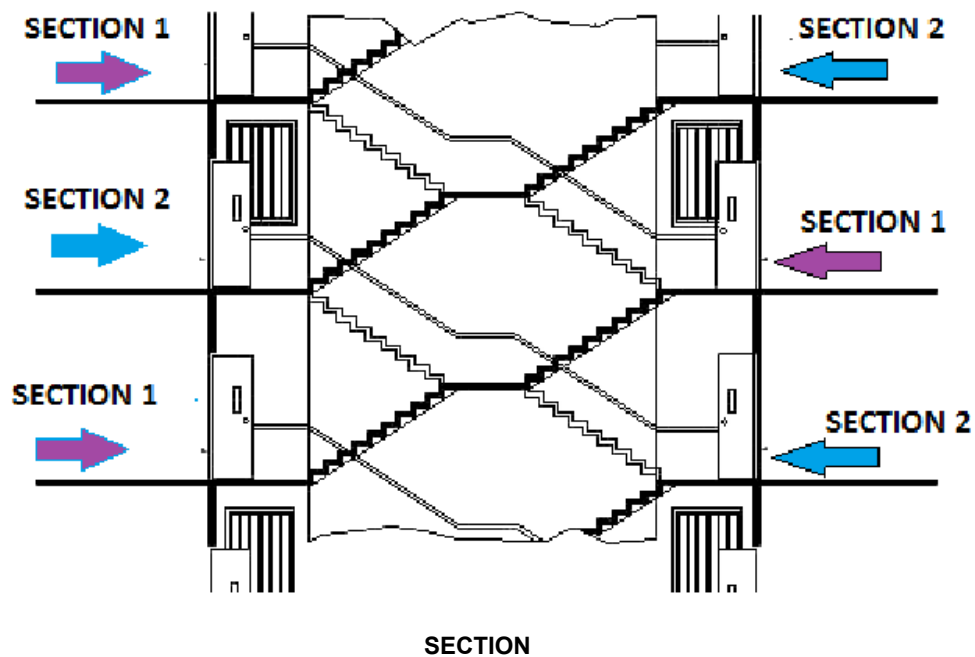
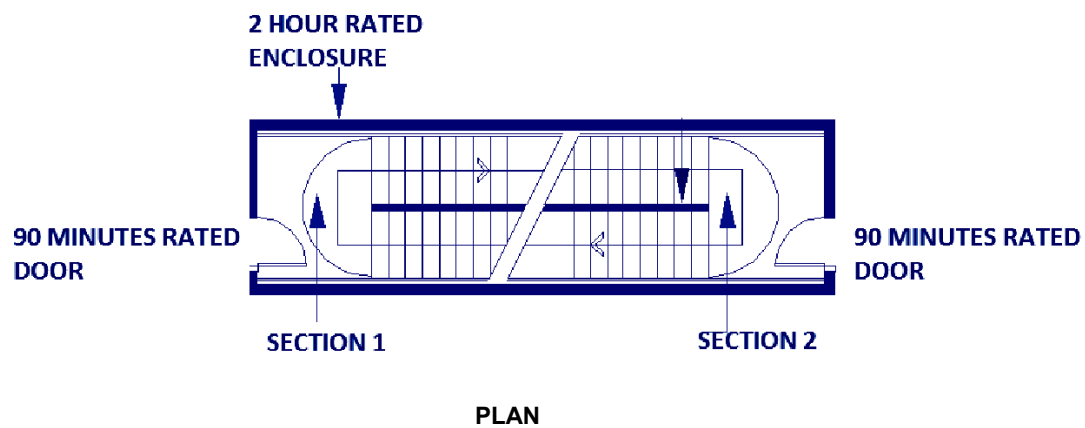


Figure 3.12.: Scissor or Interlocked Stair