

Figure 9.35: Typical Fixed Foam Discharge and Water spray cooling System outlet System for Hydrocarbon tanks

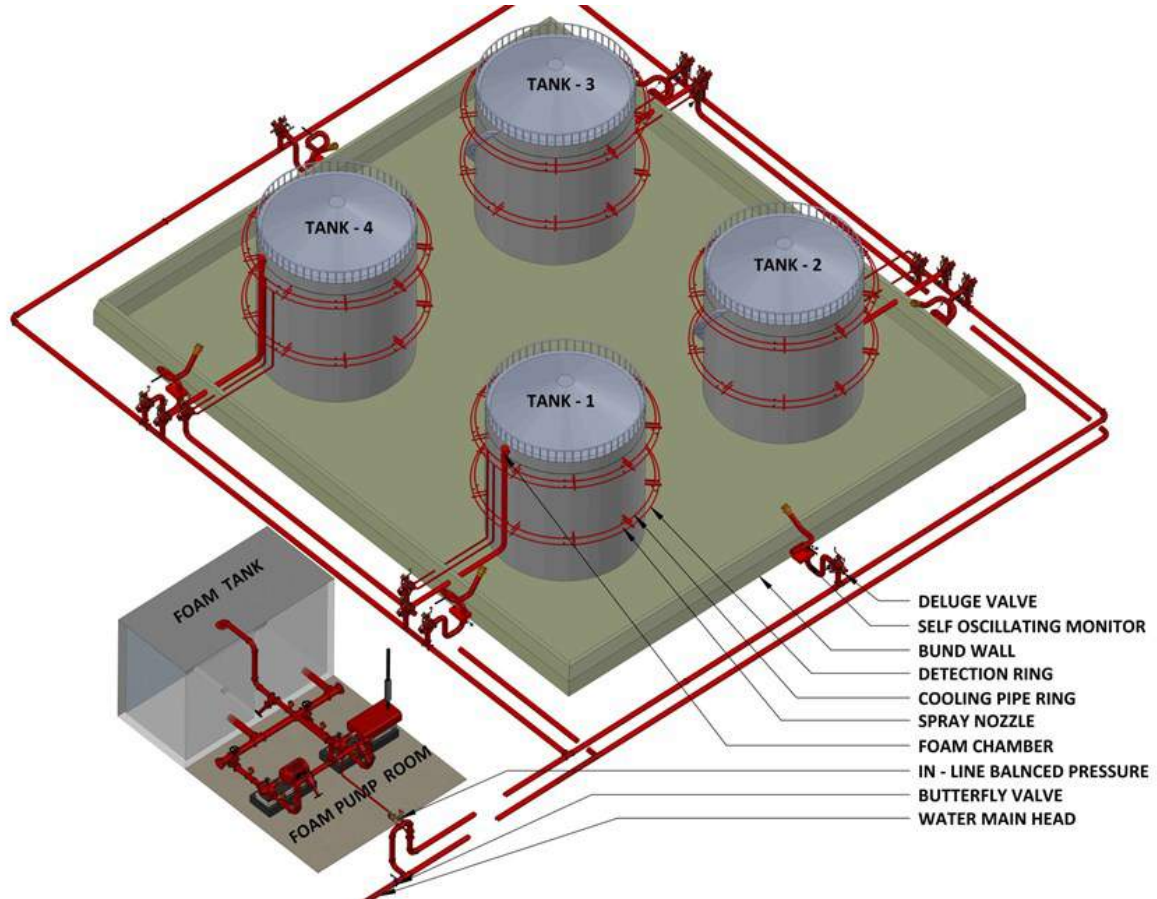


Figure 9.36: Typical Fixed Foam Monitor System for Diked Area