


Table 5.1: Specifications of Exit Signs and Directional Markings

ITEMS	REQUIREMENTS
5. "NO EXIT" SIGN	i. The NO EXIT sign shall have the word NO in letters 51 mm (2") high, with a stroke width of 9.5 mm (3/8"), and the word EXIT in letters 25 mm (1") high, with the word EXIT below the word NO.
6. EVACUATION ELEVATOR SIGNS	<p>i. Elevator signage is to indicate people if they can use the evacuation elevators during fire emergencies.</p> <p>ii. These elevator signs are to be used in place of regular "DO NOT USE ELEVATOR DURING FIRE" signs, if and only where the elevator is designed and accepted as a means of egress component to be an evacuation elevator as per Chapter 3, Section 3.9. and has been incorporated in building fire strategy.</p> <p>iii. These signs are for indicating usage of elevators during emergencies by both Civil Defence personnel and trained facility management.</p> <p>iv. These evacuation elevators shall be provided with signs reading "In the event of Fire, this elevator will be used by Civil Defence for evacuation of people." PROTECTED ELEVATOR USABLE IN EMERGENCIES"</p> <p>v. The minimum height of the letters in evacuation elevator signs shall not be less than 16 mm (5/8"), posted in every evacuation elevator lobby.</p>
7. FLOOR PROXIMITY SIGNS	<p>i. Floor proximity Exit Sign sizes and dimensions shall comply with Table 5.1.1.</p> <p>ii. Floor proximity Directional Exit Sign sizes and dimensions shall comply with Table 5.1.2.</p>



NO EXIT SIGN
FOR ILLUSTRATION

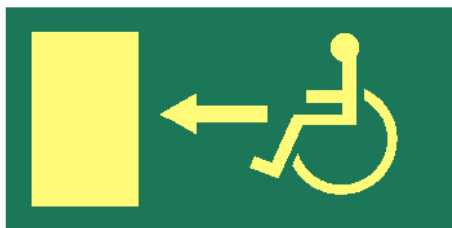

EXIT SIGN FOR ACCESSIBLE EXIT ROUTE



EVACUATION ELEVATOR
SIGN FOR ILLUSTRATION