

## 2.7. Turning Facilities for Fire Vehicles

**2.7.1.** Maximum Dead End allowed on Fire Accessway is 45 m. Where Fire Accessway dead end exceeds 45 m, a Turning Facility shall be provided. Such Turning facility can be U-Turn, Y-Turn, T-Turn or Roundabout.

### 2.7.2. U-Turn and Roundabout

U-Turn and Roundabout specifications shall be as shown in **Figure 2.5**.

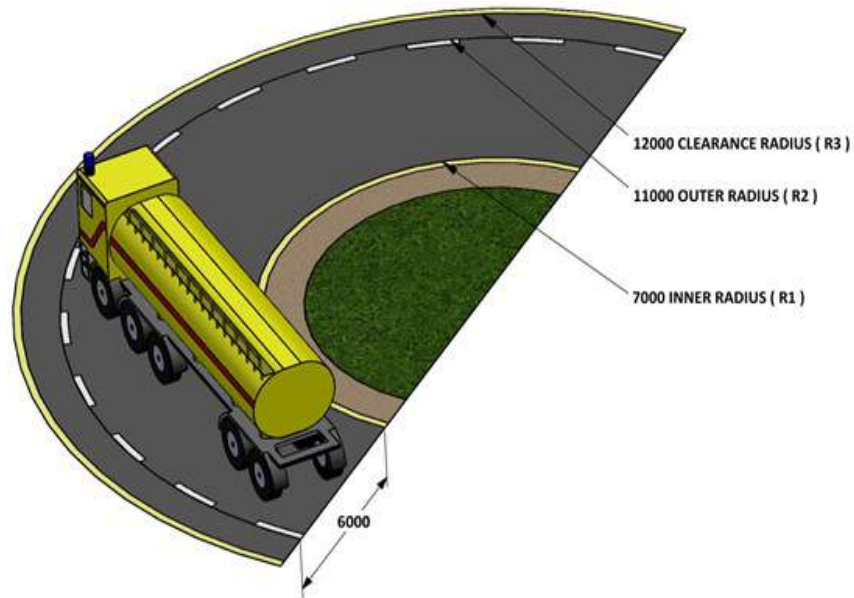


Figure 2.5: U-Turn specifications

### 2.7.3. T-Turn

T-Turn specifications shall be as shown in **Figure 2.6**.

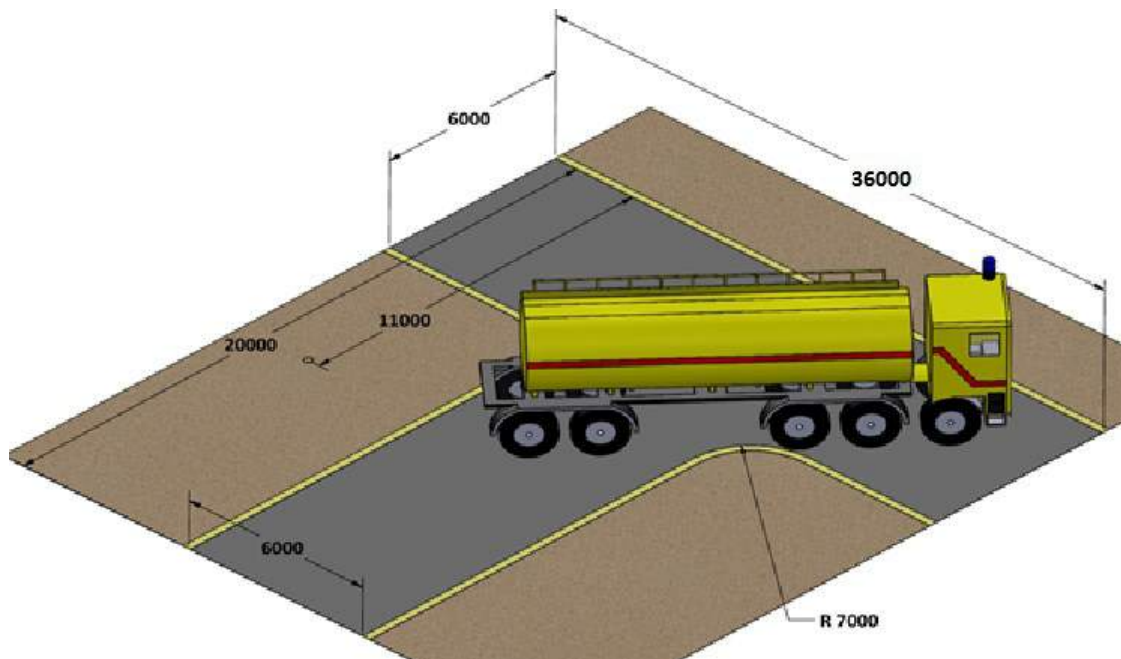


Figure 2.6: T-Turn specifications