
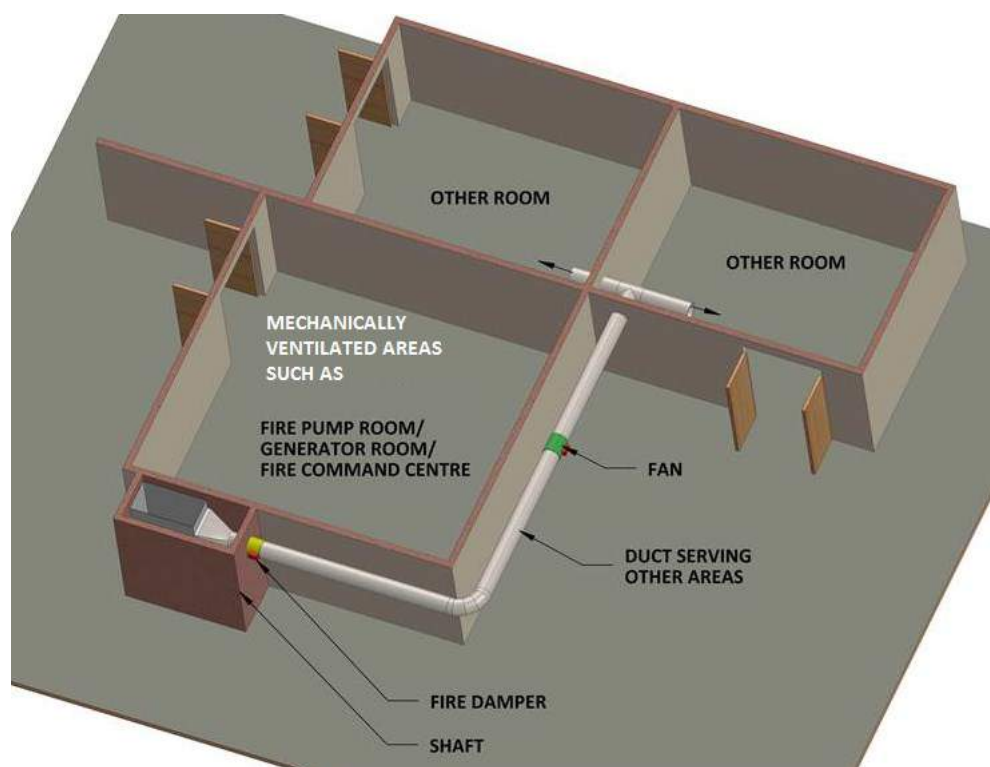


Table 10.15.: Mechanical Ventilation System for Smoke Exhaust

| ITEMS | REQUIREMENTS |
|------------------|--|
| 7. STANDBY POWER | i. Standby power is required for the mechanical ventilation systems serving as smoke exhaust. |
| 8. HVAC SYSTEM | i. Dedicated AHU system with dedicated ducting specifically for the area shall be permitted to serve as ventilation system, provided the system complies with all the features of Table 10.15. |

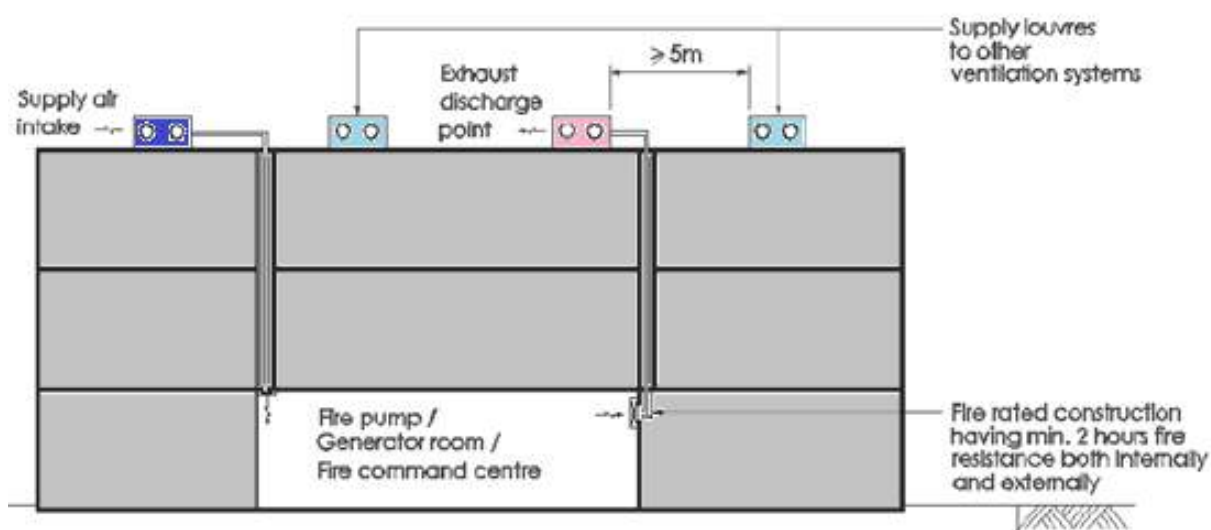

Schematic 10.34.: Ducts serving other Areas than Mechanically Ventilated Areas