

Table 9.7: Automatic Sprinkler System Requirements

ITEMS	REQUIREMENTS
20. CONTROL VALVES	<ul style="list-style-type: none"> i. Each sprinkler system shall be provided with a listed indicating valve in an accessible location, so located as to control all automatic sources of water supply. ii. At least one listed indicating valve shall be installed in each source of water supply but not for fire department connections. There shall be no shutoff valve in the fire department connection.

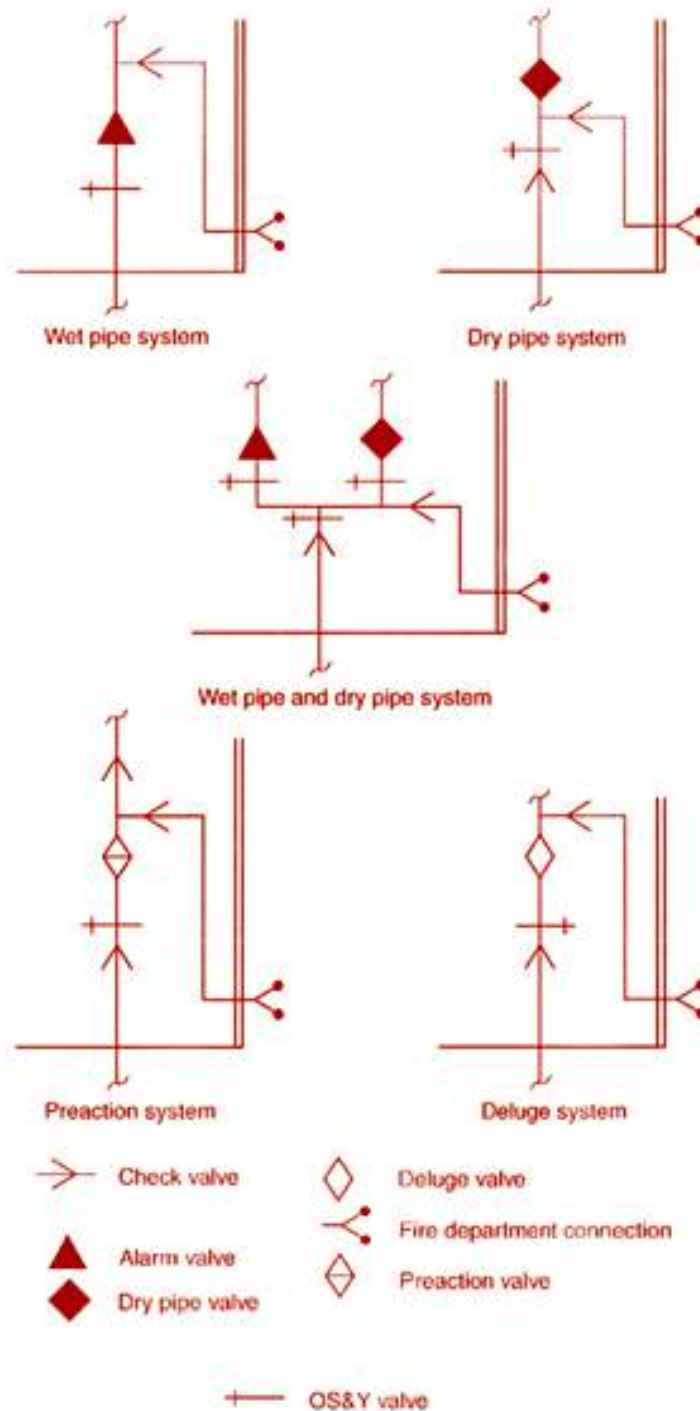


Figure 9.15.: Acceptable Isolation Valve arrangements