

Table 3.4: Stair

ITEMS	REQUIREMENTS
14. OUTSIDE STAIR	<ul style="list-style-type: none"> x. All openings below an outside stair shall be protected with an assembly having not less than a 45 minutes fire protection rating. xi. Openings to the side of an outside stair within 3m should have a fire protection rating of 30 minutes. xii. Outside stairs shall be arranged to avoid any impediments to the use of the stairs by persons having a fear of high places. Outside stairs more than three stories in height or 11 m in height, shall be provided with an opaque visual obstruction not less than 1220 mm in height.

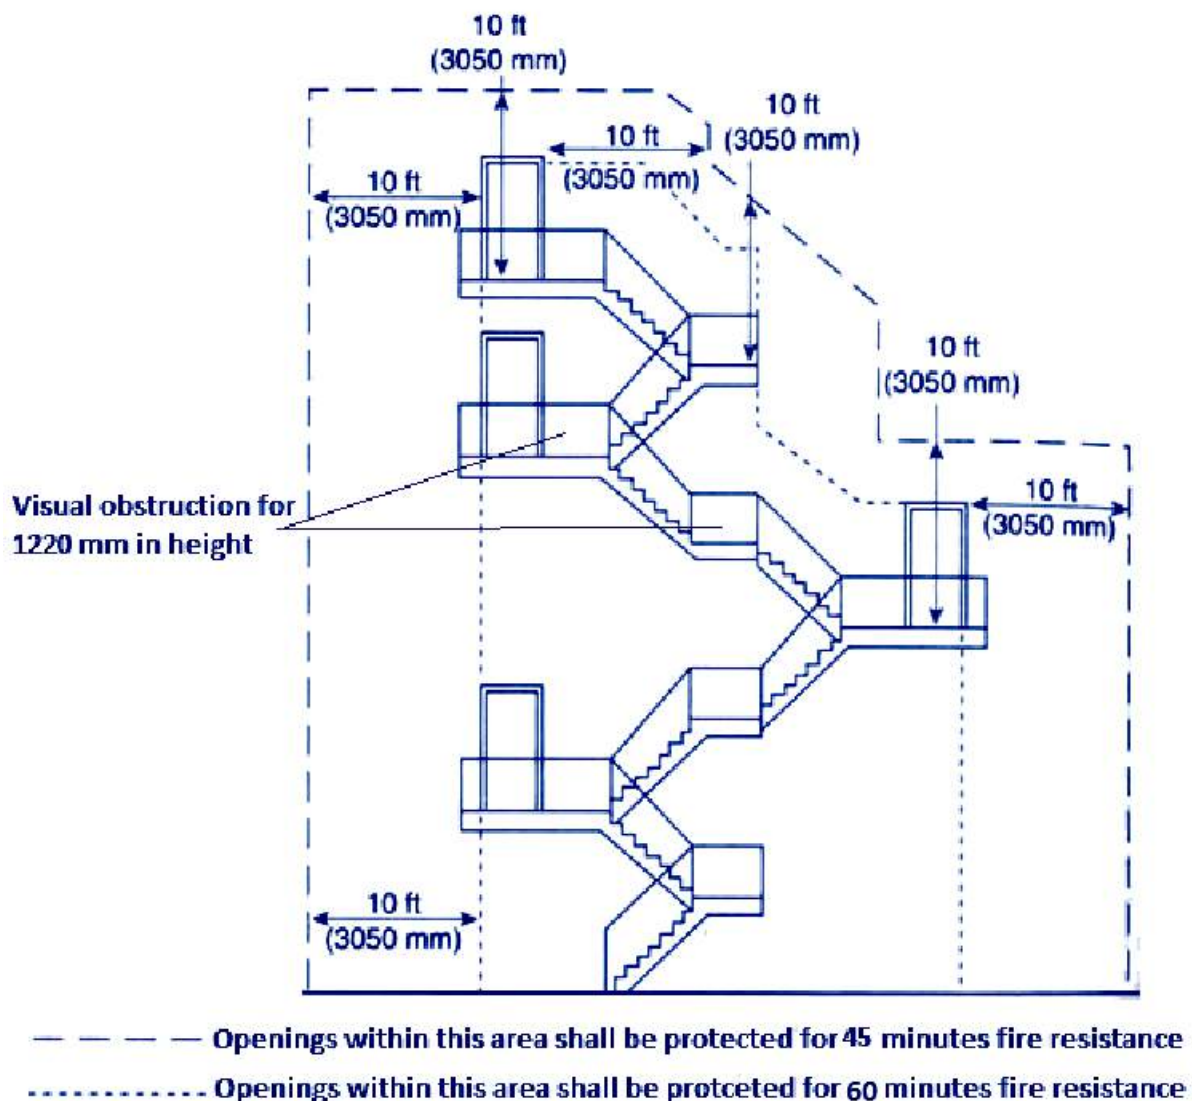


Figure 3.11.d.: Opening protection around Outside stair