



Table 1.9: Fire Resistance Separation and other requirement of incidental accessory /Occupancies.

INCIDENTAL ACCESSORY ROOMS AND OCCUPANCIES	REQUIRED SEPARATION WITH AUTOMATIC FIXED FIRE PROTECTION SYSTEM	REQUIRED SEPARATION WITHOUT AUTOMATIC FIXED FIRE PROTECTION SYSTEM	OTHER CONSTRUCTION AND PROTECTION REQUIREMENTS (See Chapter 9 for Fire Protection requirements Chapter 10 for smoke control requirements)
4. KITCHEN RESTAURANTS KITCHEN— COMMERCIAL	0 Hour	1 Hour	<ul style="list-style-type: none"> i. Kitchens having area more than 150 m² shall be provided with automatic sprinkler system. ii. Doors shall be 30 min fire rated and self closing. iii. Kitchen-hood suppression shall be provided. iv. Show/Open Kitchens shall be provided with 1 hour Fire rated Smoke partition (Glazing) to be separated from seating, open, circulation areas. v. Kitchen shall be permitted to be in the basement, but not LPG Cylinders or storage tank.

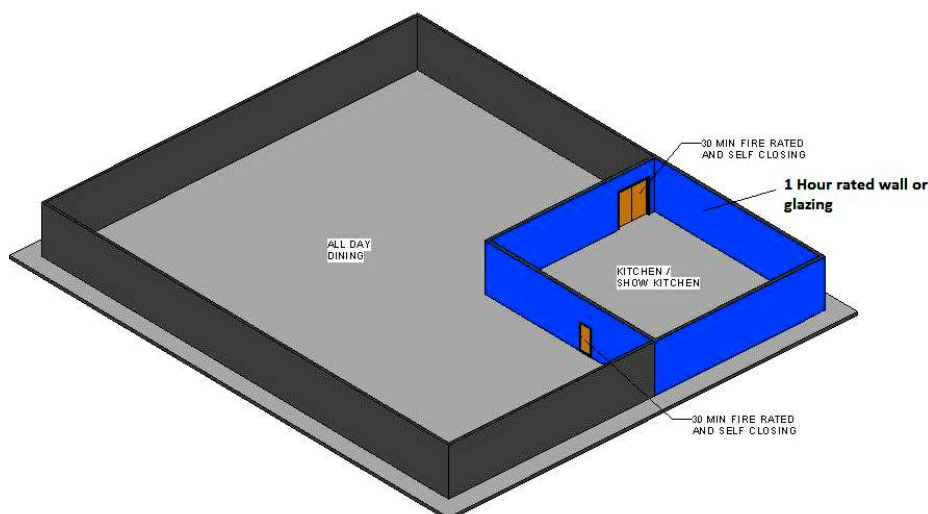
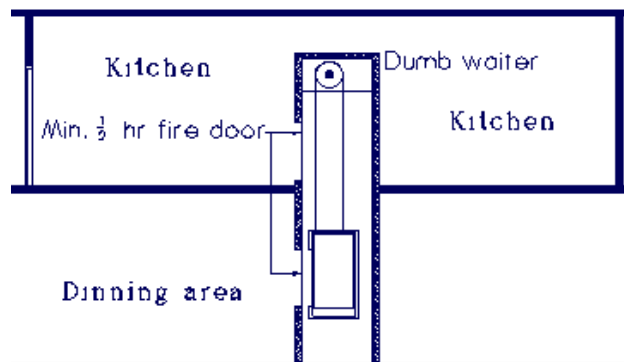
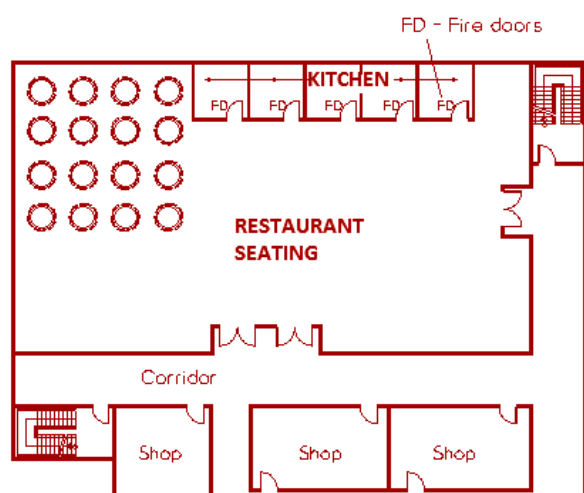


Figure 1.4: Separation of Kitchen