

Table 3.22.: Healthcare, Group A, B. (Hospitals and Clinics)

ITEMS	REQUIREMENTS
1. CORRIDOR	<ul style="list-style-type: none"> iv. Every corridor shall provide access to not less than two approved exits without passing through any intervening rooms or spaces other than corridors or lobbies. v. Every habitable room shall have an exit access door leading directly to an exit access corridor, except suites and rooms having direct discharge to outside. vi. Patient sleeping rooms with not more than 8 patient beds shall be permitted to pass through one intervening room to the exit corridor. vii. All corridor walls shall be smoke partitions, extending fully up to ceiling.

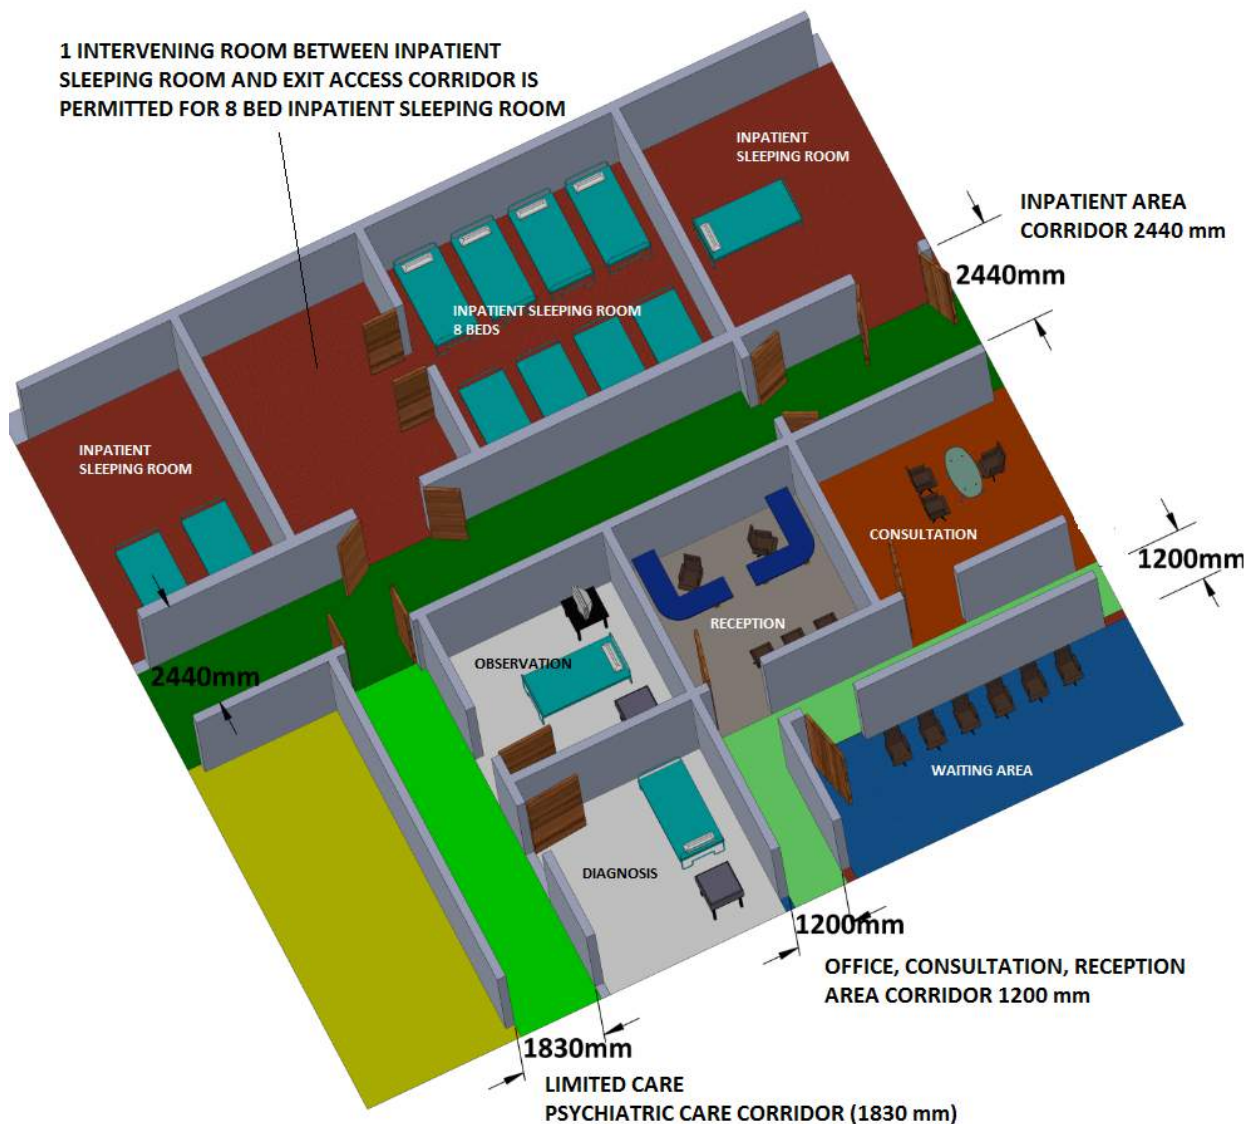


Figure 3.26.: Healthcare occupancy Corridor width Requirements