



Consultancy Services for Design and Supervision for STP, Sewer & TE Networks Systems in Ibri

Design Basis Report
Settlement Boundaries, Population, Flows and
Loads
Revision 0 • September 2026



PO Box 579, Muscat. PC 113
Sultanate of Oman
Tel: (968) 244 84 292
Fax: (968) 244 83 039
e-mail: Renardet-oman@renardet.net

Contents

1. Purpose and how to read this report	6
1.1. What it rests on.....	6
1.2. What it does not contain	6
2. The settlements and their boundaries	7
3. People today	9
3.1. From the meters to the properties	9
3.2. Persons per property	9
3.3. The 126 meters with no plot within 15 metres	11
4. The use of each plot.....	14
5. From water to sewage	16
5.1. Water demand	16
5.2. Return to the sewer	17
5.3. Special consumption: the industrial estates and other named sites	17
5.4. The result for 2024.....	18
6. How the land fills.....	20
6.1. How many people the empty land can hold	20
6.2. How fast each settlement grows	21
6.3. What happens when a settlement is full: the overflow.....	21
6.4. The design horizon: 2055, or the year the land is full.....	25
7. The flow each element is designed for.....	27
7.1. The flows by settlement and year.....	27
7.2. The plot	28
7.3. The pipe.....	28
7.4. The pumping station and its rising main.....	30
7.5. The trunk sewers and the treatment plant.....	30
7.6. The load on the treatment plant.....	34
7.7. Sewage other than domestic	34
7.8. Treated effluent	34
8. Every adopted value in one table	36
9. Data requested.....	37
10. Decisions requested, and values adopted	38
A. For approval.....	38
B. Adopted, for information.....	38
Appendix A1. Capacity and the overflow routes	40
Appendix A2. The tractive-force curve in full	42

Figures

Figure 1 The settlement boundaries as received (red, dashed) and as redrawn for the design (blue). Every plot lies in one settlement and the boundaries meet without gaps..... 8

Figure 2	Persons per property by settlement: the value calculated from the census and the meters, and the value adopted after the floor and the cap.	10
Figure 3	The 126 meters more than fifteen metres from any plot. Red: a domestic meter; blue: any other meter.	12
Figure 4	Nine of the 126 meters close up: on a road, in open ground, at a pumping station, on a building the cadastre does not carry. The plots are outlined in yellow.	13
Figure 5	The use of each plot. Coloured plots are built and metered; empty plots are shown by their outline only.	15
Figure 6	From the plot to the pipe and the STP: what each step adds.	16
Figure 7	From the empty plot to the year each settlement is full.	20
Figure 8	The annual growth rate of the series: the forecast to 2040, the extension to 2050, and the rise to a constant 2.40 per cent.	21
Figure 9	People in the study area by year, with the overflow and without it.	22
Figure 10	People at saturation in the ten settlements the choice affects most, with the overflow and without.	22
Figure 11	Where the growth goes once a settlement is full. Arrows show the routes carrying five hundred people or more; the shading shows how much of each settlement's capacity is taken by its neighbours' overflow.	24
Figure 12	People by year to saturation, the six largest settlements shown separately. The flat top of each band is the year that settlement fills.	25
Figure 13	Average sewage flow of the study area by year, from today's plots and from the empty plots as they fill.	28
Figure 14	The minimum gradient the tractive-force test asks for, against the flow in the pipe.	30
Figure 15	Average and peak-hour flow at one STP for the whole area, by year, with the margin.	31
Figure 16	Average sewage flow of each settlement in 2055 and at saturation, and the four steps from the settlements in a catchment to the flow of their STP.	33
Figure 17	The minimum gradient by tractive force at one pascal, the Table 11 minima of every size, and the 1.5 l/s floor.	42

Tables

Table 1	The decisions asked for	5
Table 2	The values adopted, for information	5
Table 3	Sources	6
Table 4	Persons per property by settlement, 2024	9
Table 5	The 126 meters by settlement	11
Table 6	Use of the built plots that carry a meter	14
Table 7	Named sites outside the ratios	18
Table 8	Water and sewage by settlement, 2024, m ³ /d	18
Table 9	Every settlement with and without the overflow: people in 2070 and the year it is full	22
Table 10	The study area in the design years	25
Table 11	People by settlement at five-year intervals	26
Table 12	Average sewage flow by settlement at five-year intervals, m ³ /d	27
Table 13	Minimum gradients at the concept stage	29
Table 14	Flows at one STP for the whole area, before infiltration and tankers, m ³ /d	31
Table 15	Average sewage flow by settlement in 2055 and at saturation, m ³ /d	32
Table 16	Loads at one STP for the whole area, from the per-person minima	34
Table 17	Raw sewage strength the guideline gives, for the network and for tankers, mg/l	34
Table 18	Treated effluent available, one STP for the whole area, m ³ /d	35

Table 19	Adopted values and assumptions.....	36
Table 20	Data requests	37
Table 21	Capacity of the empty land by settlement	40
Table 22	The overflow routes carrying fifty people or more at saturation	40

What this report asks for, and what it adopts

This report sets out the ground on which the sewer network, the treated effluent network and the treatment plant for Ibri will be designed: where the settlements are, how many people live in them, how many the land can hold, and the sewage each part of the system must carry. All of it will be part of the Concept Design Report. It is issued now, on its own, so that Nama Water Services can confirm the foundation before the design is built on it.

The study area holds 119,893 people in 2024 on the meters counted, and generates 20,852 cubic metres of sewage a day. Its empty land can hold 229,136 more. In 2055 it holds 244,914 people and generates 42,266 cubic metres a day; the last settlement fills in 2070, with 349,029 people and 60,099 cubic metres a day.¹

7 points need a decision from Nama Water Services. They are listed first, explained in the section named, and repeated in Section 10 with the answer sheet. 8 further values are the guideline's own or stated assumptions; they are adopted and reported, not put to approval. Seven data requests follow in Section 9.

Table 1 The decisions asked for

	Group	Decision
1	Settlements and people	Settlement boundaries
2	Settlements and people	Persons per property
3	Settlements and people	Use of each plot
4	Growth	The overflow
5	Growth	The design horizon
6	Growth	The growth beyond 2050
7	The network	Gradients and self-cleansing at the concept stage

Table 2 The values adopted, for information

	Group	Value
8	Settlements and people	The 126 meters with no plot within 15 metres
9	Water and sewage rates	Water demand and return
10	Water and sewage rates	The industrial estates
11	Growth	The connection ratio
12	The network	Infiltration and peak flow
13	The network	Depth
14	The plant and the effluent	STP flows and loads
15	The plant and the effluent	Treated effluent

¹ Average flows before infiltration and before the STP margin. Sections 6 and 7 give the series.

1. Purpose and how to read this report

The concept design will be submitted as one document. Its later parts, the options for the network and the plant, rest on the numbers in this report. If a number here changes after the options are drawn, the options are drawn again. Confirming the foundation first avoids that.

The report is written to be read in one sitting. Each section says what was done, what value is used, and why. Where a value is an assumption, it says so. Where the guideline gives a rule, the page is in a footnote. Section 8 collects every adopted value in one table; Section 10 is the answer sheet.

1.1. What it rests on

Table 3 Sources

Source	What it gives
PAM-GUD-201, General Design Guidelines, rev. 01, March 2026	water demand, return to the sewer, peak flow, infiltration, STP margin, treated effluent
PAM-GUD-203, Wastewater Design Guidelines, rev. 01, March 2026	self-cleansing, gradients, depth, STP flows, sewage strength
Inception Report R0 and its demand workbook	the population series to 2100, the settlement boundaries, the connection ratio
Electricity accounts, 33,971 meters	one property per domestic meter; shops, offices, government and farm meters by tariff
Cadastral plots, 77,265, Ministry of Housing and Urban Planning, September 2026	the land: built or empty, and its area
Sentinel-2 satellite image of 9 September 2026	which plots are planted

1.2. What it does not contain

No network is laid here and no plant is sized. The report gives the flow that each element will be designed for and the rule for finding it. The layout of the sewers, the stations and the plant follow in the concept design, on these numbers.

2. The settlements and their boundaries

Every rule in this report is applied settlement by settlement: the persons per property, the share of empty land that becomes housing, the growth rate and the year the land is full are all set for each settlement. So every plot must belong to exactly one settlement.

The Inception Report supplied twenty-six polygons for the twenty-five settlements, Al Aynayn being drawn as two. The polygons are drawn around the built cores. They do not touch, so the land between them belongs to nobody, and four of them, at Tanam, Satwah, Al Makhtibyah and Bat, miss part of the plots that carry the settlement's name. The map on the next page shows them in red.¹

The boundaries were therefore redrawn. Each of the 77,265 plots was given the settlement whose polygon contains it, or, where none does, the nearest one. The land was then divided so that every point belongs to the settlement of the nearest plot, and the shared edges were smoothed. The result, in blue on the map, covers the whole study area with twenty-five settlements and no gaps. Nothing else changed: the names, the population series and the plots are as received.²

The twenty-five settlements inside the study area carry 63.4 per cent of the wilayat's population in every year of the series. The other settlements of the wilayat lie outside the boundary and are not part of the design.

Decision 1. Approve the twenty-five settlement boundaries redrawn so that every plot lies in one settlement and there are no gaps between them (Section 2).

¹ Final_Boundary_IBRI.kmz, issued with the Inception Report R0.

² A Voronoi division of the plot centroids by settlement, merged, clipped to the study area boundary and smoothed as a coverage so that neighbours share one line.

Settlement boundaries: as received, and redrawn as a partition

Ibri Sewer, TE Networks and STP — Design Basis Report | Renardet 2621

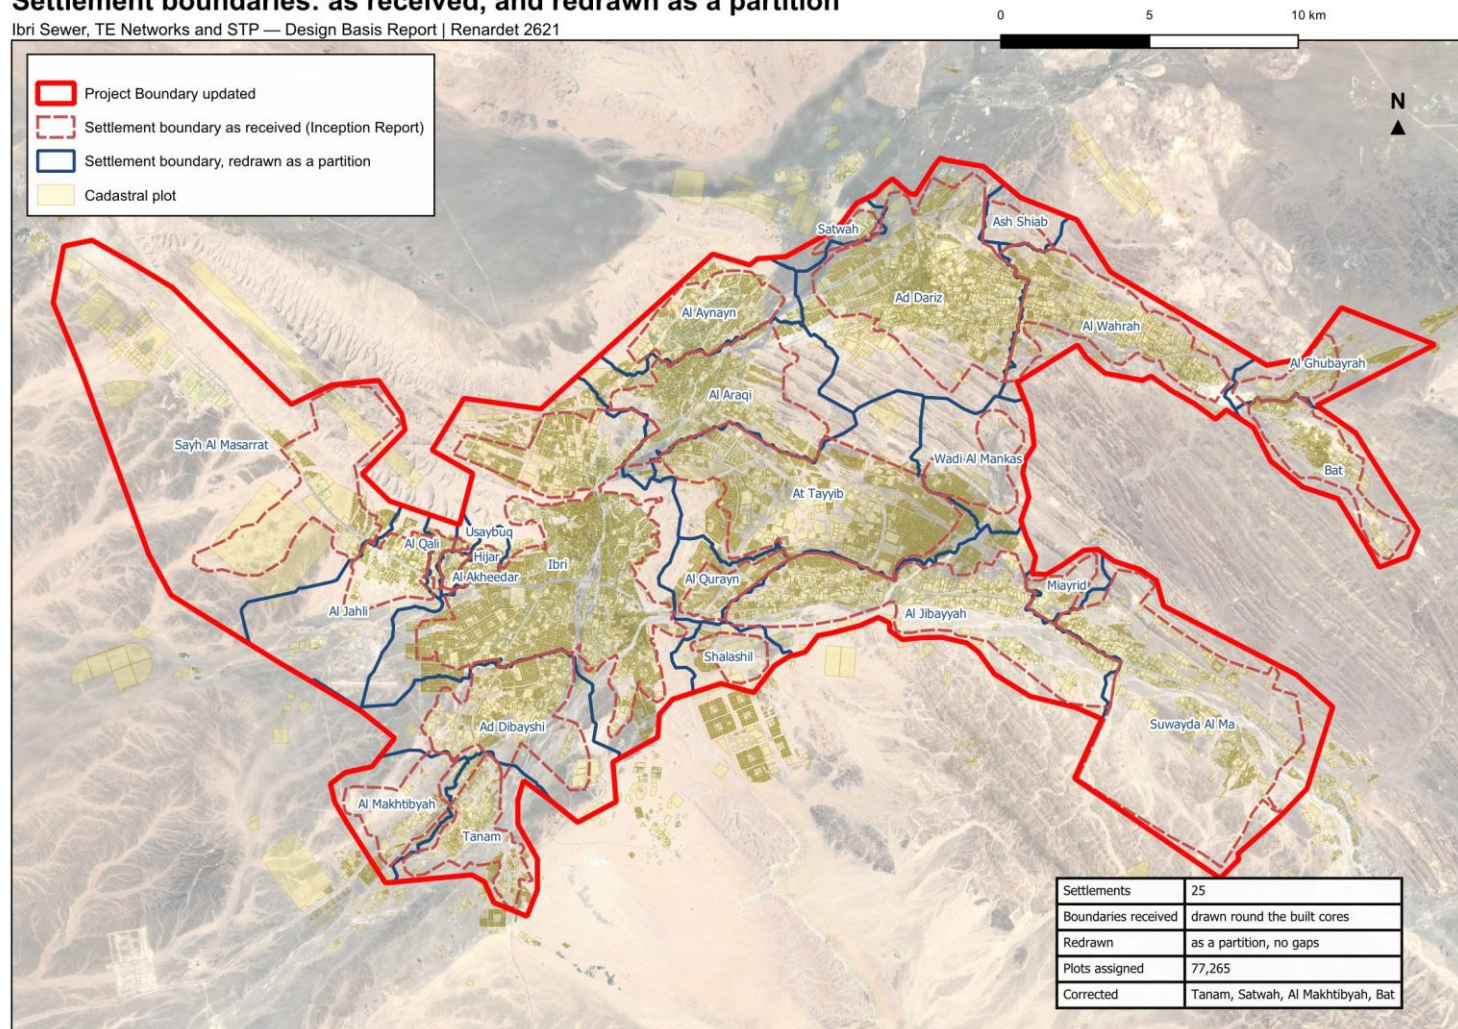


Figure 1 The settlement boundaries as received (red, dashed) and as redrawn for the design (blue). Every plot lies in one settlement and the boundaries meet without gaps.

3. People today

The population is counted, not assumed. Every domestic electricity meter is a property. The number of people in a property is set for each settlement from the official population. The two together give the people on every plot in 2024, the year of the electricity data.

3.1. From the meters to the properties

The electricity dataset holds 33,971 meters. 30,931 of them fall inside a plot. 2,914 lie on a road or in a gap between plots and were given the nearest plot within fifteen metres. 126 lie further than that from any plot; Section 3.3 shows them. Each meter on a household tariff is one property: 22,559 properties in all. Shop, office, government, farm and large-consumer meters carry no people.¹

3.2. Persons per property

The occupancy of each settlement is its population in 2024 divided by the properties counted in it.

$$OR = \frac{\text{population of the settlement in 2024}}{\text{properties counted in it}} \quad (1)$$

OR: occupancy, persons per property

Three rules bound the result. A floor of 4.0: some settlements would otherwise return between one and four persons per property, because their meters include the housing of the police, the college and similar institutions, whose occupants the census does not count as residents. Those properties discharge to the sewer whatever the census says, so the floor keeps them in. A cap of 6.12, the highest rate among the settlements of two thousand people or more. And a settlement of fewer than a thousand people takes 4.0 outright, one property per home plot and a home share of 0.9 (Section 6.1), because it has too few meters to measure on. That rule applies to 13 settlements.²

Ibri returns 6.07 persons per property. Over the whole study area the census gives 5.16. The guideline derives occupancy from population and housing units published by the statistics centre; housing units are not published at settlement level, and the counted properties are used in their place.³

Table 4 Persons per property by settlement, 2024

Settlement	Properties	Population 2024	Rate calculated	Rate adopted	People in the design
Ibri	11,052	67,106	6.07	6.07	67,106
Ad Dariz	2,439	11,850	4.86	4.86	11,850
Al Araqi	2,466	10,696	4.34	4.34	10,696
Al Aynayn	889	4,554	5.12	5.12	4,554
Al Wahrah	716	3,351	4.68	4.68	3,351
At Tayyib	833	3,348	4.02	4.02	3,348
Al Jibayyah	524	2,686	5.13	5.13	2,686
Bat	418	2,557	6.12	6.12	2,557
Ad Dibayshi	681	2,411	3.54	4.00	2,724

¹ The primary, subsidised primary and additional-dwelling tariffs count as properties. The 499 large-consumer accounts were placed by public records; their use decides only where the shop and government water is placed, not how much there is.

² 4.0 is the rate measured at At Tayyib, 3,300 people, the smallest settlement with a sample worth measuring. The cap is Bat's. The thirteen small settlements: Al Ghubayrah, Al Qurayn, Sayh al Masarrat, Al Jahli, Satwah, Al Akheedar, Al Qali, Shalashil, Al Makhtibyah, Usaybuq, Wadi al Mankas, Ash Shiab, Miayrid.

³ PAM-GUD-201, Section 7.2, page 59. The table below is the same as Table 15 of the Concept Design Report, Revision 2.

Settlement	Properties	Population 2024	Rate calculated	Rate adopted	People in the design
Tanam	403	2,116	5.25	5.25	2,116
Suwayda al Ma	301	1,559	5.18	5.18	1,559
Hijar	352	1,033	2.93	4.00	1,408
Al Ghubayrah	161	631	3.92	4.00	644
Al Qurayn	147	549	3.73	4.00	588
Sayh al Masarrat	457	466	1.02	4.00	1,828
Al Jahli	344	415	1.21	4.00	1,376
Satwah	27	263	9.73	4.00	108
Al Akheedar	120	198	1.65	4.00	480
Al Qali	56	191	3.41	4.00	224
Shalashil	38	130	3.42	4.00	152
Al Makhtibyah	91	122	1.34	4.00	364
Usaybuq	21	91	4.33	4.00	84
Wadi al Mankas	8	52	6.49	4.00	32
Ash Shiab	11	47	4.27	4.00	44
Miayrid	4	34	8.49	4.00	16
Total	22,559	116,452			119,893

With the floor and the cap the study area holds 119,893 people, against 116,452 in the official series for the same settlements. The difference is the institutional housing.¹

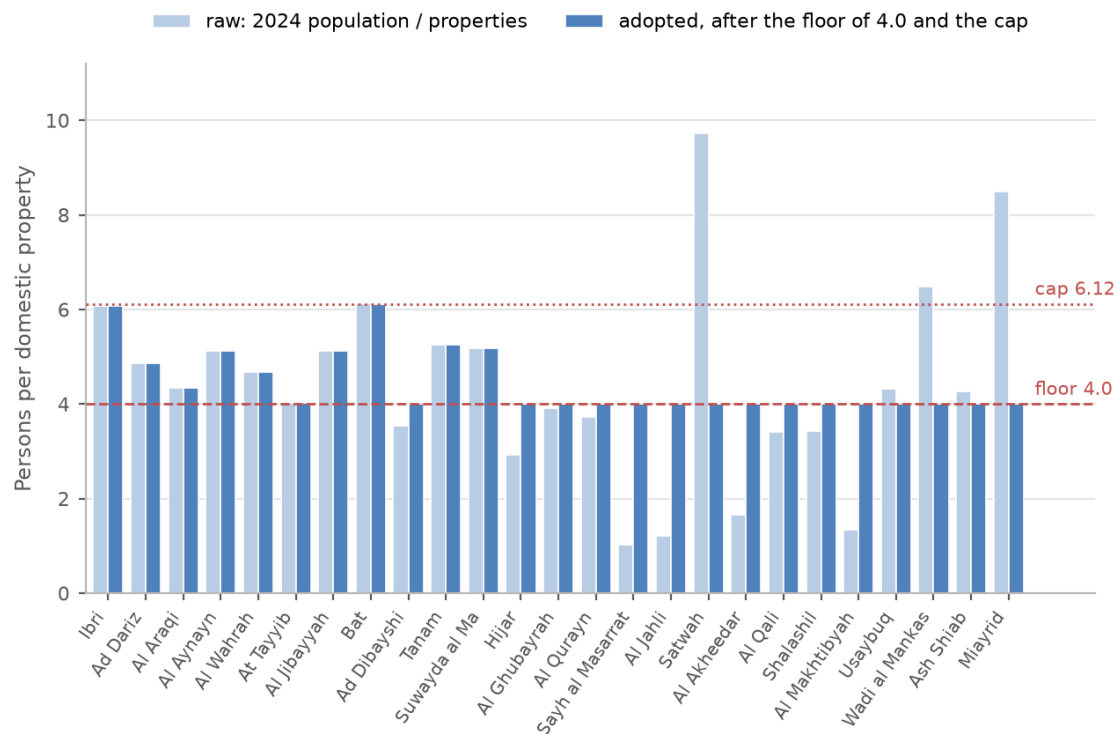


Figure 2 Persons per property by settlement: the value calculated from the census and the meters, and the value adopted after the floor and the cap.

¹ 116,452 divided by 22,559 properties gives the area-wide 5.16.

Decision 2. Approve the persons per property calculated for each settlement, with the floor of 4.0, the cap of 6.12 and the rule for settlements under a thousand people (Section 3).

3.3. The 126 meters with no plot within 15 metres

126 meters lie more than fifteen metres from any plot. 30 of them are domestic meters, about 140 people at their settlement's occupancy; the rest are government, shop and farm meters. Some stand on buildings the cadastre has not yet captured. Others stand on nothing: a road reserve, open ground, a pumping station. All of them are left out of the plot loads. The map on the next page shows where they are, and the figure after it shows nine of them close up, with the plots around them.¹

Table 5 The 126 meters by settlement

Settlement	Meters	Settlement	Meters
Ibri	29	Ad Dibayshi	3
Sayh al Masarrat	14	Al Jahli	3
Al Qurayn	14	Al Makhtibyah	2
Al Araqi	9	Al Wahrah	2
Suwayda al Ma	9	Shalashil	1
Al Jibayyah	9	Ash Shiab	1
Tanam	8	Al Qali	1
Ad Dariz	6	Bat	1
Al Ghubayrah	5	Al Akheedar	1
At Tayyib	4	Wadi al Mankas	1
Al Aynayn	3		

Adopted (8). They are left out of the plot loads: about 140 people (Section 3.3).

¹ By tariff: Government 46, Commercial 32, Primary Account Tariff 18, CRT Seasonal 9, Primary Account Tariff (with National Subsidy) 6, Additional Account Tariff 6, Agricultural 5, CRT Time of Use 4.

The meters more than 15 metres from any plot

Ibri Sewer, TE Networks and STP — Design Basis Report | Renardet 2621

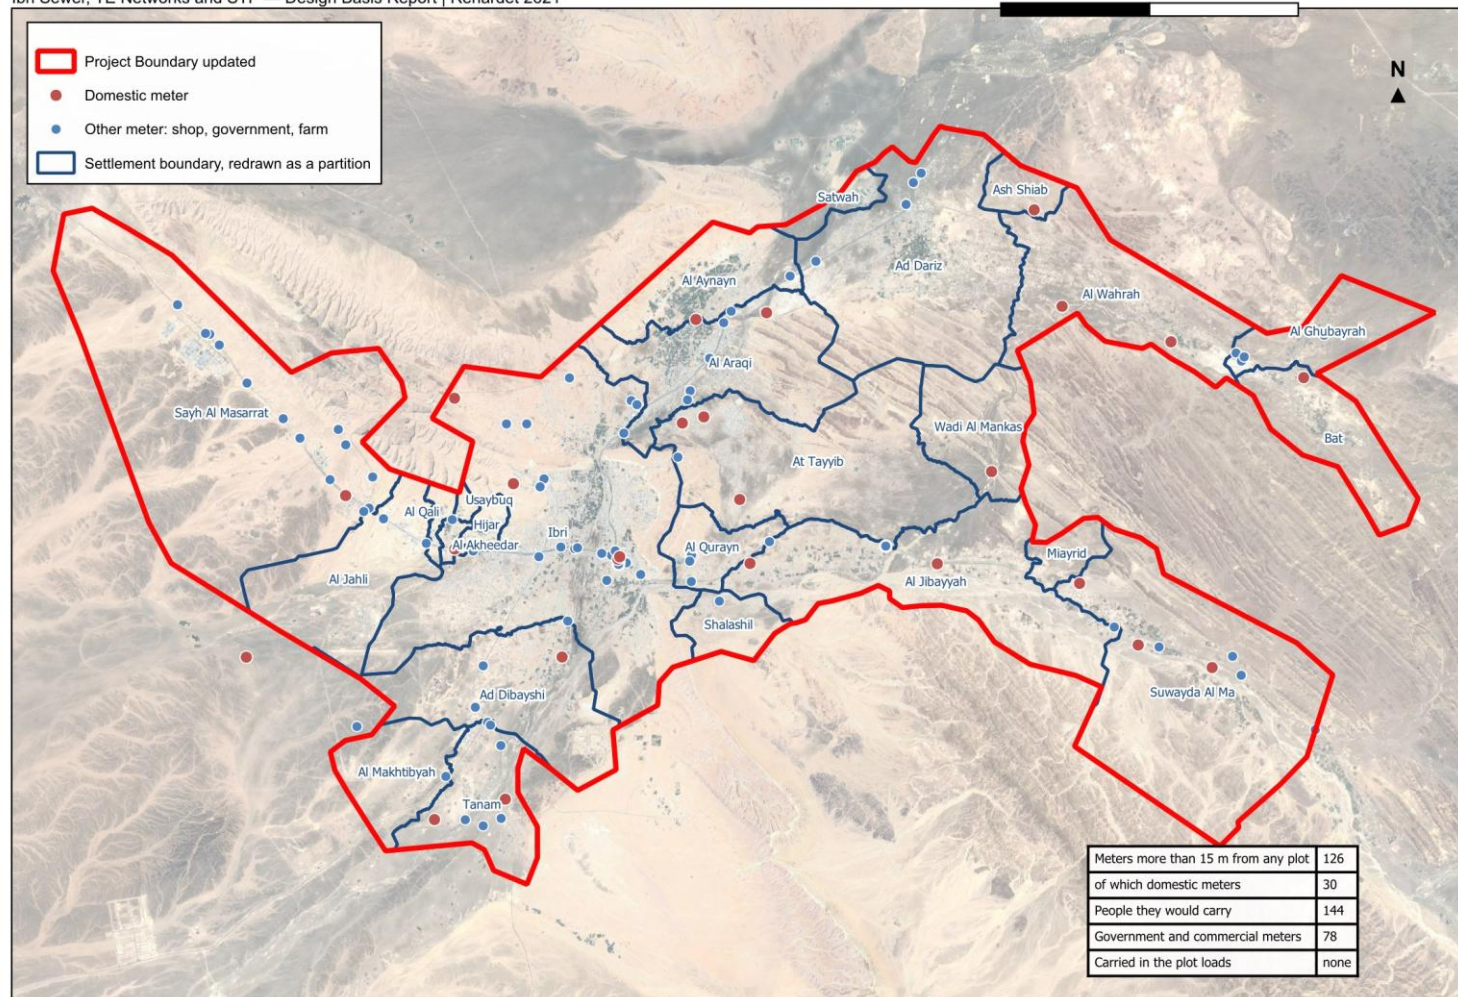


Figure 3 The 126 meters more than fifteen metres from any plot. Red: a domestic meter; blue: any other meter.

Panel 1 Ibri 1 meter, 1 domestic




Panel 3 Ibri 3 meters, 1 domestic




Panel 15 Sayh al Masarrat 1 meter




Panel 16 Sayh al Masarrat 3 meters

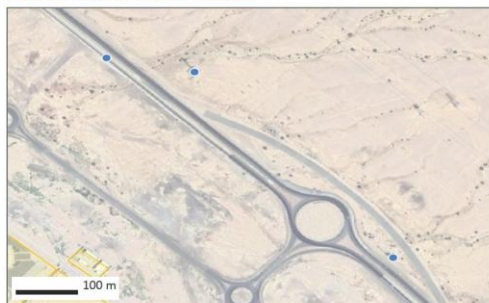


Panel 17 Sayh al Masarrat 1 meter

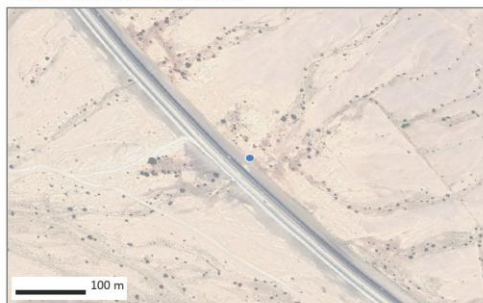

Panel 21 Sayh al Masarrat 2 meters

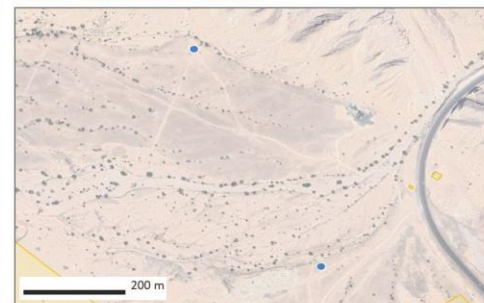


Panel 26 Al Araqi 1 meter

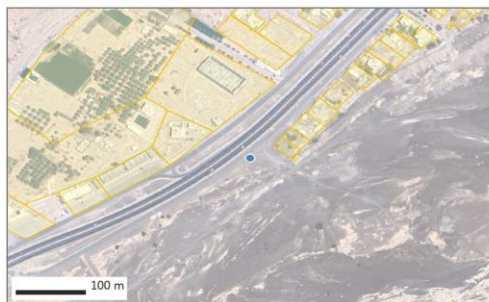

Panel 28 Al Araqi 2 meters



Panel 42 Tanam 2 meters

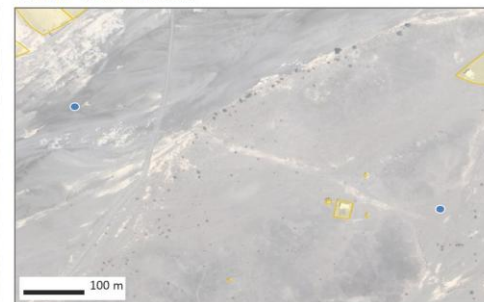

● domestic meter ● other meter (shop, government, farm) · plots outlined in yellow · no plot within 15 m of any meter shown

9 examples of the 126 meters

Figure 4 Nine of the 126 meters close up: on a road, in open ground, at a pumping station, on a building the cadastre does not carry. The plots are outlined in yellow.

4. The use of each plot

The cadastre's own land-use field cannot be used as it stands: it has no government class, it records whole districts under codes that mean unclassified, and on the plots that carry meters it disagrees with the meters on 24 per cent of them. The use of every plot has therefore been determined from what is on it, in a fixed order.¹

1. a plot inside one of the two industrial estates is industrial;
2. the 177 plots of the old quarter of Ibri, recorded as tourism, are heritage and carry no load;
3. a plot with a farm meter is a farm;
4. a plot the satellite image shows as planted is a farm, unless two thirds of its meters are shops or most are government;
5. a plot whose industrial meters equal or outnumber its households is industrial;
6. otherwise the meters decide by proportion: more than two thirds households makes a home, two thirds or more government makes a government plot, two thirds or more shops makes a shop, and a mix is a home with a shop, or a government plot where the government meters are the more;
7. a plot without a meter is empty.

The satellite image is a cloud-free Sentinel-2 image of 9 September 2026. It is used for one purpose: to tell a planted plot, a date-palm plantation, from a bare one, because a farm meter alone misses the plantations that pump from elsewhere.²

Table 6 Use of the built plots that carry a meter

Use	Plots	How it was decided
Home	12,464	more than two thirds of the meters are households
Home with a shop	614	a mix, with at least as many shop as government meters
Shop	1,321	two thirds or more of the meters are shops
Government	410	two thirds or more government; or a mix with more government than shop meters; the treatment plant
Farm	1,684	a farm meter (488) or planted on the satellite image (1,196)
Industrial	263	inside an industrial estate, or industrial meters that match the households
Heritage	177	the old quarter of Ibri; no meter, no load
Empty	60,509	no meter

The use decides where the shop and government water is placed and which empty plots can become homes. It does not change the total: that comes from the people and the rates of Section 5.

Decision 3. Approve the use determined for each plot from the meters and the satellite image, in place of the cadastre's own land-use field, as the basis for placing the loads (Section 4).

¹ MoH_Plots, 77,265 plots, received September 2026.

² 38 per cent of the plots with a farm meter show no planting: pump sites without a crop. The treatment plant's own plot carries farm meters for its pumps and is classed as a government site.

Use of each plot, derived from the meters and the satellite

Ibri Sewer, TE Networks and STP — Design Basis Report | Renardet 2621

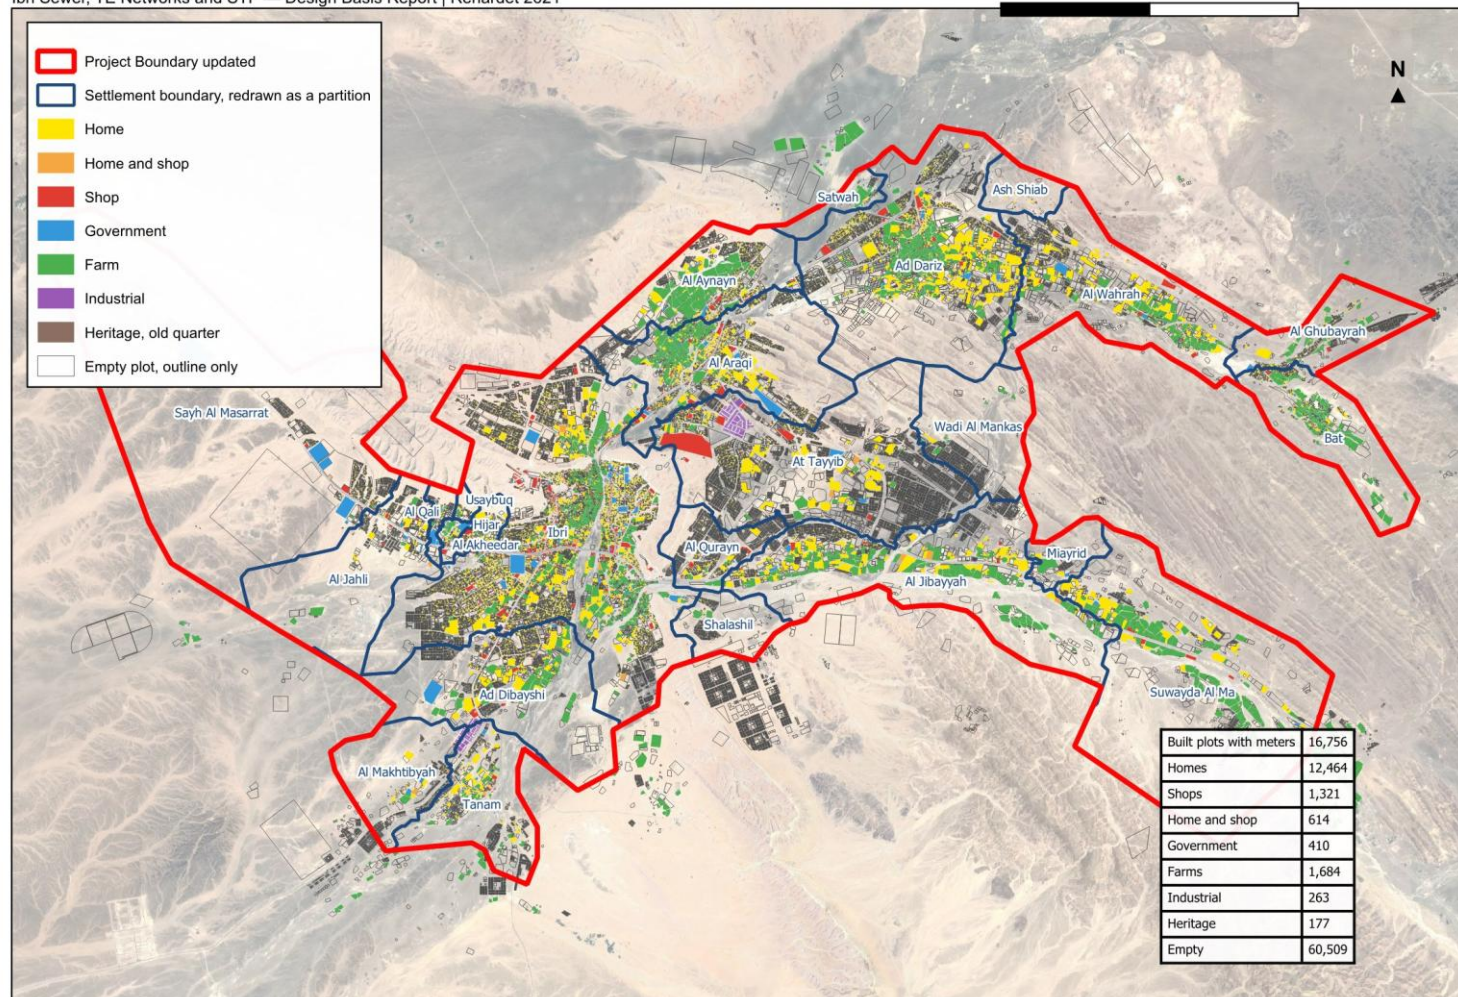


Figure 5 The use of each plot. Coloured plots are built and metered; empty plots are shown by their outline only.

5. From water to sewage

Sewage is calculated from water. Three streams are carried for every settlement: the water of its households, of its shops and offices, and of its government buildings. A fourth, the special consumption, is added on its own; in the study area it is the two industrial estates. Each stream returns a fixed share to the sewer.

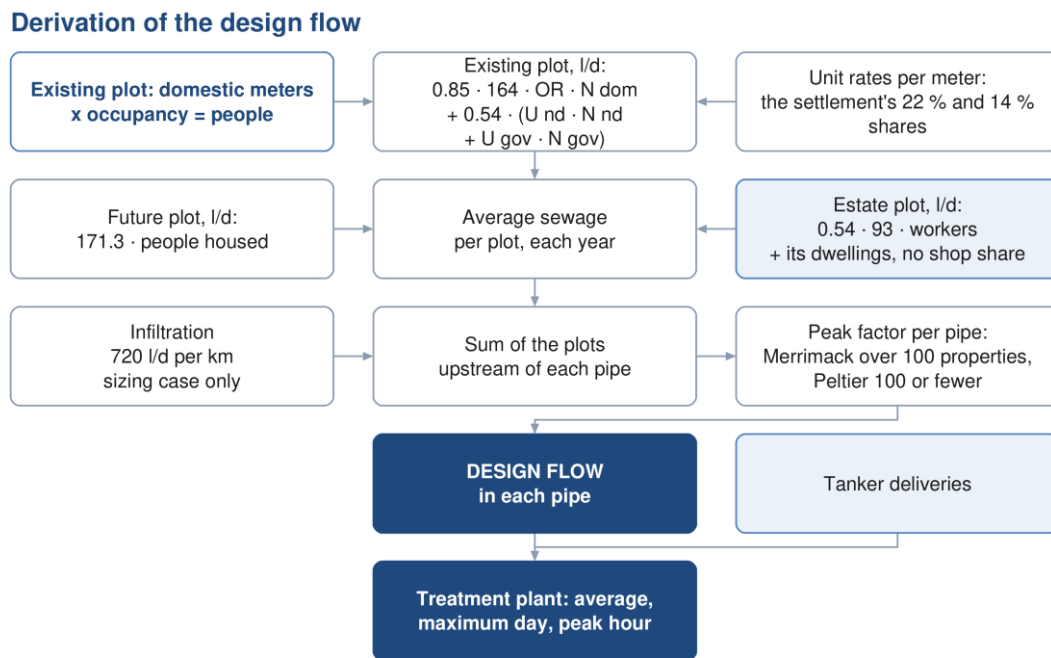


Figure 6 From the plot to the pipe and the STP: what each step adds.

5.1. Water demand

A person uses 164 litres a day at home. That is the value the guideline publishes for the Governorate of Adh Dhahirah, to be used until Nama Water Services issues an updated figure.¹

$$Q_{\text{dom}} = \text{people} \times 164 \quad (2)$$

Q_{dom} : domestic water demand, l/d

Shops, offices and government buildings are added as shares of the domestic water: 22 per cent for shops and offices, 14 per cent for government. The guideline calls these shares distributed. They come from the governorate's water balance of 2021 to 2023, all the non-domestic water divided by all the domestic water, so they stand for the everyday shops, mosques, schools and offices that come with any population, and they are added whether or not a particular village has a shop today. They do not cover named projects such as economic zones, which are added separately.²

$$Q_{\text{shops}} = 0.22Q_{\text{dom}} \quad Q_{\text{gov}} = 0.14Q_{\text{dom}} \quad (3)$$

Q_{shops} : water of shops and offices in the settlement, l/d

Q_{gov} : water of government buildings in the settlement, l/d

¹ PAM-GUD-201, Table 11, page 60, and Section 7.3.1, page 59.

² PAM-GUD-201, page 59: the ratios "refer to spatially distributed non-domestic consumption that are to be added to the domestic consumption" and "do not apply to ... specific identified non-domestic projects such as economic zones". Per person the shares are 36 and 23 litres a day.

The guideline prefers unit rates where detailed land use is known: so many litres per pupil, per hospital bed, per employee, per square metre of shop. None of those quantities is held for Ibri. Until they are, the ratios are used. They are not added on top of unit rates anywhere; it is one or the other.¹

The shares are placed where the water is used. Each settlement's shop water is divided equally among its shop meters, and its government water among its government meters, so the load sits on the shopping street and the school, not on the houses. A settlement with no shop or government meter keeps that share on its houses.

5.2. Return to the sewer

Not all water reaches the sewer. Households return 85 per cent, and so does water delivered by tanker; shops, offices, government buildings and the special consumption return 54 per cent. Farm meters feed irrigation pumps and return nothing.²

$$Q_{\text{sewage}} = 0.85Q_{\text{dom}} + 0.54(Q_{\text{shops}} + Q_{\text{gov}} + Q_{\text{special}}) \quad (4)$$

Q_{sewage} : average sewage flow, before infiltration, l/d

Q_{special} : water of the special consumption, the guideline's term; in the study area the two industrial estates, l/d

For a person in a new home all three streams are added together: $164 \times 0.85 + 36 \times 0.54 + 23 \times 0.54 = 171.3$ litres of sewage a day. That is the rate every future plot carries, because where its shops will stand is not known.³

Adopted (9). 164 litres per person per day, plus 22 per cent for shops and offices and 14 per cent for government, the values the guideline publishes for Adh Dhahirah; 85 per cent of domestic and tanker supply and 54 per cent of the rest return to the sewer. The published ratios are used in place of the unit rates per pupil, bed, employee and floor area until those quantities are held (Section 5).

5.3. Special consumption: the industrial estates and other named sites

Two industrial estates lie inside the study area, at Al Tayyeb in the north-east of the town and at Tanam beside the treatment plant. Their meters are on the commercial tariff. The guideline keeps such estates outside the ratios, as special consumption, so they are carried on their own: a workforce of 4,500 at Al Tayyeb and 1,800 at Tanam, at 93 litres a day each, the dry-industry rate. The workforce is an assumption from the number of workshop meters and is to be replaced by the estates' records.⁴

¹ PAM-GUD-201, Table 12, page 61, and Sections 7.3.2 and 7.3.3, pages 60 and 61.

² PAM-GUD-201, Table 19, page 71. The farm rule is a rule of this design: on 172 of 319 farm plots a household is metered separately from the pump.

³ 36 and 23 are 22 and 14 per cent of 164.

⁴ PAM-GUD-201, page 59 and Table 12, page 61. Al Tayyeb: 94 hectares, 202 plots, 1,035 meters. Tanam: 61 hectares, 105 plots, 409 meters. About five meters per plot and three to six workers per workshop give the figures.

Table 7 Named sites outside the ratios

Site	What it is	How it is carried
Al Tayyeb industrial area	94 ha, 202 industrial plots	4,500 workers at 93 l/d
Tanam industrial area	61 ha, 105 plots, beside the STP	1,800 workers at 93 l/d
Army camp	296 ha west of the town, no meter	recorded, no load; occupancy and drainage to be confirmed
Ibri View resort	2 km ² at As Sulayf, announced	recorded, no load until its plan is issued
Ibri Industrial City (Madayn)	10 km ² , 8.6 km outside the boundary	outside the network; a source of tankered sewage to confirm
Power station and solar plants	7.5 to 11 km outside, with a camp	outside the network; tankered sewage to confirm

Water delivered by tanker and water from private wells are in no flow. No filling-station or delivery record is held, and no record of private wells. Both are requested in Section 9. A household on tanker supply is metered for electricity like any other, so its people are counted; only the extra water is missing, and it can only raise the loads.¹

Adopted (10). 4,500 workers at Al Tayyeb and 1,800 at Tanam at 93 litres a day each, an assumption to be replaced by the estates' records when received (Section 5.3).

5.4. The result for 2024

Applied plot by plot, the rules give 20,852 cubic metres of sewage a day in 2024: 16,713 from households, 2,336 from shops and offices, 1,486 from government buildings and 316 from the two estates. The table gives the settlements.²

Table 8 Water and sewage by settlement, 2024, m³/d

Settlement	People	Household water	Shop and office water	Government water	Special	Sewage
Ibri	67,106	11,005	2,421	1,541	–	11,494
Ad Dariz	11,850	1,943	428	272	–	2,030
Al Araqi	10,696	1,754	386	246	–	1,832
Al Aynayn	4,554	747	164	105	–	780
Al Wahrah	3,351	550	121	77	–	574
At Tayyib	3,348	549	121	77	419	799
Al Jibayyah	2,686	440	97	62	–	460
Bat	2,557	419	92	59	–	438
Ad Dibayshi	2,724	447	98	63	27	481
Tanam	2,116	347	76	49	105	419
Suwayda al Ma	1,559	256	56	36	–	267
Hijar	1,408	231	51	32	–	241
Al Ghubayrah	644	106	23	15	–	110
Al Qurayn	588	96	21	14	–	101
Sayh al Masarrat	1,828	300	66	42	–	313
Al Jahli	1,376	226	50	32	–	236
Satwah	108	18	4	2	–	19

¹ PAM-GUD-201, Section 7.4, page 70: an assessment of private wells and other non-network sources is required.

² The sum of the plots equals the settlement in every column.

Settlement	People	Household water	Shop and office water	Government water	Special	Sewage
Al Akheedar	480	79	17	11	–	82
Al Qali	224	37	8	5	–	38
Shalashil	152	25	5	3	–	26
Al Makhtibyah	364	60	13	8	36	82
Usaybuq	84	14	3	2	–	14
Wadi al Mankas	32	5	1	1	–	5
Ash Shiab	44	7	2	1	–	8
Miayrid	16	3	1	0	–	3
Total	119,893	19,663	4,326	2,753	586	20,852

6. How the land fills

The population of 2024 is counted. The population at the end is set by the land: a settlement can only grow until its empty plots are built. Three things are needed: how many people the empty land can hold, how fast each settlement grows, and what happens when it is full.

From the empty plot to the saturation year

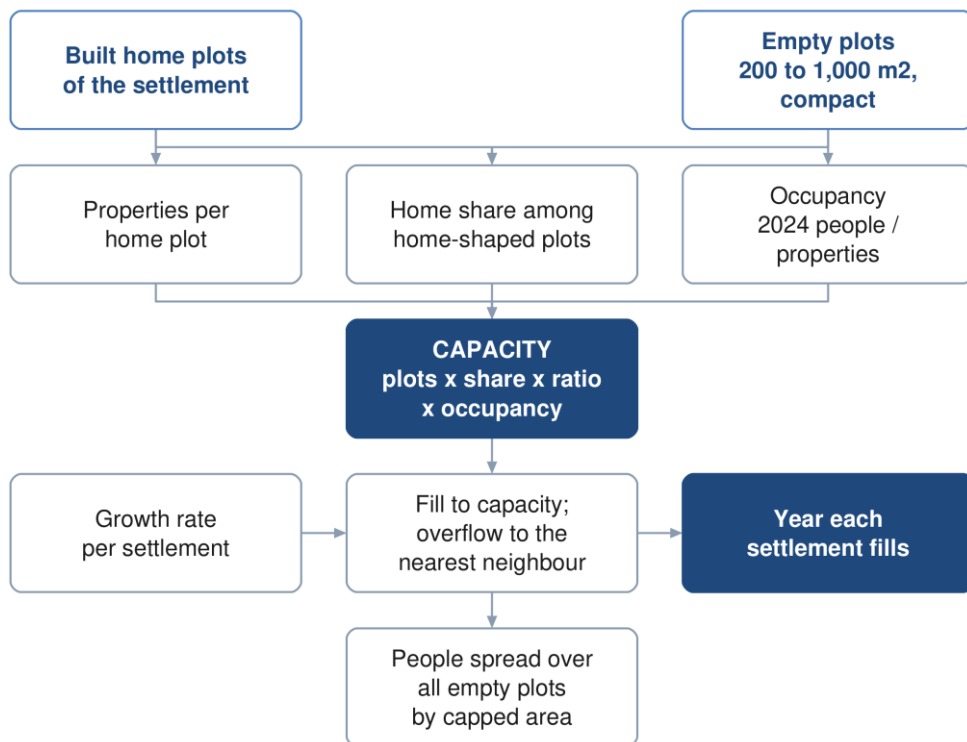


Figure 7 From the empty plot to the year each settlement is full.

6.1. How many people the empty land can hold

Of the 77,265 plots, 60,509 carry no meter. Not all of them will become homes. A future home plot must look like the built ones: between 200 and 1,000 square metres, compact, not a strip. Very small plots below 200 square metres, odd shapes and everything above 1,000 square metres are left out, as are plantations, industrial plots and the heritage quarter. 46,109 empty plots pass that test.¹

A district also needs mosques, shops and offices, so not every home-shaped plot becomes a home. The share that does is measured in each settlement over its built, metered, home-shaped plots. Ibri returns 0.87; among the settlements of a thousand people or more it runs from 0.67 at Tanam to 0.94 at Al Aynayn. The number of properties a home plot carries is measured the same way; Ibri returns 1.33.²

$$\text{capacity} = \text{home-shaped empty plots} \times \text{home share} \times \text{properties per plot} \times \text{OR} \quad (5)$$

capacity: people the empty land of the settlement can hold, persons

home share: share of the home-shaped plots that become homes

¹ Compactness is the plot's area against that of its smallest enclosing rectangle, not less than 0.6, with the rectangle's sides no more than three to one. Built home plots have a median area of 717 square metres. Shapes above 2,000 square metres are whole future districts drawn as one plot; they take nothing until subdivided.

² The settlements under a thousand people take 0.9 and one property per plot, as in Section 3.2. The table by settlement is in Appendix A1.

OR: persons per property of the settlement

The empty land of the study area holds 229,136 people on this basis, against 119,893 living in it in 2024.¹

6.2. How fast each settlement grows

The growth rate comes from the population series of the Inception Report, and nothing else is taken from it. To 2040 the series is the official forecast for the wilayat, from the statistics centre and Nama Water Services; from 2041 to 2050 it is the extension of that forecast in the Inception Report. Both are the client's own figures. From 2051 the series rises from 2.2 per cent a year to 2.40 by 2058 and stays there to 2100, the horizon Nama Water Services instructed; that part goes beyond the ten years of extension the guideline allows and is put to approval. Every settlement carries the same annual rate, applied to its counted population. The rate averages 2.6 per cent a year to 2030, 2.5 in the 2030s, 2.0 in the 2040s, 2.3 in the 2050s and 2.4 after 2060.²

The series' total for 2100 is not a target. The land fills long before then.

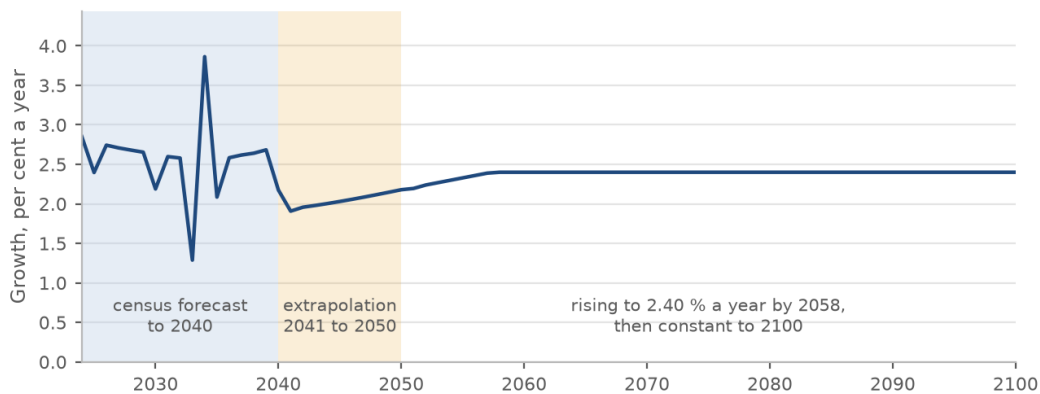


Figure 8 The annual growth rate of the series: the forecast to 2040, the extension to 2050, and the rise to a constant 2.40 per cent.

Decision 6. Approve the extension of the population series beyond 2050: the rise to 2.40 per cent a year by 2058 and that rate held to 2100. The series to 2050 is the client's own (Section 6.2).

6.3. What happens when a settlement is full: the overflow

Each settlement grows at the rate of the series until its empty plots are built. Then its further growth has to go somewhere. Two readings are possible, and the choice between them is the largest single decision in this report.

With the overflow: when a settlement is full, its further growth moves to a neighbour with room. Ibri's goes in parallel to Al Araqi, Al Qurayn and Shalashil, in the proportions seventy, twenty and ten per cent, then to Ad Dariz, then to the nearest settlement with room. At Tayyib's goes first to Miayrid. Every other settlement overflows to its nearest neighbour with room.

Without: each settlement grows on its own rate and stops when it is full. The growth it cannot house is lost to the study area.

The difference is large. With the overflow every settlement fills by 2070 and the study area holds 349,029 people. Without it, 7 settlements never fill before 2100, the study area holds 273,616 people in 2070, and 75,414 people of the

¹ Capacity by settlement: Appendix A1.

² Inception Report R0, Section 6, and the demand workbook, sheets Pop_Wilayat and Project Pop Settlements. PAM-GUD-201 allows an extrapolation of ten years beyond the available forecast.

series have nowhere to go. A sewer in those settlements sized on their own growth would be sized for land that never fills.¹

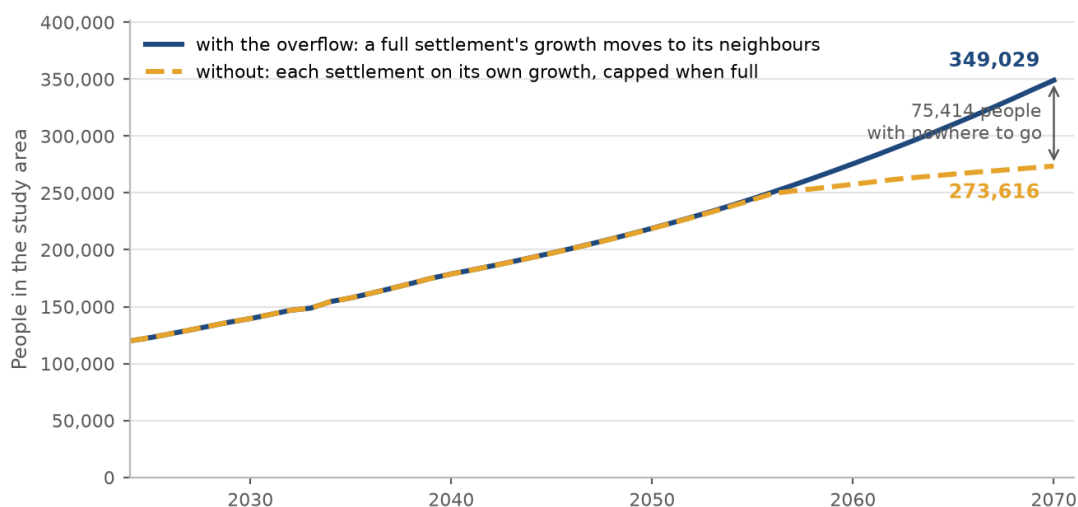


Figure 9 People in the study area by year, with the overflow and without it.

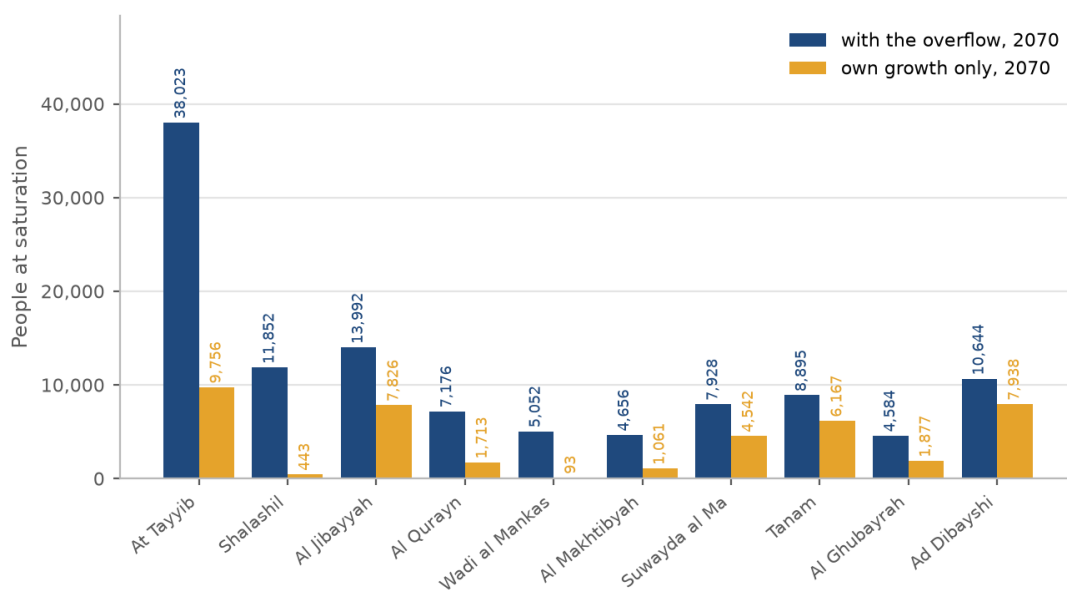


Figure 10 People at saturation in the ten settlements the choice affects most, with the overflow and without.

Table 9 Every settlement with and without the overflow: people in 2070 and the year it is full

Settlement	Capacity, people	With the overflow: people 2070	full in	Own growth only: people 2070	full in
Ibri	73,299	140,405	2056	140,405	2057
Ad Dariz	16,854	28,704	2062	28,704	2063
Al Araqi	11,832	22,528	2057	22,528	2057
Al Aynayn	7,459	12,013	2060	12,013	2066
Al Wahrah	7,109	10,460	2070	9,765	2073
At Tayyib	34,675	38,023	2068	9,756	not before 2100

¹ The settlements that never fill on their own growth: At Tayyib, Al Ghubayrah, Al Qurayn, Al Makhtibiyah, Shalashil, Wadi al Mankas, Miyayrid. The overflow routes reflect local knowledge of where Ibri's growth is taking place.

Settlement	Capacity, people	With the overflow: people 2070	full in	Own growth only: people 2070	full in
Ad Dibayshi	7,920	10,644	2063	7,938	2083
Al Jibayyah	11,306	13,992	2070	7,826	2095
Bat	2,226	4,783	2052	4,783	2052
Tanam	6,779	8,895	2069	6,167	2086
Sayh al Masarrat	4,984	6,812	2069	5,327	2081
Suwayda al Ma	6,369	7,928	2070	4,542	2094
Hijar	1,288	2,696	2053	2,696	2053
Al Jahli	3,684	5,060	2063	4,010	2080
Al Ghubayrah	3,940	4,584	2070	1,877	not before 2100
Al Qurayn	6,588	7,176	2060	1,713	not before 2100
Al Akheedar	160	640	2036	640	2036
Al Makhtibyah	4,292	4,656	2069	1,061	not before 2100
Al Qali	564	788	2054	653	2078
Shalashil	11,700	11,852	2061	443	not before 2100
Satwah	284	392	2060	315	2080
Usaybuq	140	224	2054	224	2067
Ash Shiab	48	92	2056	92	2056
Wadi al Mankas	5,020	5,052	2068	93	not before 2100
Miayrid	616	632	2070	47	not before 2100
Total	229,136	349,029	2070	273,616	

Decision 4. Approve the overflow: when a settlement's land is full, its further growth moves to its neighbours. Without it 75,000 people of the series have nowhere to go by 2070 (Section 6.3).

Where the growth goes once a settlement is full

Ibri Sewer, TE Networks and STP — Design Basis Report | Renardet 2621

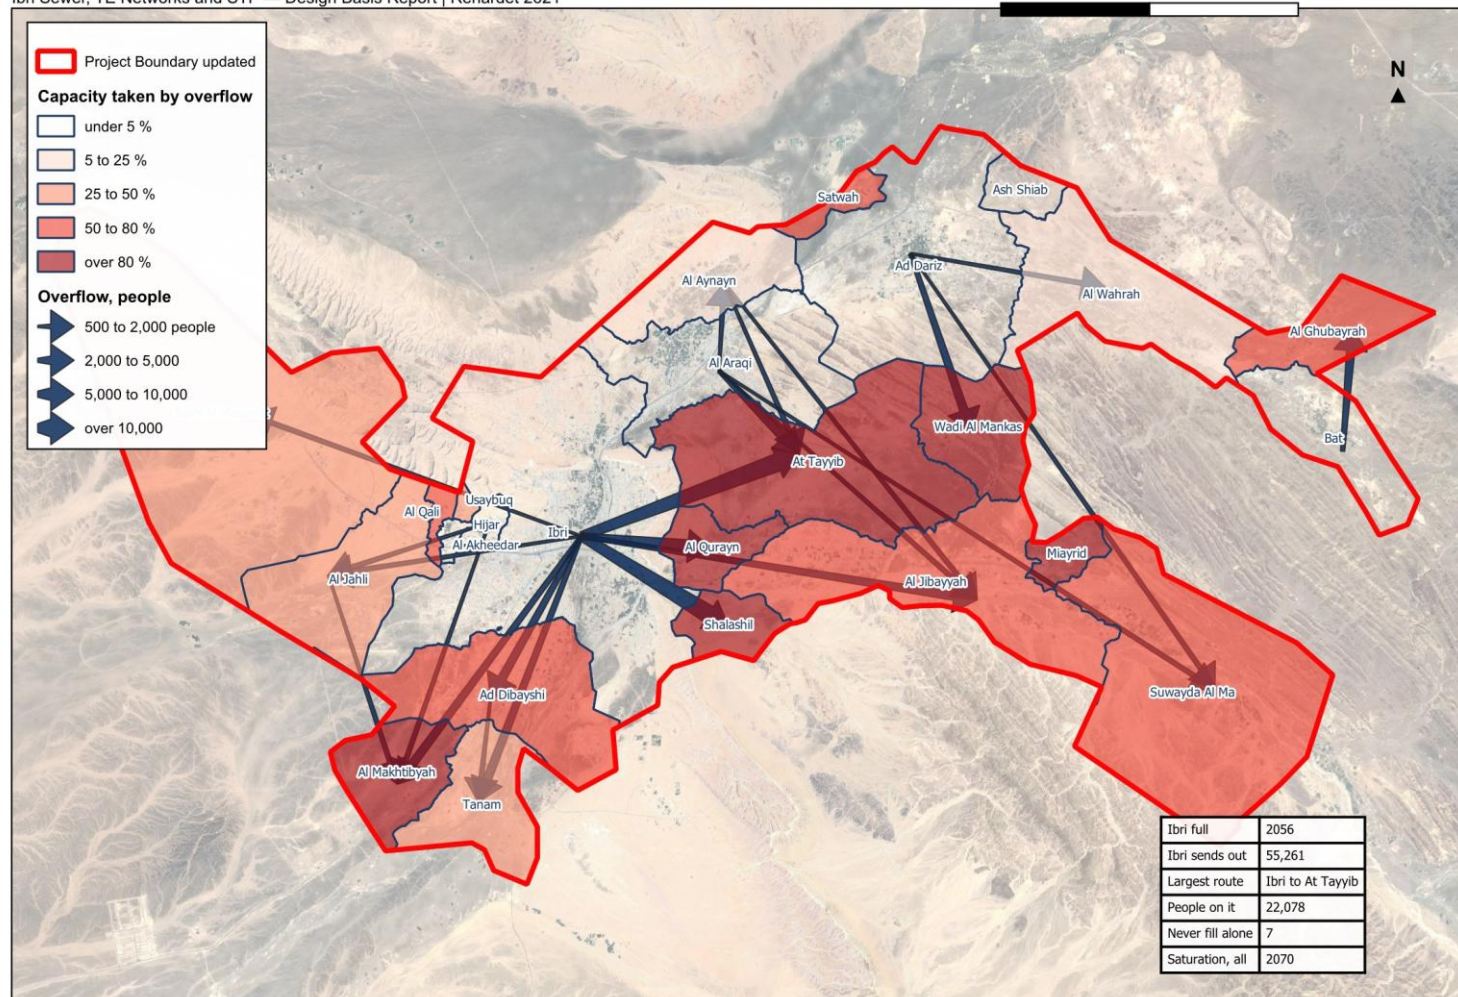


Figure 11 Where the growth goes once a settlement is full. Arrows show the routes carrying five hundred people or more; the shading shows how much of each settlement's capacity is taken by its neighbours' overflow.

6.4. The design horizon: 2055, or the year the land is full

The Terms of Reference name a horizon of completion plus twenty-five years. With the opening year taken as 2030, that is 2055: 244,914 people and 42,266 cubic metres a day. The Terms of Reference also ask for the saturation of the area. With the overflow, Ibri fills in 2056, Al Araqi in 2057, Ad Dariz in 2062, and the last settlement in 2070: 349,029 people and 60,099 cubic metres a day, 42 per cent more than in 2055.¹

The two horizons ask different things of the design. A network sized on 2055 is cheaper to build and reaches its capacity while the plots around it are still being built; the pipes under those streets would then need to be replaced or relieved. A network sized on the year the land is full is laid once, and its sewers run at low flow for longer, which the self-cleansing check of Section 7.3 is there to catch. The treatment plant is staged either way, on the series. The horizon is for Nama Water Services to decide.

Table 10 The study area in the design years

Year	People	Average sewage flow, m ³ /d	What it is
2024	119,893	20,852	today, from the meters
2030	139,535	24,216	opening year
2055	244,914	42,266	opening year plus 25 years
2070	349,029	60,099	saturation: the land is full

Decision 5. Decide the design horizon: 2055, the opening year 2030 plus 25 years, with 244,914 people and 42,266 cubic metres a day; or 2070, the year the land is full, with 349,029 people and 60,099 cubic metres a day (Section 6.4).

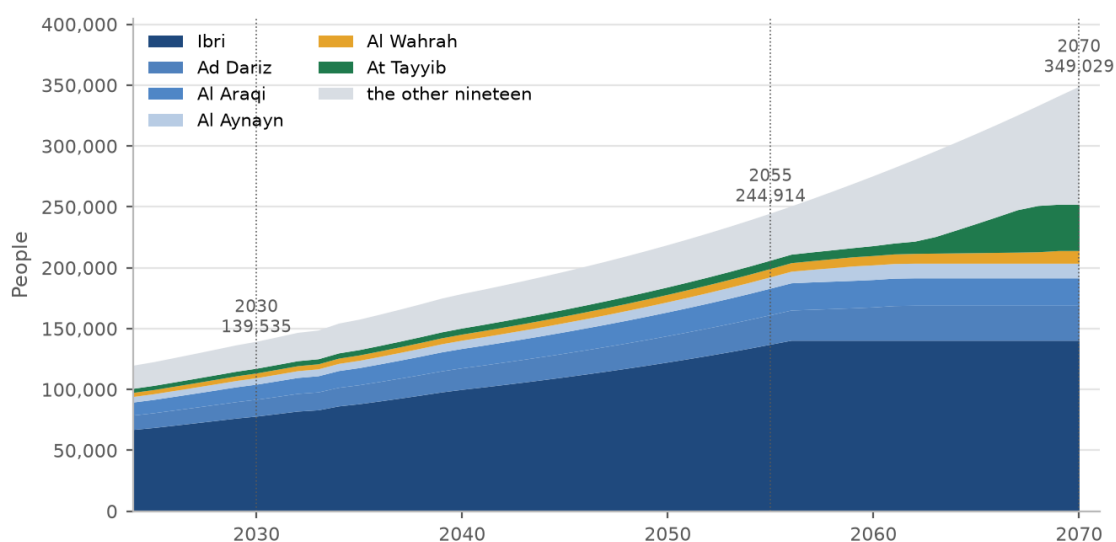


Figure 12 People by year to saturation, the six largest settlements shown separately. The flat top of each band is the year that settlement fills.

The people of every settlement at five-year steps, to the year it is full. A cell is blank once the settlement is full.

¹ Concept Design Report R2, Section 14.7. The five-year series is in the table below.

Table 11 People by settlement at five-year intervals

Settlement	2024	2025	2030	2035	2040	2045	2050	2055	2060	2065	2070	Full in	At saturation
Ibri	67,106	68,713	78,099	88,272	100,066	110,349	122,535	137,198				2056	140,405
Ad Dariz	11,850	12,134	13,791	15,587	17,670	19,486	21,638	24,206	27,350			2062	28,704
Al Araqi	10,696	10,952	12,448	14,069	15,949	17,588	19,531	21,849				2057	22,528
Al Aynayn	4,554	4,663	5,300	5,990	6,791	7,489	8,316	9,303	12,013			2060	12,013
Al Wahrah	3,351	3,431	3,900	4,408	4,997	5,511	6,119	6,845	7,703	8,684	10,460	2070	10,460
At Tayyib	3,348	3,428	3,897	4,404	4,993	5,506	6,114	6,839	8,130	23,972		2068	38,023
Ad Dibayshi	2,724	2,789	3,170	3,583	4,062	4,479	4,974	5,564	6,262			2063	10,644
Al Jibayyah	2,686	2,750	3,126	3,533	4,005	4,416	4,904	5,486	6,174	6,951	13,992	2070	13,992
Bat	2,557	2,618	2,976	3,363	3,813	4,204	4,669					2052	4,783
Tanam	2,116	2,167	2,463	2,784	3,156	3,480	3,864	4,323	4,865	5,961		2069	8,895
Sayh al Masarrat	1,828	1,872	2,127	2,405	2,726	3,006	3,338	3,734	4,202	4,786		2069	6,812
Suwayda al Ma	1,559	1,596	1,814	2,050	2,324	2,563	2,846	3,184	3,583	4,034	7,928	2070	7,928
Hijjar	1,408	1,442	1,639	1,852	2,100	2,315	2,571					2053	2,696
Al Jahli	1,376	1,409	1,601	1,810	2,052	2,263	2,513	2,831	3,746			2063	5,060
Al Ghubayrah	644	659	750	847	960	1,059	1,176	1,756	2,575	3,501	4,584	2070	4,584
Al Qurayn	588	602	684	773	877	967	1,074	1,201	7,176			2060	7,176
Al Akheedar	480	492	559	631								2036	640
Al Makhtibiyah	364	373	424	479	543	599	665	744	837	1,522		2069	4,656
Al Qali	224	229	261	295	410	518	646					2054	788
Shalashil	152	156	177	200	227	250	278	311	8,335			2061	11,852
Satwah	108	111	126	142	161	178	197	221	392			2060	392
Usaybuq	84	86	98	110	125	138	153					2054	224
Ash Shiab	44	45	51	58	66	72	80	90				2056	92
Wadi al Mankas	32	33	37	42	48	53	58	65	74	2,859		2068	5,052
Miayrid	16	16	19	21	24	26	29	33	37	41	632	2070	632
Total	119,893	122,766	139,535	157,710	178,781	197,153	218,926	244,914	275,608	310,307	349,029	2070	349,029

7. The flow each element is designed for

Every plot now carries an average sewage flow for 2024, 2030, 2055 and the saturation year. What each element of the system is designed for follows from those plot flows by fixed rules, set out below element by element. The rules are the same wherever the element sits, so the client can check any one of them.

7.1. The flows by settlement and year

The average sewage flow of every settlement at five-year steps, to the year it is full, before infiltration and before the STP margin. A cell is blank once the settlement is full.

Table 12 Average sewage flow by settlement at five-year intervals, m³/d

Settlement	2024	2025	2030	2035	2040	2045	2050	2055	2060	2065	2070	Full in	At saturation
Ibri	11,494	11,769	13,377	15,119	17,140	18,901	20,988	23,500				2056	24,049
Ad Dariz	2,030	2,078	2,362	2,670	3,027	3,338	3,706	4,146	4,685			2062	4,917
Al Araqi	1,832	1,876	2,132	2,410	2,732	3,013	3,345	3,742				2057	3,859
At Tayyib	800	813	893	980	1,081	1,169	1,273	1,398	1,618	4,332		2068	6,739
Al Aynayn	780	799	908	1,026	1,163	1,283	1,424	1,593	2,058			2060	2,058
Al Wahrah	574	588	668	755	856	944	1,048	1,173	1,320	1,487	1,792	2070	1,792
Ad Dibayshi	481	492	557	628	710	782	866	967	1,087			2063	1,838
Al Jibayyah	460	471	535	605	686	756	840	940	1,057	1,191	2,397	2070	2,397
Bat	438	448	510	576	653	720	800					2052	819
Tanam	419	428	479	534	597	653	719	797	890	1,078		2069	1,580
Sayh al Masarrat	313	321	364	412	467	515	572	640	720	820		2069	1,167
Suwayda al Ma	267	273	311	351	398	439	488	545	614	691	1,358	2070	1,358
Hijar	241	247	281	317	360	397	440					2053	462
Al Jahli	236	241	274	310	351	388	430	485	642			2063	867
Al Ghubayrah	110	113	128	145	165	181	201	301	441	600	785	2070	785
Al Qurayn	101	103	117	133	150	166	184	206	1,229			2060	1,229
Al Akheedar	82	84	96	108								2036	110
Al Makhtibiyah	82	83	92	101	112	122	133	147	163	280		2069	817
Al Qali	38	39	45	51	70	89	111					2054	135
Shalashil	26	27	30	34	39	43	48	53	1,428			2061	2,030
Satwah	19	19	22	24	28	30	34	38	67			2060	67
Usaybuq	14	15	17	19	22	24	26					2054	38
Ash Shiab	8	8	9	10	11	12	14	15				2056	16
Wadi al Mankas	6	6	6	7	8	9	10	11	13	490		2068	865
Miayrid	3	3	3	4	4	5	5	6	6	7	108	2070	108
Total	20,852	21,344	24,216	27,329	30,938	34,085	37,815	42,266	47,523	53,466	60,099	2070	60,099

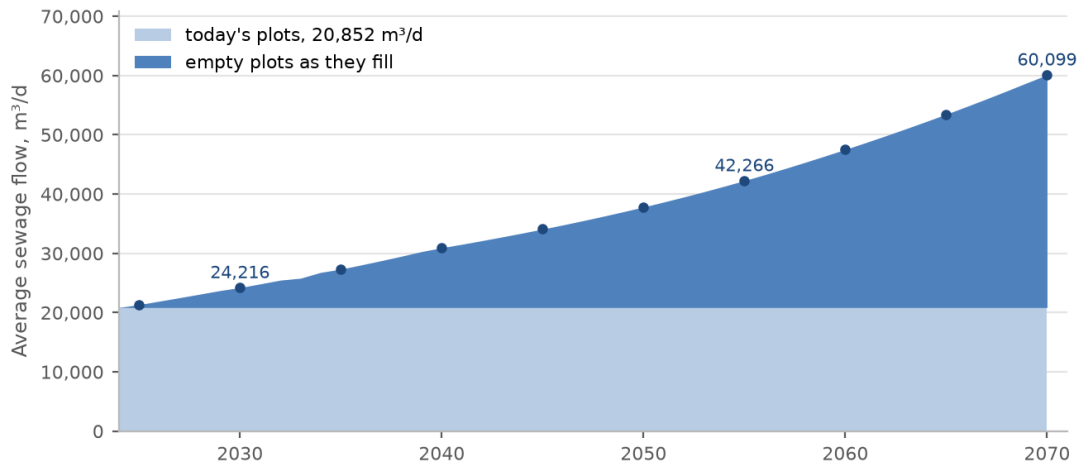


Figure 13 Average sewage flow of the study area by year, from today's plots and from the empty plots as they fill.

7.2. The plot

The plot carries the average flow of its people and meters, and nothing else: no peak, no infiltration, no tankers. Those belong to the pipe and the STP. A new home carries 171.3 litres a day per person; an existing plot carries its own meters at the rates of Section 5.¹

7.3. The pipe

A pipe is checked twice, on two different flows, because the two checks fail in opposite directions.

Size and capacity: the flow at saturation of every plot upstream, added up, peaked, plus infiltration along the pipe. Under-estimating it surcharges the pipe.

Self-cleansing: the flow in 2030 of the plots upstream, with 61 per cent of the properties connected, peaked, and no infiltration. Over-estimating it declares a pipe self-cleansing while it silts.

The 61 per cent is the connection ratio of the Inception Report, reached by 2028. It is never applied to the saturation flow: that would give a pipe in a new district most of its final flow in a year when it carries almost nothing.²

Peak flow belongs to the pipe, not to the plot. Above 100 properties the Merrimack formula applies; at 100 or fewer, the Peltier formula.

$$Q_{\text{peak}} = 2.65Q_{\text{avg}}^{0.879} \quad (6)$$

Merrimack: above 100 properties; both flows in MI/d

Q peak: peak flow: the guideline's peak daily flow, equal to its peak hourly flow, MI/d

Q avg: average flow of the plots upstream, MI/d

$$Q_{\text{peak}} = \left(1.5 + \frac{1}{\sqrt{Q_m}}\right) Q_{\text{avg}} \quad (7)$$

Peltier: at 100 properties or fewer

Q m: the average flow of the plots upstream, l/s

¹ The flow of every plot in 2024, 2030, 2055 and the saturation year is carried in the project's plot layer.

² Whole area: $24,216 \times 0.61 = 14,772 \text{ m}^3/\text{d}$ in 2030, against 36,660 if the ratio were applied to saturation.

The guideline recommends that the hourly peak factor not exceed 5.0. It is a recommendation, applied as such. Infiltration is 720 litres a day per kilometre of new sewer, added along each pipe by its length; stormwater is not considered.¹

Adopted (11). 61 per cent of properties connected in 2030, the Inception Report's ratio, used only for the early-year self-cleansing check (Section 7.3).

Adopted (12). 720 litres a day per kilometre of sewer, added to each pipe and left out of the early-year check; the Merrimack formula above 100 properties and the Peltier formula at 100 or fewer (Section 7.3).

Gradients and self-cleansing at the concept stage

At the concept stage every pipe is laid at the guideline's minimum gradient for its size, rounded up to a step of 0.05 per cent, or 0.025 per cent for trunks of 500 mm and above. The steps are our rounding, so that the gradients are round figures on the drawings. The guideline asks for a second test, the minimum tractive force, and for the steeper of the two gradients to govern. At this stage that test is used only to list the pipes that will need washing in the early years, not to steepen them, because the tractive tension it needs is not given in the guideline. One pascal is used until Nama Water Services confirms a value. That is a departure from the guideline, stated here for approval.²

Table 13 Minimum gradients at the concept stage

Pipe size, mm	200	250	315	400	500	600	700	800	900 and above
Minimum gradient, mm/m	5.00	3.75	2.70	2.05	1.55	1.25	1.00	0.85	0.75

The chart shows what the tractive test asks of a pipe. It is a curve: the smaller the flow, the steeper the pipe must be. A 200 mm pipe at its minimum gradient of 0.5 per cent passes the test at 1.29 l/s and above. Below that, at the very head of a street, no practical gradient passes; those pipes go on the washing list. A design floor is proposed: a pipe carrying less than 1.5 l/s is checked as if it carried 1.5, for which the curve asks 0.47 per cent, so a 200 mm pipe at the Table 11 gradient always passes.³

¹ PAM-GUD-201, Section 7.4.2, pages 71 and 72; Section 7.4.3, page 72. PAM-GUD-203, Table 29, page 65, defines the peak hourly flow and gives it the symbol QPDF.

² PAM-GUD-203, Table 11, page 29; Sections 4.2.2.1 and 4.3, pages 25 to 29. The Mara, Sleigh and Taylor relationship on page 27, $K = 2.33 \times 10^{-4}$ with the flow in m³/s.

³ The full curve with every size is in Appendix A2. The audit on the test area gave 70 per cent of the length as needing early washing, all of it 200 mm pipe carrying under 1.3 l/s.

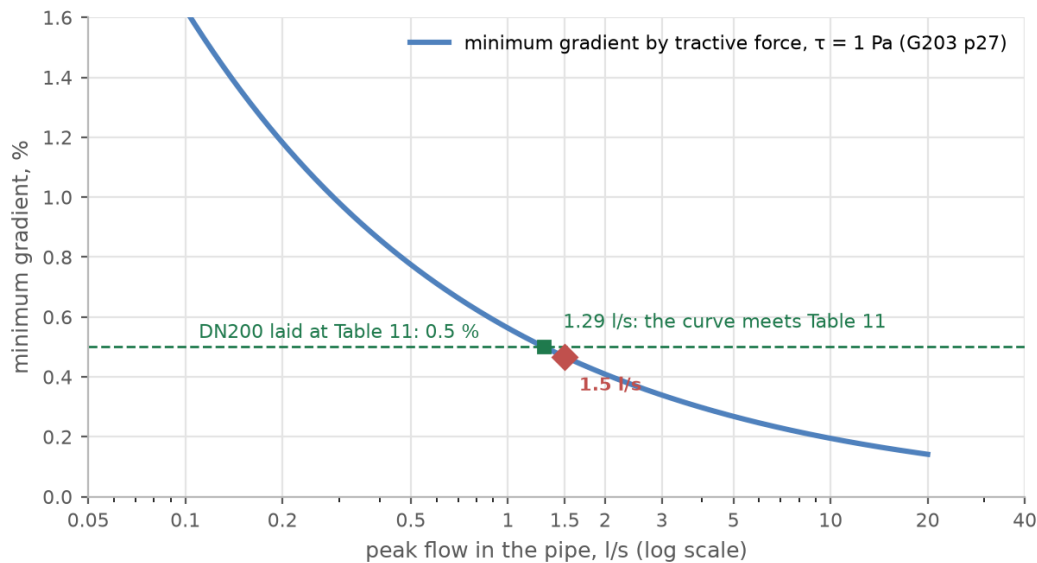


Figure 14 The minimum gradient the tractive-force test asks for, against the flow in the pipe.

Decision 7. Approve the concept-stage rule: pipes laid at the Table 11 minimum gradient rounded up to steps of 0.05 per cent; the tractive-force test at 1 pascal used only to list the pipes needing early washing, with a pipe carrying less than 1.5 l/s checked as if it carried 1.5. The guideline asks for the steeper of the two gradients; this is a departure (Section 7.3).

7.4. The pumping station and its rising main

A gravity sewer goes deeper the further it runs. The guideline recommends about 10 to 12 metres of cover as the point where the cost of excavation justifies a pumping station. That cost cannot be calculated without the detailed quantities, so 12 metres is applied as the limit at this stage: where a sewer would pass it, a station is placed before that point and the sewer restarts at normal cover. The preliminary design looks deeper where the quantities allow the cost to be calculated.¹

The station's duty flow is the peak flow of the catchment it drains plus the infiltration of its sewers, at saturation. The rising main is sized on that duty: at least 0.75 metres a second, 1.0 where the pumps start and stop, and at most 2.5 metres a second.²

Adopted (13). 12 metres of cover is the limit at the concept stage, with a pumping station before that point; the preliminary design looks deeper where the quantities allow the cost to be calculated (Section 7.4).

7.5. The trunk sewers and the treatment plant

The trunk sewers and the STP carry the sum of the settlements upstream. The STP is sized on three flows, and the guideline names what each one sizes: the average annual flow for the biological treatment, with the load; the peak hourly flow for everything the flow passes through; and the maximum day flow, which the guideline defines but gives no factor for.³

¹ PAM-GUD-203, Section 4.6.3, page 33.

² PAM-GUD-203, Section 8.1, page 50. Which chamber the main discharges into, and whether neighbouring stations are joined, are layout decisions of the concept design.

³ PAM-GUD-203, Table 29, page 65, and Section 10.2.2.1, page 66.

$$Q_{AAF} = 1.10(Q_{avg} + Q_{inf}) \quad Q_{PHF} = 1.10(Q_{peak} + Q_{inf}) \quad (8)$$

Q_{AAF} : average annual flow, the design average of the STP, m³/d

Q_{PHF} : peak hourly flow, for the structures the flow passes through, m³/d

Q_{avg} , Q_{peak} : average flow of the settlements upstream, and its Merrimack peak, m³/d

Q_{inf} : infiltration of the whole network upstream, 720 l/d per km, m³/d

1.10: the 10 per cent margin the guideline requires for a new STP, over and above any standby

If the whole study area drains to one STP, the flows are as in the table. The network has not yet been laid over the whole area, so its infiltration cannot be totalled; each 100 kilometres of new sewer adds 79 cubic metres a day with the margin. Tanker deliveries are added when their records arrive. The maximum day flow is read from a year of daily records at the existing STP, requested in Section 9.¹

Table 14 Flows at one STP for the whole area, before infiltration and tankers, m³/d

Flow	2024	2030	2055	2070
People	119,893	139,535	244,914	349,029
Average flow from the plots	20,852	24,216	42,266	60,099
Peak flow before the margin	38,263	43,639	71,202	97,022
Merrimack peak factor	1.83	1.80	1.68	1.61
Average annual flow with the margin	22,937	26,638	46,492	66,109
Peak hourly flow with the margin	42,089	48,003	78,322	106,724
Infiltration with the margin, to add to both	0.79 m ³ /d per km of sewer			
Maximum day flow	from the existing STP's records			

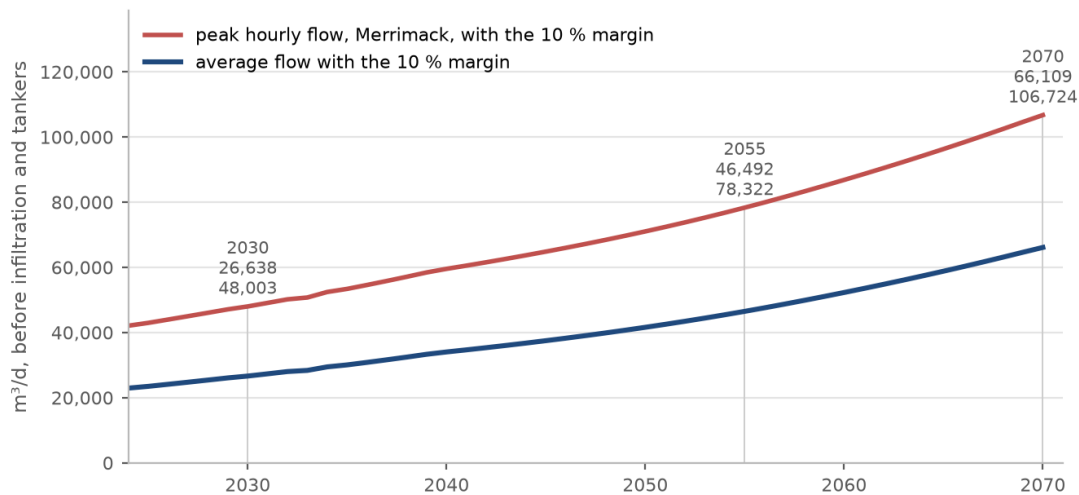


Figure 15 Average and peak-hour flow at one STP for the whole area, by year, with the margin.

The map on the next page gives every settlement's average flow in 2055 and at saturation, and the four steps to an STP flow, so that any grouping of settlements into one or more plants can be calculated by hand. The table below carries the same values.

¹ PAM-GUD-201, Section 7.4.5, page 73, the margin. The margin is applied to the peak as to the average; the guideline does not state the order, and this reading is for confirmation.

Table 15 Average sewage flow by settlement in 2055 and at saturation, m³/d

Settlement	2055	2070, saturation	Share in 2055, %
Ibri	23,500	24,049	55.6
Ad Dariz	4,146	4,917	9.8
Al Araqi	3,742	3,859	8.9
Al Aynayn	1,593	2,058	3.8
At Tayyib	1,398	6,739	3.3
Al Wahrah	1,173	1,792	2.8
Ad Dibayshi	967	1,838	2.3
Al Jibayyah	940	2,397	2.2
Bat	819	819	1.9
Tanam	797	1,580	1.9
Sayh al Masarrat	640	1,167	1.5
Suwayda al Ma	545	1,358	1.3
Al Jahli	485	867	1.1
Hijar	462	462	1.1
Al Ghubayrah	301	785	0.7
Al Qurayn	206	1,229	0.5
Al Makhtibyah	147	817	0.3
Al Qali	135	135	0.3
Al Akheedar	110	110	0.3
Shalashil	53	2,030	0.1
Usaybuq	38	38	0.1
Satwah	38	67	0.1
Ash Shiab	15	16	0.0
Wadi al Mankas	11	865	0.0
Miayrid	6	108	0.0
Total	42,266	60,099	100

Adopted (14). The average annual flow and the peak hourly flow with the 10 per cent margin as the guideline defines them; 60 grams of BOD and 80 grams of suspended solids per person per day, the guideline's minimum, until the laboratory data of the existing STP are received; the maximum day flow from that plant's records (Sections 7.5 and 7.6).

Average sewage flow of each settlement in 2055 and at saturation, 2070

Ibri Sewer, TE Networks and STP — Design Basis Report | Renardet 2621

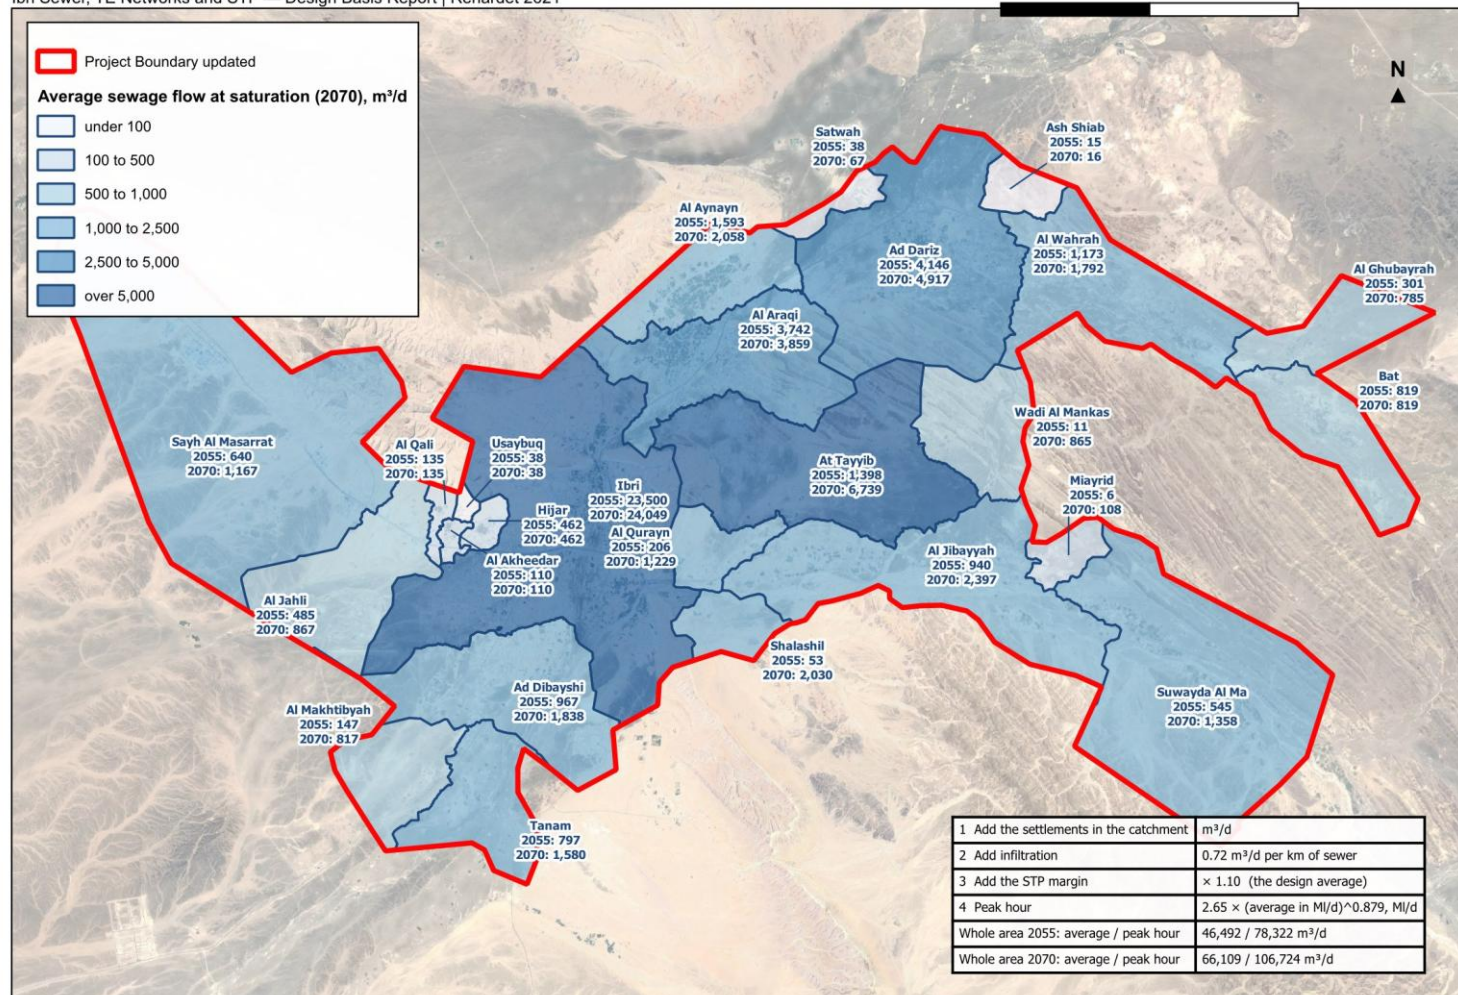


Figure 16 Average sewage flow of each settlement in 2055 and at saturation, and the four steps from the settlements in a catchment to the flow of their STP.

7.6. The load on the treatment plant

The biological treatment is sized on the load, not only the flow. No laboratory data for Ibri's sewage is held. The guideline sets a minimum for a new STP: 60 grams of BOD and 80 grams of suspended solids per person per day. At the flows above that is 348 milligrams of BOD per litre at saturation, at the low end of the range the guideline gives for raw sewage, 350 to 400. The per-person loads are used until the laboratory results of the existing STP are received, and the sewage brought by tanker, which is far stronger, is provided for separately once its records arrive.¹

Table 16 Loads at one STP for the whole area, from the per-person minima

	2024	2030	2055	2070
People	119,893	139,535	244,914	349,029
BOD, kg/d	7,194	8,372	14,695	20,942
Suspended solids, kg/d	9,591	11,163	19,593	27,922
BOD as a concentration at the average flow, mg/l	345	346	348	348
Suspended solids as a concentration, mg/l	460	461	464	465
BOD at the peak factor of 1.2, kg/d	8,632	10,047	17,634	25,130

Table 17 Raw sewage strength the guideline gives, for the network and for tankers, mg/l

Parameter	Network sewage	Sewage by tanker, average to maximum
BOD	350 to 400	350 to 1,050
COD	700 to 900	1,350 to 5,000
Suspended solids	400 to 500	900 to 4,300
Total Kjeldahl nitrogen	60 to 80	115 to 265
Ammonia as nitrogen	40 to 50	70 to 125
Total phosphorus	10 to 15	16 to 35

7.7. Sewage other than domestic

Sewage from industry and commerce, called trade effluent in the guidelines, affects the STP's load and how treatable the sewage is. Where its chemical to biochemical oxygen demand is above the domestic range, a separate line is needed if the volume is significant. In Ibri the two industrial estates are workshops on the commercial tariff; no wet industry has been found. The estates are carried at the dry-industry rate (Section 5.3), and no separate line is foreseen at this stage. A central slaughterhouse has been announced without a site; it will need pre-treatment and is added when sited.²

7.8. Treated effluent

Treated effluent is produced at 95 per cent of the STP inflow, and a further 10 per cent is lost in the treated effluent distribution network, so 85.5 per cent of the inflow reaches the customers. The customers, their demand and its seasonal pattern are being identified and will be presented in the concept design.³

¹ PAM-GUD-203, Section 10.3.1, page 74, "at least 60 g of BOD5 per capita per day and 80 g of suspended solids"; Table 30, page 67; Table 31, page 68, tankered sewage at 350 to 1,050 mg/l BOD. Peak factors for the aeration design at a large STP: 1.2 on BOD and COD, 1.5 on TKN (page 74).

² PAM-GUD-203, page 74: a COD to BOD ratio of 1.8 to 2.2 is typical of domestic sewage.

³ PAM-GUD-201, Section 7.4.6.1, page 73, and Section 7.4.6.3 (b), page 76: "a system loss of 10 percent of all produced TSE shall be assumed".

Table 18 Treated effluent available, one STP for the whole area, m³/d

	2024	2030	2055	2070
STP inflow, design average	22,937	26,638	46,492	66,109
Produced, 95 per cent	21,790	25,306	44,168	62,803
Delivered, less 10 per cent in the network	19,611	22,776	39,751	56,523

Adopted (15). 95 per cent of the STP inflow produced as treated effluent and 10 per cent of it lost in the distribution network (Section 7.8).

8. Every adopted value in one table

The values below are the ones the design rests on. Where a value is the guideline's, its page is given. Where it is a choice of this design, the reason is given and the value is marked as such.

Table 19 Adopted values and assumptions

Value	Adopted	Why	Source
Domestic water use	164 l per person per day	the published value for Adh Dhahirah	G201 Table 11, p60
Shops and offices	22 % of domestic	the distributed ratio for the governorate	G201 Table 11, p60
Government	14 % of domestic	the distributed ratio; unit rates need quantities not held	G201 Table 11, p60; §7.3.3, p61
Return to the sewer	85 % domestic and tanker; 54 % the rest	the published discharge ratios	G201 Table 19, p71
Farm meters	no sewage	they feed irrigation pumps; the house on a farm is metered separately	design rule
Industrial estates	4,500 and 1,800 workers at 93 l/d	no record supplied; from the meter count	assumption; G201 Table 12, p61
Persons per property	per settlement; floor 4.0; cap 6.12	institutional housing distorts the low ones; the cap is the highest large settlement	design rule; G201 §7.2, p59
Settlements under 1,000 people	4.0, one property per plot, home share 0.9	too few meters to measure on	design rule
Future home plot	200 to 1,000 m ² , compact	the shape of the built home plots	design rule
Where the growth is placed	all empty plots up to 2,000 m ² , by area capped at 1,000 m ²	the sewer serves every plot on its street	design rule
New home	171.3 l of sewage per person per day	$164 \times 0.85 + 36 \times 0.54 + 23 \times 0.54$	G201 Tables 11 and 19
Growth rates	the Inception Report series	the official forecast and its extension; used for rates only	Inception Report R0; Decision 6
Overflow	a full settlement's growth moves to its neighbours	the land, not the series, sets the population	design rule; Decision 4
Design horizon	2055, or saturation in 2070	opening year plus 25, or the year the last settlement fills	TOR; Decision 5
Connection in 2030	61 % of properties	the Inception Report ratio; used in the self-cleansing check only	Inception Report R0
Infiltration	720 l/d per km, per pipe; none in the early-year check	new networks	G201 §7.4.3, p72
Peak flow	Merrimack above 100 properties; Peltier at or below	the guideline's formulae	G201 §7.4.2, p71 to 72
Hourly peak factor ceiling	5.0, a recommendation	not applied silently	G201 p72
Minimum gradients	Table 11, rounded up to 0.05 % steps; 0.025 % for trunks	round figures on the drawings	G203 Table 11, p29; Decision 7
Tractive tension	1 Pa; a 1.5 l/s floor	no value in the guideline; for washing lists only at this stage	G203 p27; Decision 7
Self-cleansing velocity	0.75 m/s at peak flow, 0.90 preferred	the guideline	G203 p26
Depth of cover	12 m at the concept stage; a station before it	the excavation cost needs the detailed quantities	G203 §4.6.3, p33
Rising main velocity	0.75 to 2.5 m/s; 1.0 for start-stop pumping	the guideline	G203 §8.1, p50
STP margin	10 % on average and peak	new plants	G201 §7.4.5, p73
STP loads	60 g BOD, 80 g solids per person per day	the guideline minimum; no laboratory data held	G203 §10.3.1, p74
Treated effluent	95 % produced; 10 % lost in the network	the guideline	G201 p73, p76
Tanker water, private wells	not in any flow	no records held; requested	G201 §7.4, p70; §7.3.5, p61

9. Data requested

Seven items would improve or confirm the numbers in this report. None of them stops the concept design; each replaces an assumption with a record.

Table 20 Data requests

Item	What is asked for	Why
Tanker water and sewage tankers	Filling-station volumes by area and sewage tanker deliveries to the STP, with their source	Water supplied by tanker is not in any flow. It can only raise the loads.
Private wells	Any record of private abstraction inside the study area	The guideline requires it to be assessed. Not held.
Existing STP records	Daily inflow and the laboratory results for the Ibri STP, three years	Sets the maximum day flow and checks the per-person loads.
Industrial estates	Workforce and water use of the Al Tayyeb and Tanam estates	Replaces the assumed 4,500 and 1,800 workers.
Army camp	Occupancy and drainage arrangement of the camp west of the town	296 hectares with no meter in the dataset.
Ibri View	The development plan of the resort at As Sulayf	Two square kilometres announced; no load carried until the plan is issued.
Non-domestic quantities	Pupils, beds, employees and floor areas by plot, where held	Would allow the unit rates of the guideline in place of the ratios.

10. Decisions requested, and values adopted

Part A lists the 7 points that need a decision from Nama Water Services; each can be answered with a yes, a no, or one figure, and a no returns the report to the section named. Part B lists the values adopted from the guidelines and the stated assumptions, for information.

A. For approval

Settlements and people

1. **Settlement boundaries.** Approve the twenty-five settlement boundaries redrawn so that every plot lies in one settlement and there are no gaps between them (Section 2).
2. **Persons per property.** Approve the persons per property calculated for each settlement, with the floor of 4.0, the cap of 6.12 and the rule for settlements under a thousand people (Section 3).
3. **Use of each plot.** Approve the use determined for each plot from the meters and the satellite image, in place of the cadastre's own land-use field, as the basis for placing the loads (Section 4).

Growth

4. **The overflow.** Approve the overflow: when a settlement's land is full, its further growth moves to its neighbours. Without it 75,000 people of the series have nowhere to go by 2070 (Section 6.3).
5. **The design horizon.** Decide the design horizon: 2055, the opening year 2030 plus 25 years, with 244,914 people and 42,266 cubic metres a day; or 2070, the year the land is full, with 349,029 people and 60,099 cubic metres a day (Section 6.4).
6. **The growth beyond 2050.** Approve the extension of the population series beyond 2050: the rise to 2.40 per cent a year by 2058 and that rate held to 2100. The series to 2050 is the client's own (Section 6.2).

The network

7. **Gradients and self-cleansing at the concept stage.** Approve the concept-stage rule: pipes laid at the Table 11 minimum gradient rounded up to steps of 0.05 per cent; the tractive-force test at 1 pascal used only to list the pipes needing early washing, with a pipe carrying less than 1.5 l/s checked as if it carried 1.5. The guideline asks for the steeper of the two gradients; this is a departure (Section 7.3).

B. Adopted, for information

Settlements and people

8. **The 126 meters with no plot within 15 metres.** They are left out of the plot loads: about 140 people (Section 3.3).

Water and sewage rates

9. **Water demand and return.** 164 litres per person per day, plus 22 per cent for shops and offices and 14 per cent for government, the values the guideline publishes for Adh Dhahirah; 85 per cent of domestic and tanker supply and 54 per cent of the rest return to the sewer. The published ratios are used in place of the unit rates per pupil, bed, employee and floor area until those quantities are held (Section 5).
10. **The industrial estates.** 4,500 workers at Al Tayyeb and 1,800 at Tanam at 93 litres a day each, an assumption to be replaced by the estates' records when received (Section 5.3).

Growth

11. **The connection ratio.** 61 per cent of properties connected in 2030, the Inception Report's ratio, used only for the early-year self-cleansing check (Section 7.3).

The network

12. **Infiltration and peak flow.** 720 litres a day per kilometre of sewer, added to each pipe and left out of the early-year check; the Merrimack formula above 100 properties and the Peltier formula at 100 or fewer (Section 7.3).
13. **Depth.** 12 metres of cover is the limit at the concept stage, with a pumping station before that point; the preliminary design looks deeper where the quantities allow the cost to be calculated (Section 7.4).

The plant and the effluent

14. **STP flows and loads.** The average annual flow and the peak hourly flow with the 10 per cent margin as the guideline defines them; 60 grams of BOD and 80 grams of suspended solids per person per day, the guideline's minimum, until the laboratory data of the existing STP are received; the maximum day flow from that plant's records (Sections 7.5 and 7.6).
15. **Treated effluent.** 95 per cent of the STP inflow produced as treated effluent and 10 per cent of it lost in the distribution network (Section 7.8).

Appendix A1. Capacity and the overflow routes

Table 21 Capacity of the empty land by settlement

Settlement	Empty plots	of which home-shaped and counted	Home share	Properties per plot	Persons per property	Capacity, people
Ibri	14,203	10,469	0.87	1.33	6.07	73,299
Ad Dariz	4,888	3,219	0.90	1.20	4.86	16,854
Al Araqi	3,360	2,463	0.84	1.32	4.34	11,832
Al Aynayn	1,780	1,362	0.94	1.14	5.12	7,459
Al Wahrah	2,000	1,373	0.91	1.22	4.68	7,109
At Tayyib	10,012	8,640	0.92	1.09	4.02	34,675
Al Jibayyah	2,784	1,966	0.89	1.26	5.13	11,306
Bat	879	355	0.88	1.17	6.12	2,226
Ad Dibayshi	2,430	1,887	0.90	1.16	4.00	7,920
Tanam	2,045	1,556	0.67	1.24	5.25	6,779
Suwayda al Ma	1,593	937	0.82	1.60	5.18	6,369
Hijar	375	211	0.90	1.69	4.00	1,288
Al Ghubayrah	1,448	1,094	0.90	1.00	4.00	3,940
Al Qurayn	2,051	1,830	0.90	1.00	4.00	6,588
Sayh al Masarrat	1,745	1,384	0.90	1.00	4.00	4,984
Al Jahli	1,235	1,023	0.90	1.00	4.00	3,684
Satwah	181	79	0.90	1.00	4.00	284
Al Akheedar	120	45	0.90	1.00	4.00	160
Al Qali	220	157	0.90	1.00	4.00	564
Shalashil	3,686	3,250	0.90	1.00	4.00	11,700
Al Makhtibyah	1,523	1,192	0.90	1.00	4.00	4,292
Usaybuq	60	39	0.90	1.00	4.00	140
Wadi al Mankas	1,580	1,394	0.90	1.00	4.00	5,020
Ash Shiab	65	13	0.90	1.00	4.00	48
Miayrid	246	171	0.90	1.00	4.00	616
Total	60,509	46,109				229,136

Table 22 The overflow routes carrying fifty people or more at saturation

From	To	People at saturation	Donor full	Receiver starts	Receiver full
Ibri	At Tayyib	22,078	2056	2060	2068
Ibri	Shalashil	11,471	2056	2056	2061
Ibri	Al Qurayn	5,856	2056	2056	2060
Ad Dariz	Wadi al Mankas	4,965	2062	2062	2068
Al Araqi	At Tayyib	4,873	2057	2060	2068
Ibri	Ad Dibayshi	4,078	2056	2062	2063
Ibri	Al Jibayyah	3,927	2056	2068	2070
Bat	Al Ghubayrah	2,493	2052	2052	2070
Ibri	Al Makhtibyah	2,441	2056	2063	2069
Ibri	Tanam	2,010	2056	2063	2069
Al Araqi	Al Aynayn	1,790	2057	2057	2060
Al Aynayn	At Tayyib	1,639	2060	2060	2068

From	To	People at saturation	Donor full	Receiver starts	Receiver full
Al Araqi	Al Jibayyah	1,410	2057	2068	2070
Ibri	Sayh al Masarrat	1,225	2056	2063	2069
Ad Dibayshi	Tanam	1,004	2063	2063	2069
Ibri	Al Jahli	915	2056	2054	2063
Ad Dariz	Al Wahrah	863	2062	2062	2070
Al Araqi	Suwayda al Ma	730	2057	2070	2070
Al Aynayn	Al Jibayyah	600	2060	2068	2070
Ad Dariz	Suwayda al Ma	551	2062	2070	2070
Hijar	Al Makhtibyah	519	2053	2063	2069
Hijar	Al Jahli	518	2053	2054	2063
Al Jahli	Al Makhtibyah	507	2063	2063	2069
Ibri	Suwayda al Ma	490	2056	2070	2070
At Tayyib	Miayrid	441	2068	2068	2070
Ibri	Ad Dariz	440	2056	2057	2062
Al Aynayn	Ad Dariz	347	2060	2057	2062
Al Aynayn	Suwayda al Ma	311	2060	2070	2070
Al Akheedar	Al Qali	297	2036	2036	2054
Ad Dariz	Al Ghubayrah	258	2062	2052	2070
Al Qurayn	At Tayyib	244	2060	2060	2068
At Tayyib	Suwayda al Ma	229	2068	2070	2070
Al Wahrah	Suwayda al Ma	229	2070	2070	2070
Ad Dibayshi	Suwayda al Ma	186	2063	2070	2070
Al Jibayyah	Suwayda al Ma	183	2070	2070	2070
Ad Dibayshi	Sayh al Masarrat	182	2063	2063	2069
Al Akheedar	Al Makhtibyah	177	2036	2063	2069
Al Akheedar	Al Jahli	176	2036	2054	2063
Bat	Suwayda al Ma	175	2052	2070	2070
Ibri	Al Araqi	163	2056	2056	2057
Al Aynayn	Satwah	150	2060	2060	2060
Tanam	Suwayda al Ma	145	2069	2070	2070
Ibri	Miayrid	141	2056	2068	2070
Tanam	Sayh al Masarrat	141	2069	2063	2069
Sayh al Masarrat	Suwayda al Ma	125	2069	2070	2070
Al Qali	Al Jahli	103	2054	2054	2063
Hijar	Al Jibayyah	94	2053	2068	2070
Al Jahli	Al Jibayyah	92	2063	2068	2070
Al Qali	Sayh al Masarrat	83	2054	2063	2069
Al Qurayn	Al Jibayyah	78	2060	2068	2070
Hijar	Ibri	66	2053	2054	2056
Shalashil	At Tayyib	63	2061	2060	2068
Hijar	Usaybuq	60	2053	2053	2054
Hijar	Al Qali	54	2053	2036	2054
Sayh al Masarrat	Al Jibayyah	52	2069	2068	2070

Appendix A2. The tractive-force curve in full

The same curve as in Section 7.3, with every pipe size's minimum gradient marked where it meets the curve, three readings on the steep part, and the 1.5 l/s floor.

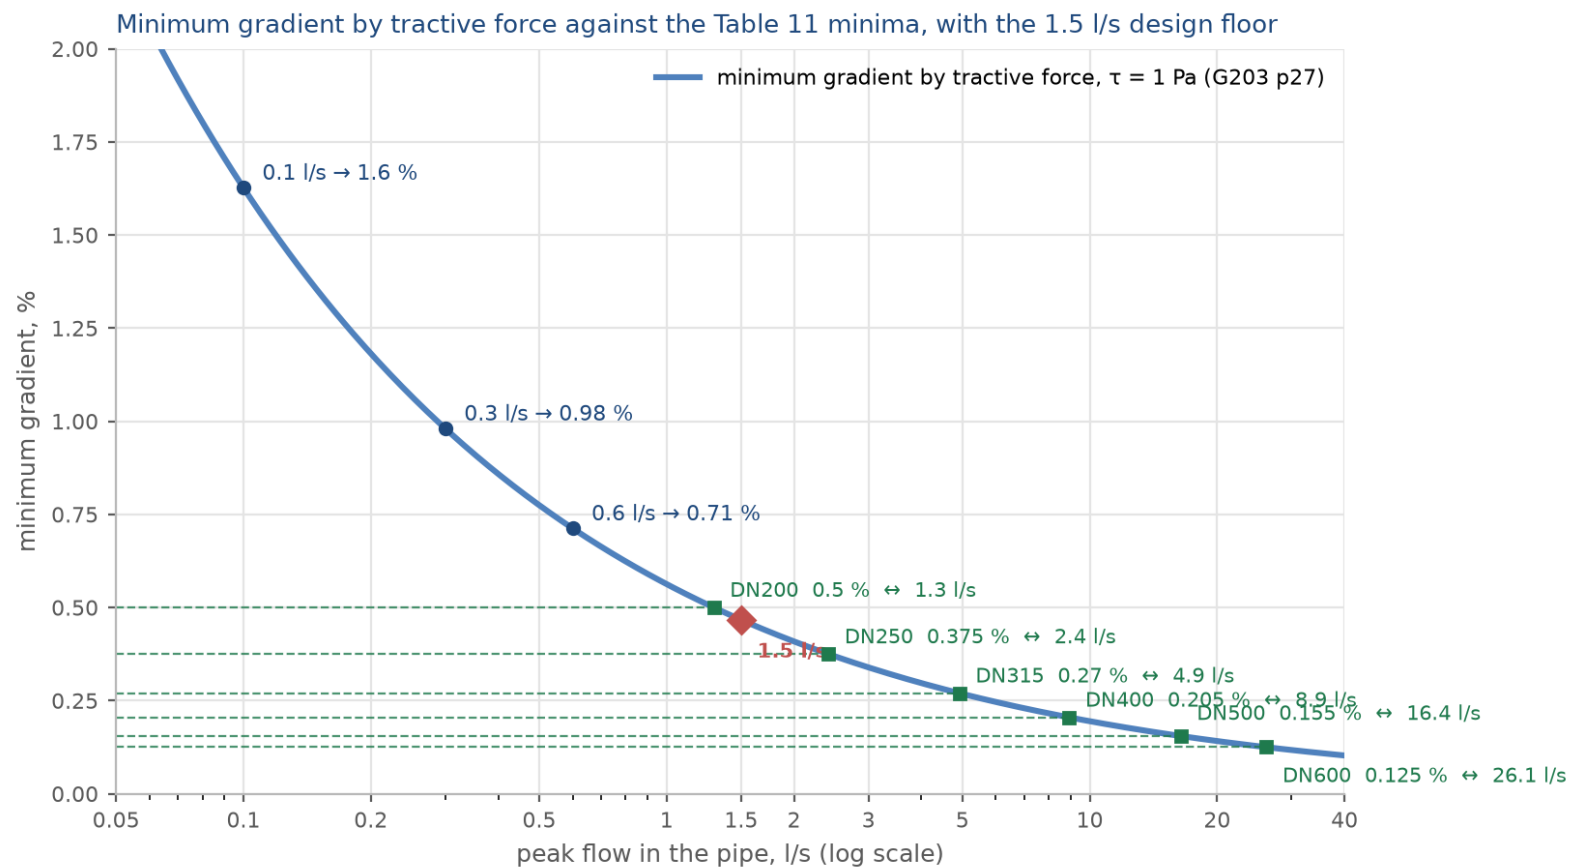


Figure 17 The minimum gradient by tractive force at one pascal, the Table 11 minima of every size, and the 1.5 l/s floor.