

Sultanate of Oman
Nama Water Services Company SAOC

**Consultancy Services for Design and Supervision for STP, Sewer and TE Networks
Systems in Ibri**

Tender No. T/2719110/2025

Concept Design — Methodology, Equations and Workflows

Tutorial T03

A working reference for every calculation the Concept Design Report requires: what each step is for, how it is done, which equation applies, what every symbol means, and which page of which guideline it comes from.

Renardet S.A. & Partners
Project 2621 · Revision 0 · August 2026

Contents

Contents	2
How to use this document	5
Reading paths	5
How each section is built	5
Three conventions worth knowing before you start	5
Abbreviations	5
Executive summary	7
The chain, in twelve steps	7
The spine of the calculation	8
The numbers that govern Ibri	8
Six things that are easy to get wrong	8
Where the guidelines cannot be relied on	9
3 Preparing the data	11
3.1 Purpose	11
3.2 What the source data does and does not contain	11
3.3 Method	11
3.4 Mapping tariffs to consumption categories	12
Agricultural plots	12
Cost Reflective Tariff	12
4 Population	13
4.1 Purpose	13
4.2 The three permitted routes	13
4.3 Population from plots	13
4.4 Occupancy rate	14
4.5 Disaggregation and extrapolation	14
5 Water demand	15
5.1 Purpose	15
5.2 The five components	15
5.3 Domestic demand	15
How the figure was derived	16
5.4 Non-domestic and governmental — the two tiers	16
If Table 12 is ever used	16
5.5 Tanker demand	16
6 Wastewater generation	18
6.1 Purpose	18
6.2 Return rates	18

6.3	Non-network water sources	18
6.4	The alternative route where land use is detailed	18
7	Projecting through time.....	19
7.1	Purpose.....	19
7.2	Interval.....	19
7.3	Connection ratio	19
7.4	Saturation	19
8	Peak flow and infiltration	20
8.1	Purpose.....	20
8.2	Merrimack.....	20
8.3	Peltier, the master plan alternative.....	20
8.4	The cap on hourly peak factor	20
8.5	Infiltration.....	21
8.6	Assembling the design flow	21
9	Gravity sewer design	22
9.1	Purpose.....	22
9.2	Which formula	22
	Manning, where it is used	22
9.3	Velocity and depth of flow.....	23
9.4	Tractive force.....	23
9.5	Minimum gradients	24
9.6	Cover, depth and manholes.....	24
9.7	Lengths and materials.....	25
10	Lifting stations and force mains.....	26
10.1	Purpose.....	26
10.2	When a station is required	26
10.3	Station classification	26
10.4	Wet well volume.....	27
10.5	Suction conditions	27
10.6	Force mains.....	27
10.7	Surge	28
10.8	Emergency provision	28
11	Treatment plant sizing and phasing.....	29
11.1	Purpose.....	29
11.2	Size categories, and why they matter.....	29
11.3	Design horizon and margin	30
11.4	Influent characterisation	30

Tankered sewage is far stronger	30
11.5 Load, and an equation the guideline does not print	30
11.6 Process sizing.....	31
11.7 Land area	31
11.8 Effluent quality	31
11.9 Siting and buffer	32
12 Treated effluent.....	33
12.1 How much is produced	33
12.2 Who takes it.....	33
12.3 How much each needs.....	33
12.4 Seasonality and sizing	33
13 Sludge	34
13.1 Purpose.....	34
13.2 How much.....	34
13.3 Where it goes.....	34
14 Options and appraisal	36
14.1 How many options, and of what kind.....	36
14.2 The appraisal parameters	36
14.3 Net present value	36
14.4 Operating cost	37
14.5 Carbon	37
14.6 Choosing	37
14.7 Cost accuracy and value engineering	37
15 Where the guidelines cannot be relied on	39
15.1 Formulae that do not exist in the guidelines.....	39
15.2 A mandatory method that cannot be completed.....	39
15.3 Errors of substance	39
15.4 Cross-references that do not resolve	40
15.5 What to do about all this	40

How to use this document

This is a reference, not a report. It is written to be opened at the point of need: when a step of the concept design has to be carried out and the question is what exactly to calculate, with what, and on whose authority.

Reading paths

If you want to...	Read
Understand the whole chain in twenty minutes	The executive summary that follows, and nothing else
Carry out one calculation correctly	The section for that step. Each is self-contained
Check a number before it goes to the client	The equation, then its source page in the guideline itself
Know where the guidelines are wrong or silent	Section 15, and the caution boxes throughout

How each section is built

Every calculation section follows the same five parts, so the document can be navigated by shape rather than by memory.

- **Purpose** — why the step exists and what it feeds
- **Method** — how it is done, in order
- **Equation** — as a native Word equation, numbered
- **Parameters** — every symbol, its meaning and its unit
- **Source** — guideline and page, so any figure can be checked at source

Three conventions worth knowing before you start

Nothing here is quoted from memory. Every equation in this document was read from the guideline page itself, rendered as an image, because the text layer of the PDFs mangles fraction bars, roots and exponents. Three equations exist in the guidelines only as pictures and cannot be found by searching the text at all.

Where a formula is not NWS's, it says so. Several formulae every engineer expects to find — net present value, life cycle cost, total dynamic head, pump power, Darcy-Weisbach and Hazen-Williams in written form — do not appear anywhere in the three guidelines. Each is attributed here to its actual source. Citing NWS for them would be a fabricated reference.

Where the guideline is wrong, it is reproduced and flagged. The guidelines contain errors — a dimensionally impossible flow equation, a peak-factor formula that differs from the published original, a tanker ratio that cannot be arithmetically true. This document prints what the guideline prints, then says plainly what is wrong with it. It does not silently correct the client's own standard.

Abbreviations

Term	Meaning
AAF	Average Annual Flow, the daily volume averaged over a year
Qadf	Average daily flow — the same quantity, the guideline's symbol
MDF	Maximum Day Flow
PHF / Qpdf	Peak Hour Flow, and peak daily flow
Pf	Peak factor, the ratio converting an average flow to a peak flow
LPCD	Litres per capita per day
OR	Occupancy rate, persons per housing unit

d/D	Proportional depth — flow depth divided by pipe diameter
SRT	Solids retention time, also called sludge age
TN	Total nitrogen
OU	Odour unit; 1 OU/m ³ is the concentration half a panel can detect
DS	Dry solids
NCSI	National Centre for Statistics and Information
MoHUP	Ministry of Housing and Urban Planning
APSR	Authority for Public Services Regulation
G201 / G202 / G203	PAM-GUD-201 General Design, -202 Water and TSE, -203 Wastewater, all Revision 01 of March 2026

One term to be careful with. In G201 and G203, TE means Trade Effluent and TSE means Treated Sewage Effluent. This project, the TOR and the tender all use TE to mean treated effluent. Wherever this document says TSE it means the treated product of the STP. Say so explicitly in anything sent to NWS, or a guideline-literate reviewer will read a trade effluent network into the report.

Executive summary

The concept design turns a population into a set of pipe diameters, a plant capacity and a phasing plan. This document sets out how, in twelve steps, and fixes every number to a page of a guideline. What follows is the whole chain in short form. Anyone who reads only these few pages should be able to do the work and know where to look when a detail is needed.

The chain, in twelve steps

#	Step	What comes out	Section
1	Prepare the data	A clean plot layer with counted properties and a land use for each	3
2	Population	People, per settlement, per year	4
3	Water demand	Litres per day, by consumption category	5
4	Wastewater generation	The flow that reaches the sewer	6
5	Project through time	A flow for every year to saturation	7
6	Peak and infiltration	The flow the pipe is actually sized on	8
7	Gravity network	Diameters, gradients, depths, manholes	9
8	Lifting stations	Where gravity fails, and what pumps it	10
9	STP sizing and phasing	Plant capacity, by phase	11
10	Treated effluent	How much is produced, and who takes it	12
11	Sludge	How much, and where it goes	13
12	Options and appraisal	Three options, costed, and a recommendation	14

The concept design calculation chain

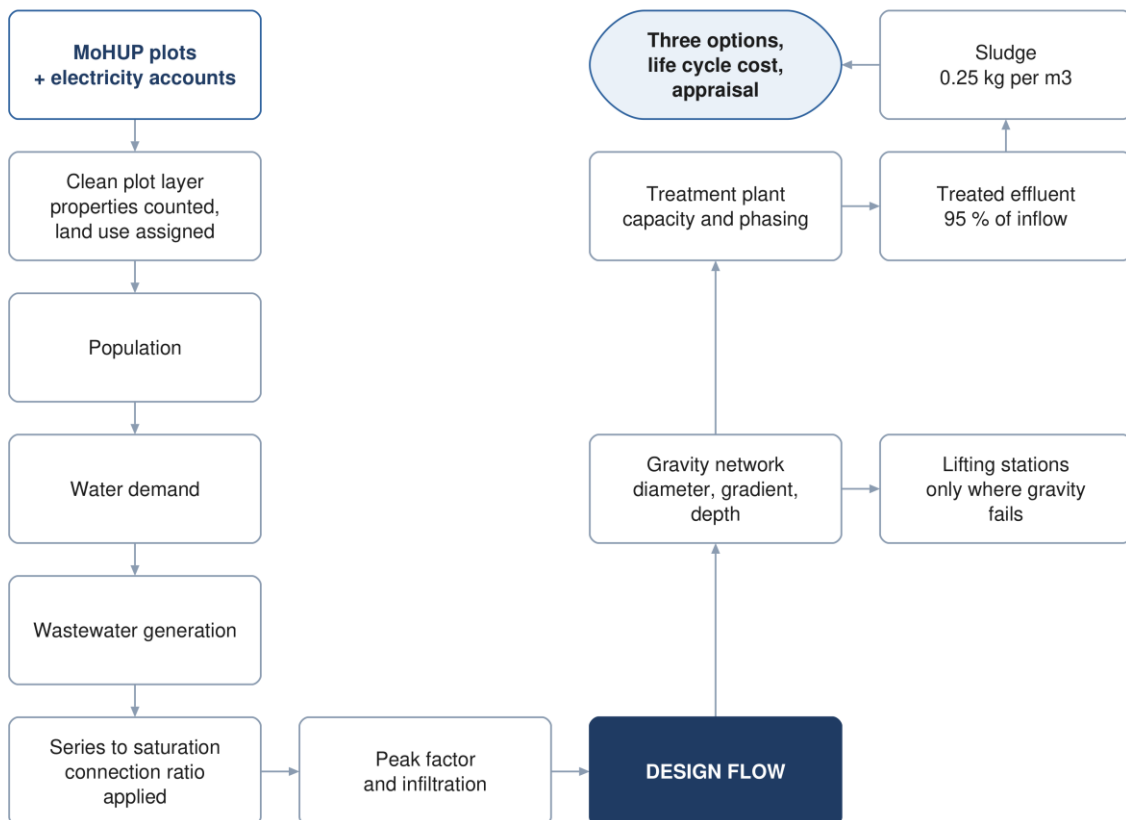


Figure 1 The concept design calculation chain. The left column establishes the flow; the right sizes the works.

Steps 1 to 6 are one continuous calculation: each is the input to the next, and an error early on propagates the whole way. Steps 7 to 11 consume that flow independently of one another. Step 12 sits across all of them.

The spine of the calculation

Stripped of detail, the flow chain is four multiplications and two additions. Everything else is refinement.

$$\text{Population} = \text{Plots} \times \text{Properties per plot} \times \text{OR} \quad (1)$$

$$Q_{\text{demand}} = \text{Population} \times \text{LPCD} \times (1 + 0.22 + 0.14) \quad (2)$$

$$Q_{\text{adf}} = Q_{\text{dom}} \times 0.85 + Q_{\text{ND}} \times 0.54 + Q_{\text{inf}} \quad (3)$$

$$Q_{\text{design}} = Q_{\text{adf}} \times \text{Pf} \quad (4)$$

The 22 % and 14 % are the non-domestic and governmental uplifts for Adh Dhahirah. The 85 % and 54 % are the proportions of supplied water that come back as sewage. The peak factor comes from Merrimack. Each is traced to its page in the sections that follow.

The numbers that govern Ibri

Quantity	Value	Where it comes from
Domestic consumption	164 l/c/d	G201 Table 11, Adh Dhahirah
Non-domestic uplift	22 % of domestic	G201 Table 11
Governmental uplift	14 % of domestic	G201 Table 11
Return to sewer, domestic and tanker	85 %	G201 Table 19
Return to sewer, non-domestic	54 %	G201 Table 19
Infiltration, new networks	720 l/d per km of sewer	G201 p72
Peak factor	Merrimack, over 100 properties	G201 p71
Minimum self-cleansing velocity	0.75 m/s at peak flow	G203 p26
Maximum velocity	3 m/s	G203 p27
Flow depth at peak	0.65 up to 350 mm, 0.50 above	G203 Table 10
Minimum cover	1.3 m to pipe crown	G203 p33
Recommended maximum cover	approximately 10–12 m	G203 p33
STP design margin	10 %	G201 p73
TSE produced	95 % of plant inflow	G201 p73
TSE network loss	10 % of TSE produced	G201 p76
Sludge	0.25 kg per m ³ of inflow	G201 p78
Total nitrogen in the effluent	below 15 mg/l as N	G203 p71
Design horizon	at least 15 years for the STP; 25 years for appraisal	G203 p65, G201 p57

Six things that are easy to get wrong

These are the places where a correct-looking calculation gives a wrong answer. Each is explained where it arises.

Merrimack runs in megalitres per day. The formula has an exponent of 0.879, so feeding it cubic metres instead of megalitres does not scale the answer — it produces a different number entirely. Peltier, on the facing page, wants litres per second. The general peak-factor equation between them is in cubic metres per day.

The minimum gradient table is a full-bore table. Its gradients deliver 0.75 m/s when the pipe runs full. The guideline separately requires 0.75 m/s at peak flow. A pipe over 350 mm laid at the table minimum sits exactly on the limit at its design depth, and every pipe falls below it in the opening years.

The depth rule is a recommendation about cover. Ten to twelve metres is not a limit and does not refer to invert depth. What triggers a pumping station is excavation cost becoming prohibitive, and the guideline attaches no depth figure to that.

Tankered water still becomes sewage. Water delivered by truck returns to the sewer at the same 85 % as piped water. Leaving it out understates the load, and in this governorate the tankered volume is large.

Accuracy points in opposite directions. For pipe and plant capacity, under-estimating is the danger. For the self-cleansing and washing schedule, over-estimating is the danger, because it declares the pipes self-scouring while they silt. One population figure cannot serve both.

Table 12 and the percentage uplifts are alternatives. Applying unit rates to commercial plots and then adding the 22 % and 14 % counts the same water twice. Use one or the other.

Where the guidelines cannot be relied on

Three categories, each handled in full in Section 15.

Formulae that are not there. Net present value, life cycle cost, carbon footprint, multi-criteria scoring, total dynamic head, pump power, and both friction equations in written form. The guidelines name them and tabulate their coefficients but never write them. They are attributed here to ISO 15686-5, the GHG Protocol, Metcalf and Eddy, or standard hydraulics.

A mandatory method that cannot be executed. The tractive force check is required, and the required value of shear stress in pascals appears nowhere in either guideline. Any value used has to come from outside and be agreed with NWS.

Twenty-eight printing and arithmetic defects. Including a flow equation that divides where it should multiply, a peak-factor formula that differs from its published original, and a tanker ratio that cannot be true. All are listed with their page numbers.

3 Preparing the data

3.1 Purpose

Every later number rests on knowing how many properties sit on each plot and what each one is used for. The cadastral data does not say. This step builds that layer, and it is the only step whose output is a dataset rather than a number.

3.2 What the source data does and does not contain

The plot layer from MoHUP carries geometry. It does not distinguish developed from undeveloped plots, it is missing plots that exist on the ground, and it carries no land use and no count of dwellings.

The electricity account layer supplies what is missing — but only partly, and the limit matters. It carries a tariff name and a coordinate. It carries no land use, no floor area, and no consumption figure. It can therefore say what kind of customer sits at a point and how many there are. It can never say how large that customer is.

This single limitation decides the demand method. GUD-201 Table 12 prices non-domestic demand in pupils, beds, employees and square metres of floor area. None of those quantities exists in any dataset held for this project. The percentage-uplift route is therefore the one in use, and Table 12 is adopted on the day real quantities are supplied. See Section 5.4.

Building the plot layer from electricity accounts

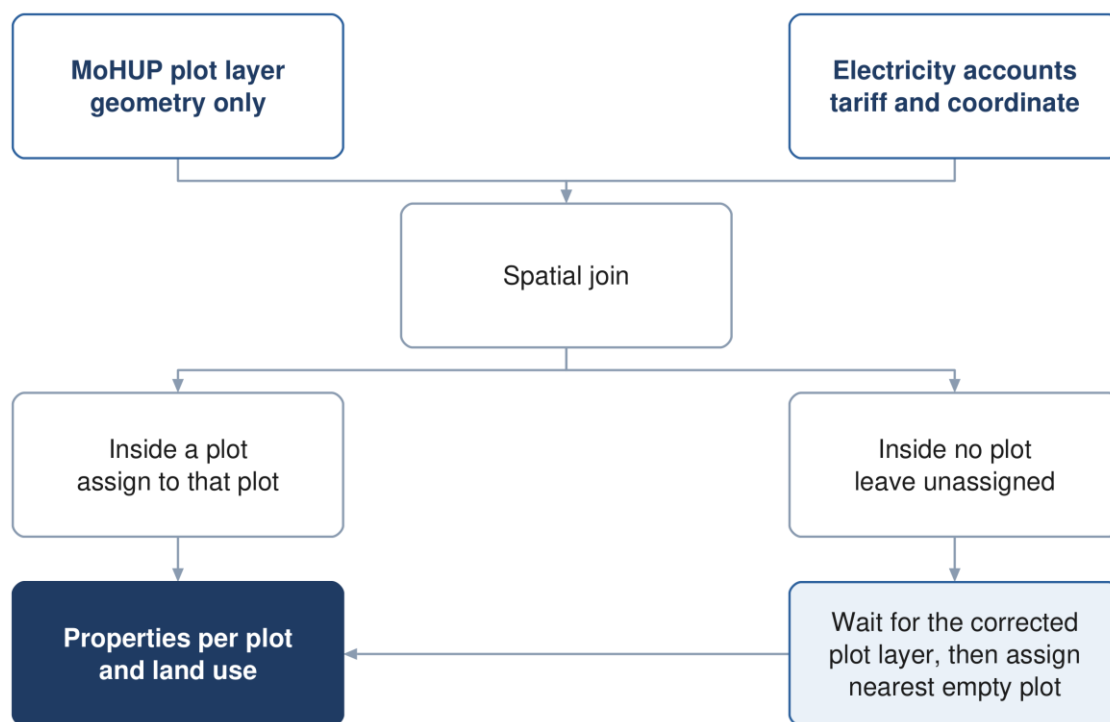


Figure 2 Building the plot layer. Points matching no plot wait for the corrected cadastre rather than being moved first.

3.3 Method

1. Points sharing an identical coordinate are stacked properties at one address, and are counted individually.
2. Points falling inside a plot belong to that plot, whatever their spacing.

3. Points falling inside no plot are left unassigned until the corrected plot layer is available. Only then are any remaining orphans moved to the nearest plot that holds none.
4. Each tariff is mapped to one consumption category. The mapping is an inference and is recorded as one.

Assign orphan points last, not first. Moving a point to a neighbouring plot moves load between streets and changes the pipe sizes on both. Many unmatched points will land naturally once the missing plots are digitised, so shifting before that step manufactures errors that the corrected data would have avoided.

3.4 Mapping tariffs to consumption categories

The electricity file names a tariff. The guideline names a consumption category. The crosswalk between them is the following, and it is ours rather than NWS's.

Table 1 Electricity tariff to guideline consumption category

Tariff as issued	Category	Treatment
Primary Account	Domestic	one dwelling
Primary Account with National Subsidy	Domestic	one dwelling
Additional Account	Domestic	a separate dwelling on the same plot
Commercial, Fisheries, Tourism	Non-domestic	carries the uplift volume
Government, MOD	Governmental	carries the uplift volume
Agricultural	No sewage load	an irrigation pump — see below
Cost Reflective Tariff (CRT)	Unresolved	a size class, not a land use
Industrial	Case by case	excluded from the uplift ratios by G201 p59

Agricultural plots

An agricultural meter powers a borehole pump. The water it lifts goes onto a field and never reaches a sewer. Where a dwelling stands on a farm plot it carries its own domestic account, which is counted normally. The test is therefore whether the plot holds a domestic meter, not whether it holds an agricultural one.

- **Rule** — an agricultural meter on a plot that already holds a domestic meter adds nothing
- **Rule** — an agricultural-only plot carries no dwelling

Cost Reflective Tariff

CRT is a consumption-threshold tariff, applied to large consumers and billed at unsubsidised rates. It says a customer is big; it does not say what the customer is. A shopping centre, a factory, a hotel and a large government building all fall into it. These accounts are therefore both the most significant consumers and the only ones the tariff cannot classify. They must be resolved against the plot layer or by site inspection before any uplift ratio is applied.

Source: G201 §7.3 p59-61 for the consumption categories; the tariff crosswalk is a project inference recorded in the concept report's inference register.

4 Population

4.1 Purpose

Population drives every flow in the chain. The guideline permits three routes to it, and the choice between them is not free: they answer different questions and are used for different parts of the design.

4.2 The three permitted routes

Route	Basis	What it is good for
Developer figures	supplied directly	takes precedence where they exist
NCSI projection	official census series	populations at dated years
Plot count	plots × properties × occupancy	the saturation ceiling

The two routes used here answer different questions. The census projection says how many people there will be in a given year. The plot count says how many there can ever be. Buried pipe, which lasts fifty years and cannot be economically re-laid, is sized on the ceiling. The plant, which is built in phases, is sized on the dated years.

Two routes to population, and what each is for

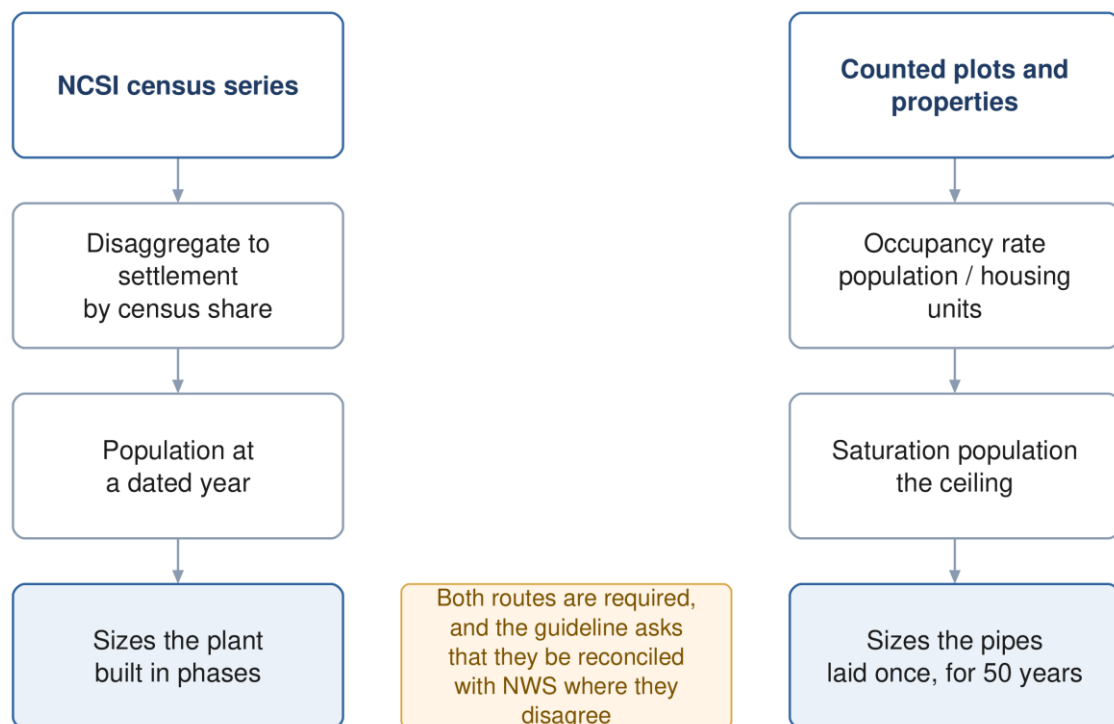


Figure 3 Two routes to population. The census route dates the plant; the plot route sizes the pipe.

4.3 Population from plots

$$\text{Population} = N_{\text{plots}} \times p \times \text{OR} \quad (5)$$

Symbol	Meaning	Unit
N plots	number of plots, classified by clear typologies	count
p	average number of properties per plot	dimensionless

OR	occupancy rate, persons per housing unit	persons per unit
----	--	------------------

Source: G201 §7.2.2 p58.

4.4 Occupancy rate

$$OR = \frac{\text{Population}}{\text{Housing units}} \quad (6)$$

The guideline requires both terms to come from NCSI, at the geographic scale of the project, using the most recent data.

A declared departure. NCSI does not publish housing units at settlement level. This project therefore counts properties from active domestic electricity accounts instead. The guideline itself uses active domestic accounts in its own derivation of consumption per capita, which supports the substitution — but it remains a departure and must be stated as one and agreed with NWS.

Two conditions make the result meaningful. Both halves of the fraction must describe the same ground: a wilayat population divided by the meters of one town gives a household size that is too large purely because people were kept and houses discarded. And only domestic accounts belong in the denominator, since a shop is not a dwelling.

Source: G201 §7.2.2 p58; the account-based derivation follows the form of the consumption formula at G201 p60.

4.5 Disaggregation and extrapolation

Where a forecast exists only at wilayat level it must be distributed to settlements in proportion to the latest census shares. Below settlement scale, the guideline directs distribution pro rata to the number of electricity accounts.

The extrapolation ceiling. NCSI forecasts run twenty to twenty-five years. Beyond that the guideline permits polynomial regression but states that it is not recommended to extrapolate more than ten years past the forecast period. A projection reaching decades beyond the underlying data is an assumption presented as a number, and any capacity argument resting on it should be defended on land availability instead.

The guideline also requires that build-out be phased. Raw plot count multiplied by occupancy assumes every plot is developed at once, which the NOTE at G201 p59 expressly warns against — it requires development percentages to be applied over the design period, particularly to avoid overestimation.

Source: G201 §7.2.1 p58, and the NOTE at p59.

5 Water demand

5.1 Purpose

Wastewater is derived from water demand, so demand is calculated first even though the project is a sewerage scheme. Demand has five components, and three of them are commonly forgotten.

5.2 The five components

Component	Basis	Clause
Domestic	population × litres per capita per day	§7.3.1
Non-domestic	22 % uplift, or Table 12 unit rates	§7.3.2
Governmental	14 % uplift, or project-specific	§7.3.3
Special	developer-supplied; labour camps, thirsty industry	§7.3.4
Blue tankers	from tanker filling station records	§7.3.5

The last two sit outside the percentage uplifts and are added separately. The guideline is explicit that special consumption is not covered by population forecasts, and that the uplift ratios do not apply to identified projects such as economic zones, which are determined case by case.

Assembling water demand, and choosing the tier

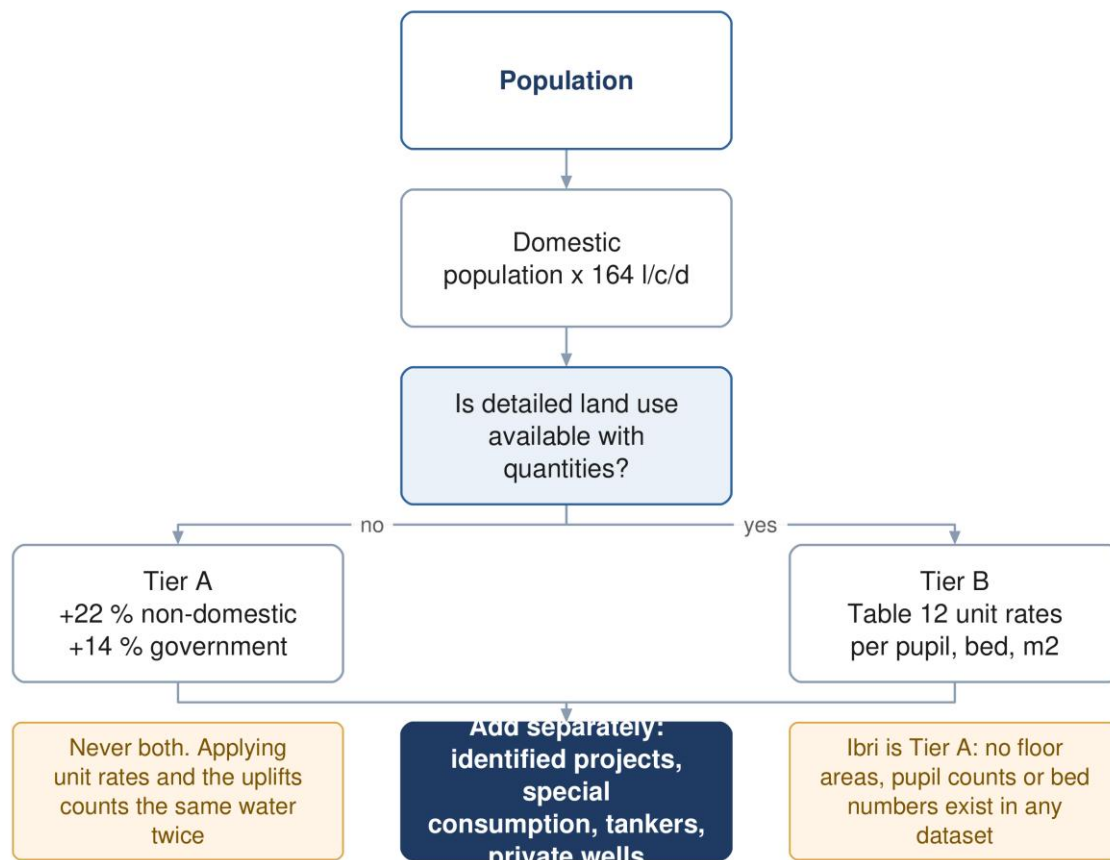


Figure 4 Assembling demand, and the point at which the tier is decided.

5.3 Domestic demand

$$Q_{\text{dom}} = \text{Population} \times \text{LPCD} \quad (7)$$

Symbol	Meaning	Unit
Q dom	domestic water demand	litres per day
LPCD	unit consumption; 164 for Adh Dhahirah	l/c/d

The 164 figure is indicative, derived from the 2024 Integrated Master Plan, applies in the absence of updated figures, and the guideline states it should be validated by NWS before design. It measures network-accounted water only, so it excludes tanker deliveries and private wells.

How the figure was derived

$$LPCD = \frac{\text{Total domestic water accounted}}{OR \times \text{Active domestic accounts}} \quad (8)$$

This is shown because it explains what the number is, not because it is a routine design step. Note that occupancy rate appears in the denominator: raising it lowers the consumption per capita, so the two move together and cannot be chosen independently.

Source: G201 §7.3.1 p59-60 and Table 11.

5.4 Non-domestic and governmental — the two tiers

The guideline offers two routes, and the choice is not a matter of preference.

	Tier A — ratios	Tier B — Table 12
When	in the absence of detailed land use allocation	where detailed land use allocation exists
Method	22 % and 14 % of domestic demand	unit rates per pupil, bed, employee, m ²
Wording	the published fallback	"shall be calculated using"
Needs	population only	counts of pupils, beds, staff, and floor areas

$$Q_{ND} = Q_{dom} \times 0.22 \quad (9)$$

$$Q_{gov} = Q_{dom} \times 0.14 \quad (10)$$

The word to notice in the table heading is Distributed. These are not per-person demands. They are the governorate's measured non-domestic and governmental volumes, taken from the 2021 to 2023 water balance and spread across the population for convenience. That is why the total is right and the distribution is not: a residential-only street generates no commercial flow at all.

Never apply both routes. Table 12 unit rates on commercial plots plus the 22 % and 14 % uplifts counts the same water twice. Use one or the other. Whichever is used, identified projects, special consumption, tankers and private wells remain additive — the guideline excludes those from the ratios by name, so adding them is not double counting.

If Table 12 is ever used

Its rates are keyed to occupancy of the built area, never to plot area. Substituting cadastral area is wrong by an order of magnitude: 121 hectares of mosque plots at the mosque rate of 185 litres per square metre per day would produce roughly four times the entire ultimate flow of the scheme.

Source: G201 §7.3.2 p60, §7.3.3 p61, Table 11 p60 and Table 12 p61.

5.5 Tanker demand

Where a tanker filling station lies within or near the project area, tanker consumption must be explicitly assessed from NWS station records — historical use, the area served, and how that is expected to change over the horizon — and validated by NWS.

The published governorate ratio does not reconcile. Table 13 gives Adh Dhahirah a tanker volume of 5,145 m³/d and a ratio to networked domestic consumption of 333 %. Those two figures together imply the governorate's entire piped domestic consumption is about 1,545 m³/d, which at 164 l/c/d serves roughly 9,400 people. Ibri wilayat alone has many times that. The volume column of the table sums correctly to its printed total, so the volumes are sound and the ratio is not. It cannot be corrected from the document and should be raised with NWS.

Source: G201 §7.3.5 p61-62 and Table 13 p62.

6 Wastewater generation

6.1 Purpose

Not all supplied water returns to the sewer. Irrigation evaporates, process water is consumed, some is lost. The return rate converts demand into the flow the pipe actually receives.

6.2 Return rates

The guideline gives two rates, and only two. Governmental consumption is folded into the non-domestic figure rather than carrying its own.

Table 2 Return ratio, as a percentage of drinking water demand

Type of consumption	Discharge ratio
Domestic and tanker	85 %
Non-domestic, including government and commercial	54 %

$$Q_{ww} = 0.85Q_{\text{dom+tank}} + 0.54Q_{\text{ND+gov}} \quad (11)$$

Symbol	Meaning	Unit
Q _{ww}	wastewater generated, before infiltration	m ³ /d
Q _{dom+tank}	domestic demand plus tanker deliveries	m ³ /d
Q _{ND+gov}	non-domestic plus governmental demand	m ³ /d

Tankered water generates sewage. The 85 % applies to domestic and tanker together. Water that arrives by truck is drunk, washed with and flushed exactly as piped water is; the delivery method changes nothing downstream. Omitting it understates the load, and in this governorate the tankered volume is substantial.

6.3 Non-network water sources

The guideline places a binding duty on the designer to assess other water sources within the project area — private wells, private water providers and other non-network abstraction — so that their contribution to wastewater is accounted for. No rate is given. The assessment has to be made and the assumption declared.

Source: G201 §7.4 p70, §7.4.1 p70-71 and Table 19 p71.

6.4 The alternative route where land use is detailed

Where detailed land use information exists, the guideline requires design flows to be calculated to a recognised international standard such as BS EN 752, with the standard used clearly stated and supported by site-specific evidence. This is the wastewater-side counterpart of the Table 12 switch on the demand side, and it is governed by the same condition.

Source: G201 §7.4.1 p71.

7 Projecting through time

7.1 Purpose

A single ultimate flow sizes the pipes but says nothing about when the plant must be built, or how long the network will run at a fraction of its design flow. Both answers come from a year-by-year series.

7.2 Interval

The TOR requires population forecasting and flow projection at five-year intervals. Calculate annually and report at five-year steps: the finer series costs nothing extra and is needed for the self-cleansing assessment, which turns on the earliest years rather than on any reporting milestone.

7.3 Connection ratio

Population is not the same as connected population. A new network fills gradually as properties are joined to it, and until they are, the flow is a fraction of what the population implies.

$$Q_{\text{year}} = P_{\text{year}} \times c_{\text{year}} \times q \quad (12)$$

Symbol	Meaning	Unit
P year	population in that year	persons
c year	connection ratio, connected divided by total population	fraction
q	wastewater generated per person	m ³ /person/day

The connection ratio is what makes the washing schedule answerable. It is the reason early-year flows are low enough to leave solids in the pipe. Leave it out and the network appears to reach self-cleansing velocity on the day it opens, which it does not.

7.4 Saturation

Two different meanings are in circulation and they must not be confused in the same document.

- **Development ceiling** — the year the last developable plot is built out. A property of the land.
- **Capacity trigger** — the year a particular asset reaches its capacity. A property of the design.

The first bounds the second. Where a projection carries population past the ceiling, the surplus has nowhere to live and the projection has left the physical world — which is the practical form of the extrapolation limit in Section 4.5.

8 Peak flow and infiltration

8.1 Purpose

Sewers are not sized on average flow. They are sized on the peak, plus whatever groundwater leaks in through the joints.

8.2 Merrimack

For any catchment or sub-catchment of more than one hundred properties, the guideline states that the Merrimack formula is to be used. It gives no method for smaller catchments.

$$Q_{pdf} = 2.65Q_{adf}^{0.879} \quad (13)$$

Symbol	Meaning	Unit
Q pdf	peak daily flow	ML/day
Q adf	average daily flow	ML/day

Both flows are in megalitres per day. Because the exponent is 0.879 and not 1, feeding this formula cubic metres per day does not merely scale the answer — it returns a different number. One megalitre per day is one thousand cubic metres per day. This is the single most common error in the whole chain.

$$Pf = \frac{Q_{pdf}}{Q_{adf}} \quad (14)$$

8.3 Peltier, the master plan alternative

The guideline also records the method used in the 2024 Integrated Master Plan. It is described rather than mandated, and Merrimack carries the obligatory wording.

$$Pf_{ww} = 1.5 + \frac{1}{\sqrt{Q_m}} \quad (15)$$

Symbol	Meaning	Unit
Pf ww	wastewater peak factor	dimensionless
Q m	average daily flow	litres per second

This formula differs from the published Peltier relation. The classical form carries 2.5 in the numerator; the guideline prints 1. This was confirmed three separate ways — a high-resolution render of the page, a coordinate-level dump of the text showing a single raised glyph, and the text layer itself. The guideline as issued prints 1, and that is what is reproduced here. Whether NWS intended the classical form is a question for NWS. In practice it changes nothing for this project, because Merrimack is the mandated route.

Note also that Merrimack wants megalitres per day and Peltier wants litres per second, on facing pages, using symbols the abbreviation list defines identically.

8.4 The cap on hourly peak factor

The guideline states that it is recommended the hourly peak factor should not exceed 5.0. The wording is doubly hedged and is not an obligation. Truncating a small headworks at 5.0 without saying so hides a real peak.

8.5 Infiltration

Accounting for infiltration is mandatory. The three values themselves are recommendations, and they do not share a common basis — two are proportions of flow and one is a rate per length of pipe, so they are not interchangeable.

Table 3 Infiltration allowances

Case	Allowance
Existing network in a groundwater zone or coastal area	up to 40 % of wastewater flow
Existing network inland, outside groundwater influence	10 % of wastewater flow
Newly designed network	720 litres per day per km of sewer

Stormwater infiltration is expressly not considered, and tanker or vacuum collection carries no infiltration allowance at all.

Source: G201 §7.4.2 p71-72 and §7.4.3 p72.

From demand to the flow the pipe is sized on

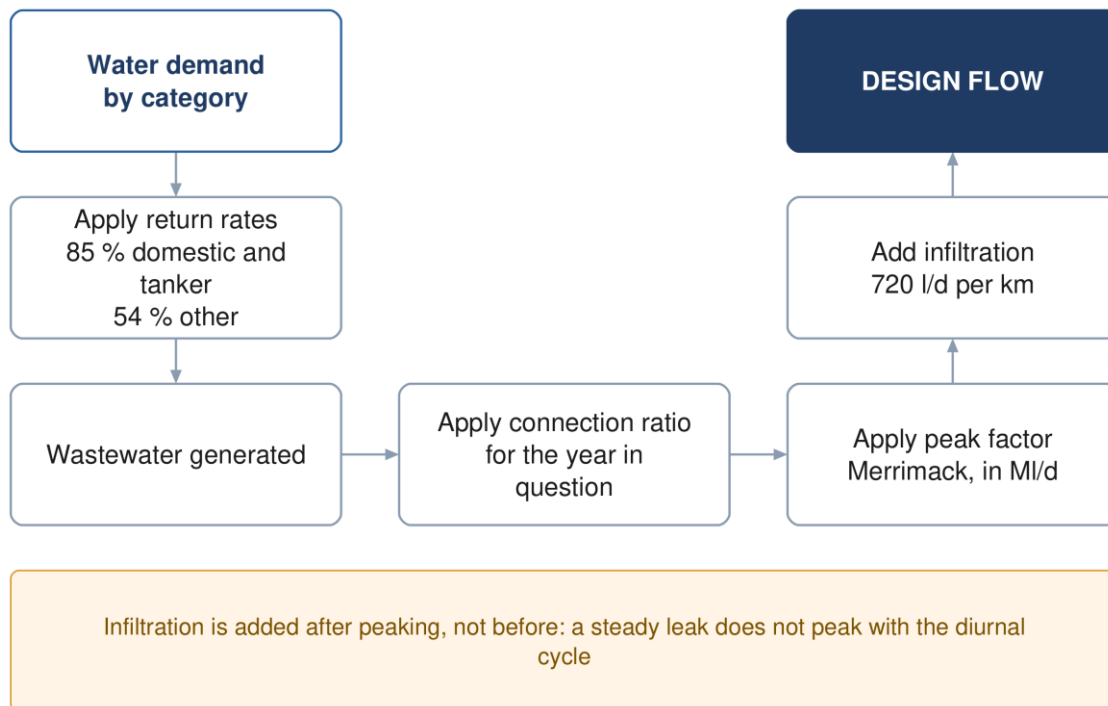


Figure 5 From demand to the flow the pipe is sized on.

8.6 Assembling the design flow

$$Q_{\text{design}} = Q_{\text{ww}} \times \text{Pf} + Q_{\text{inf}} \quad (16)$$

Infiltration is added after peaking, not before. It is a steady leak and does not peak with the diurnal cycle.

9 Gravity sewer design

9.1 Purpose

Turning a design flow into a diameter, a gradient and an invert level, while keeping the pipe fast enough to scour itself and slow enough not to erode.

9.2 Which formula

The guideline requires that a recognised hydraulic formula be used and names Colebrook-White and Manning. Neither is exclusively mandated, but Colebrook-White is the one given a mandatory input and the one from which the minimum gradient table is derived.

$$V = -2\sqrt{2gDS} \log_{10} \left[\frac{k_s}{3.7D} + \frac{2.51\nu}{D\sqrt{2gDS}} \right] \quad (17)$$

Symbol	Meaning	Unit
V	pipe-full velocity	m/s
g	acceleration due to gravity	m/s ²
D	pipe internal diameter	m
S	hydraulic gradient	m/m
k _s	roughness — 1.5 mm, mandatory for all sizes and materials	m
ν	kinematic viscosity; 1.141 × 10 ⁻⁶ at 15 °C	m ² /s

Manning, where it is used

$$v = \frac{1}{n} R_h^{\frac{2}{3}} S^{\frac{1}{2}} \quad (18)$$

Symbol	Meaning	Unit
n	roughness coefficient; 0.009 to 0.011 for the plastics specified	dimensionless
R _h	hydraulic radius, area divided by wetted perimeter	m

One equation in the guideline is dimensionally impossible. The relation between full-bore flow and velocity is printed as flow equals velocity divided by area, which yields units of reciprocal metre-seconds. It was verified at high resolution that the document really does print a division. Flow is velocity multiplied by area. Use the correct form and note the defect if the calculation is ever audited against the page.

Source: G203 §4.2.1 p24 and §4.2.4 p25.

Sizing a gravity sewer run

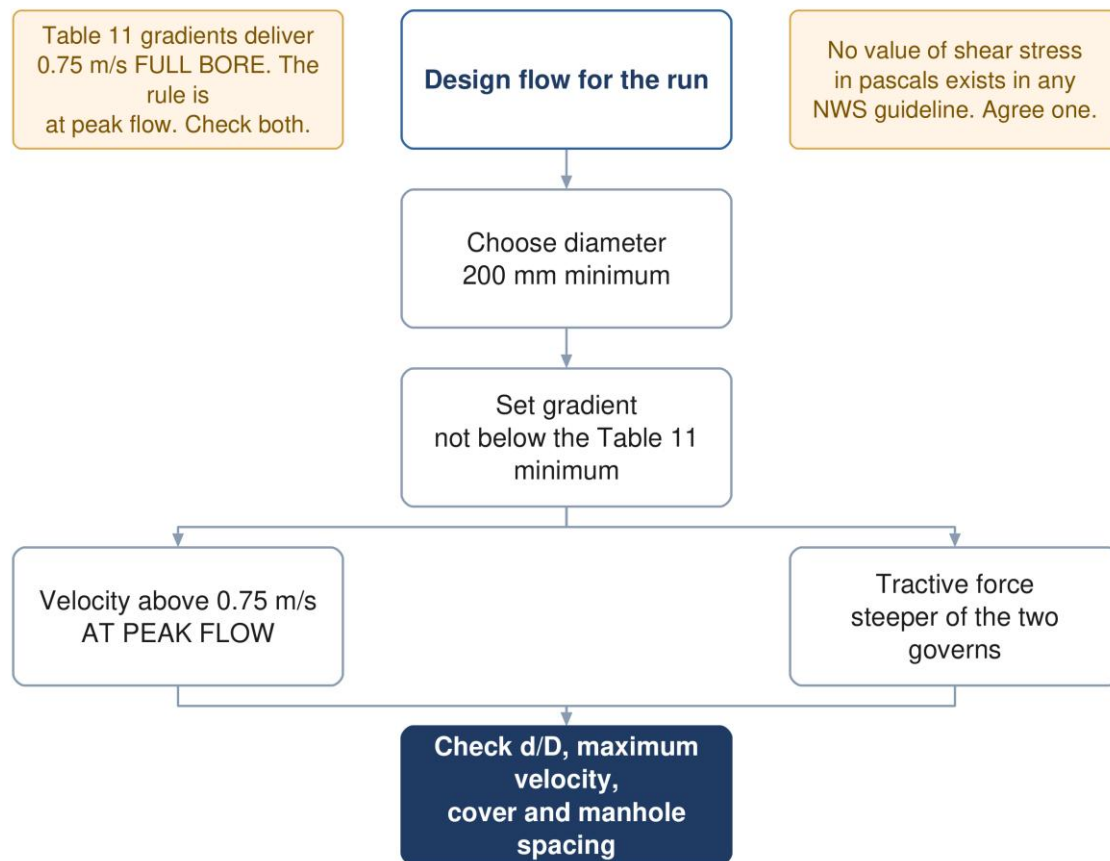


Figure 6 Sizing a gravity run. Both self-cleansing checks apply, and the steeper gradient governs.

9.3 Velocity and depth of flow

Table 4 Velocity and flow-depth criteria

Criterion	Value	Condition	Force
Self-cleansing velocity	above 0.75 m/s	at peak flow	mandatory
Preferred velocity	0.90 m/s	at peak flow	advisory
Maximum velocity	3 m/s	at design depth	mandatory
Flow depth, up to 350 mm	d/D = 0.65	at peak flow	recommended
Flow depth, above 350 mm	d/D = 0.50	at peak flow	recommended

Two checks are required together, not as alternatives: the self-cleansing velocity, and the minimum tractive force. Where they disagree, the steeper gradient governs. At the head of a system, where the velocity cannot be reached at all, the tractive force method is the one that decides the gradient.

9.4 Tractive force

$$\tau = \frac{W \sin \theta}{p L} \quad (19)$$

Symbol	Meaning	Unit
τ	tractive tension, or boundary shear stress	Pa
W	weight of fluid	N
θ	angle of the pipe to the horizontal	degrees

p	wetted perimeter	m
L	length of pipe	m

$$S_{\min} = K\tau^{1.23}Q^{-0.461} \quad (20)$$

The coefficient depends on the units of flow: 2.33×10^{-4} where flow is in cubic metres per second, or 5.5×10^{-3} where it is in litres per second. The relation assumes a flow depth of 0.2 and a Manning roughness of 0.013 — the latter inconsistent with the roughness table for the plastic pipes actually specified.

This mandatory method cannot be completed from NWS documents. The guideline requires the tractive force check, gives the equation, and never states the required value of shear stress in pascals — not in the wastewater guideline's 201 pages, nor in the general guideline's 152. A value must be taken from the literature and agreed with NWS in writing. It must not be presented as though it came from the guideline.

Both equations above exist in the source only as images. They cannot be found by searching the text of the PDF, which is worth knowing for anyone checking them.

Source: G203 §4.2.2.1 p26-27.

9.5 Minimum gradients

The guideline tabulates a minimum gradient against diameter, derived from Colebrook-White at a self-cleansing velocity of 0.75 m/s.

Table 5 Minimum sewer gradient by diameter

Diameter (mm)	Minimum gradient (mm/m)	Diameter (mm)	Minimum gradient (mm/m)
200	5.00	600	1.25
250	3.75	700	1.00
315	2.70	800	0.85
400	2.05	900 and above	0.75
500	1.55		

These gradients are full-bore values, and that matters. Reproducing all nine rows with Colebrook-White at the mandated roughness returns 0.75 m/s running full, to within two per cent. But the velocity requirement is stated at peak flow, not full bore. At the mandated flow depth of 0.65 a pipe reaches about 0.82 m/s and passes; at 0.50 it reaches exactly 0.75 and has no margin at all; at a depth of 0.20 it manages 0.46 m/s and fails. Laying to this table is therefore not by itself compliance, and in the opening years every pipe in the network sits below the threshold. That is what the maintenance washing schedule exists to cover.

Source: G203 §4.3 p29; the part-full check is a project calculation.

9.6 Cover, depth and manholes

The minimum depth is 1.3 m to the crown of the pipe. Where that cannot be achieved, concrete protection is required and the minimum cover over pipe and protection together becomes 0.5 m.

The maximum depth rule is widely mis-stated. The guideline recommends a maximum cover of approximately 10 to 12 metres. It is a recommendation, not a limit; it refers to cover, not invert depth; and exceeding it is permitted, with the consequence being a mandatory consultation with pipe manufacturers. What obliges a pumping station is excavation cost becoming prohibitive, and no depth figure is attached to that clause.

Table 6 Maximum spacing between manholes

Pipe diameter (mm)	Maximum spacing (m)
--------------------	---------------------

200 to 315	100
350 to 900	120
1000 to 1400	150
above 1400	200

Any departure from this spacing needs NWS approval in advance. Manholes are required at every change of gradient, every change of diameter, every junction and the end of each lateral. A backdrop is required where invert levels differ by more than 600 mm, and is to be built outside the manhole.

No inlet may meet the flow at less than 90 degrees. The rule is stated twice in mandatory voice. It is a common source of non-compliance in automated layouts, because a geometrically convenient junction is often a hydraulically bad one.

Source: G203 §4.4 p29-30 and §4.6.3 p33.

9.7 Lengths and materials

A lateral sewer has a maximum length of 45 m. A property connection should not exceed 50 m, so that it can be maintained; beyond that a manhole is added. Minimum sizes are 160 mm outside diameter for riders and property connections, and 200 mm for laterals and main sewers.

Source: G203 §3.2 p17, Table 5 p18 and Table 6 p22.

10 Lifting stations and force mains

10.1 Purpose

Where gravity cannot carry the flow onward, it is lifted and pushed through a pressure pipe to the next point at which gravity can take over again. Every such station is a permanent operating cost and a permanent failure mode, which is why the guideline treats them as a last resort.

The guideline's position is unambiguous. "The use of pumping stations and pressure mains shall be avoided whenever gravity sewer designs are feasible and cost effective." A design that reaches zero pumping stations is not an unusual outcome to be defended; it is the outcome the guideline asks for.

10.2 When a station is required

There is exactly one trigger in the entire guideline set, and it is a cost trigger. Where the cost of excavation becomes prohibitive, a pumping station is to be incorporated. No depth figure is attached to that obligation. The ten to twelve metre figure discussed in Section 9.6 is a separate recommendation about cover, and exceeding it obliges consultation with pipe manufacturers rather than a pump.

When a lifting station is required

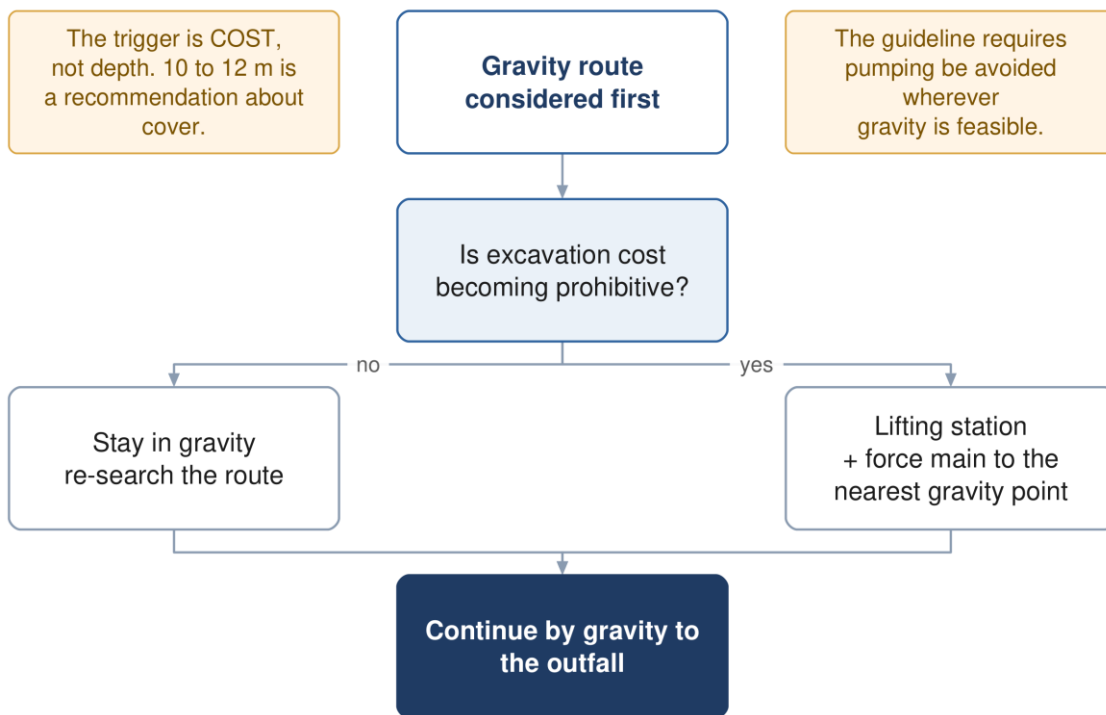


Figure 7 When a lifting station is required. The trigger is excavation cost, not depth.

10.3 Station classification

Type	Design flow	Minimum duty pumps	Standby
Type 1	up to 100 l/s	1	1
Type 2	100 to 300 l/s	2	1
Type 3	above 300 l/s	3	1

Two tables in the guideline disagree here. One gives a Type 3 station three duty pumps; another, two pages later, gives it two. Both are printed in the same section of the same document. The three-pump reading is the conservative one, and the two tables agree for Types 1 and 2, so the discrepancy is confined to the largest stations.

Above the table sits the governing rule, which is independent of type: sufficient pumps must be provided that the design peak flow can still be achieved with any one pump out of service.

10.4 Wet well volume

The volume between the start and stop levels is set by how often the motor may be started, not by storage in any general sense.

$$V = 0.25 Q T \quad (21)$$

Symbol	Meaning	Unit
V	live volume, between pump start and stop levels	m ³
Q	capacity of a single pump	m ³ /s
T	on-off cycle time, 3600 divided by permitted starts per hour	s

The guideline sets a minimum of ten starts per hour for motors up to 30 kW, and refers larger motors to the manufacturer and to NEMA MG 1. At ten starts per hour the cycle time is 360 seconds and the live volume becomes ninety times the pump capacity in cubic metres per second.

The equation applies to a single constant-speed pump. The guideline gives no equivalent for variable-speed or duty-assist arrangements.

Source: G203 §7.8 p48.

10.5 Suction conditions

$$NPSH_a = H_a - H_{vpa} - H_{st} - H_f \quad (22)$$

Symbol	Meaning	Unit
H _a	absolute pressure on the liquid surface	m (not stated in source)
H _{vpa}	vapour pressure	m
H _{st}	static head	m
H _f	friction head	m

A margin of at least one metre over the pump's required suction head is to be provided. The guideline gives no units and no sign convention; the form as printed assumes a suction lift, and for a flooded suction the static term is additive.

10.6 Force mains

Table 7 Force main velocity and gradient criteria

Criterion	Value	Force
Minimum velocity, raw sewage	0.75 m/s at minimum flow	shall
Minimum velocity, intermittent flow	1.0 m/s	shall
Minimum velocity, vertical mains	1.2 m/s	shall
Maximum velocity	2.5 m/s	shall
Minimum internal diameter	75 mm; 50 mm with grinder pumps	shall
Gradient rising	1:500 recommended	recommended
Gradient falling	1:300 recommended	recommended
Gradient, absolute floor	never below 1:750	in all cases

Retention time	ideally under half an hour	ideally
----------------	----------------------------	---------

Diameter is not selected by a formula. The guideline requires that alternative diameters producing velocities across the permitted range be considered, and that a cost comparison determine which gives the optimum whole life cost. Where initial flows are far below future flows, two mains may be warranted rather than one.

The friction equations are named but never written. Head loss is to be calculated by Darcy-Weisbach for larger pipes and higher velocities, or Hazen-Williams for smaller diameters, with any other equation needing NWS approval. Neither formula is printed anywhere in the three guidelines — only their coefficients are tabulated. Cite the standard form, not NWS. There is also no roughness value published for a raw sewage force main; the coefficient table covers potable water and treated effluent only.

There is likewise no total dynamic head equation and no pump power equation in the guidelines. The components NWS names are static lift, friction loss, fitting losses and the velocity head difference; assembling them is standard hydraulics and should be cited as such.

Source: G203 §8 p50-55; head loss cross-referenced to G202 §7.1.3.2 p104.

10.7 Surge

$$\Delta H = \frac{c}{g} \Delta v \quad (23)$$

Symbol	Meaning	Unit
ΔH	change in pressure	m
c	wave propagation speed	m/s
g	acceleration due to gravity	m/s ²
Δv	change in flow velocity	m/s

The wave speed is described qualitatively as depending on the properties of the pipe and the liquid. No celerity equation is given anywhere in the guidelines, so it must come from standard theory.

Transient analysis must be carried out in NWS-approved licensed software; the equation is for checking, not for design. The number of simultaneous pump startups and shutdowns modelled follows N+1, so that reflected waves from earlier events can combine and reveal the true worst case. Models are first run with roughness set to near zero to capture the maximum swing, then re-run with realistic roughness.

One concession applies uniquely to wastewater: negative pressure, with air entering at an air valve, can be acceptable on a force main provided the protection and equipment are adapted to it.

Source: G201 Appendix III p145-147. G202 §10 is a one-line cross-reference to it and contains no surge content of its own.

10.8 Emergency provision

Every pumping station must have an emergency overflow to prevent flooding of the station or of connected dwellings, and overflows require Environmental Authority approval. Only extreme events should result in one, and a method to prevent or minimise overflows must be submitted for approval — chosen on least cost and least operational complexity.

No emergency storage duration is specified. Emergency storage is named as one of four permitted methods, with no duration and no sizing method attached. The 48 to 72 hour figure that appears elsewhere in the guidelines applies to a lagoon at a treatment plant, not to a pumping station, and should not be transplanted. The designer proposes and NWS approves.

11 Treatment plant sizing and phasing

11.1 Purpose

Converting flows and loads into a plant capacity, a technology, a land area and a phasing plan.

11.2 Size categories, and why they matter

Category	Capacity
Small	below 500 m ³ /d
Medium	500 up to 20,000 m ³ /d
Large	20,000 m ³ /d and above

The large-plant classification changes four separate rules. The residential buffer stops being a flat 500 m and becomes 300 to 1000 m, set by the distance to the 5 odour-unit contour from a dispersion model. Computational fluid dynamics modelling becomes mandatory unless the TOR excludes it. The chlorine contact tank is replaced by a treated effluent storage tank performing the same function. And the organic peak factors fall to 1.2 for BOD and COD and 1.5 for nitrogen.

Sizing and phasing the treatment plant

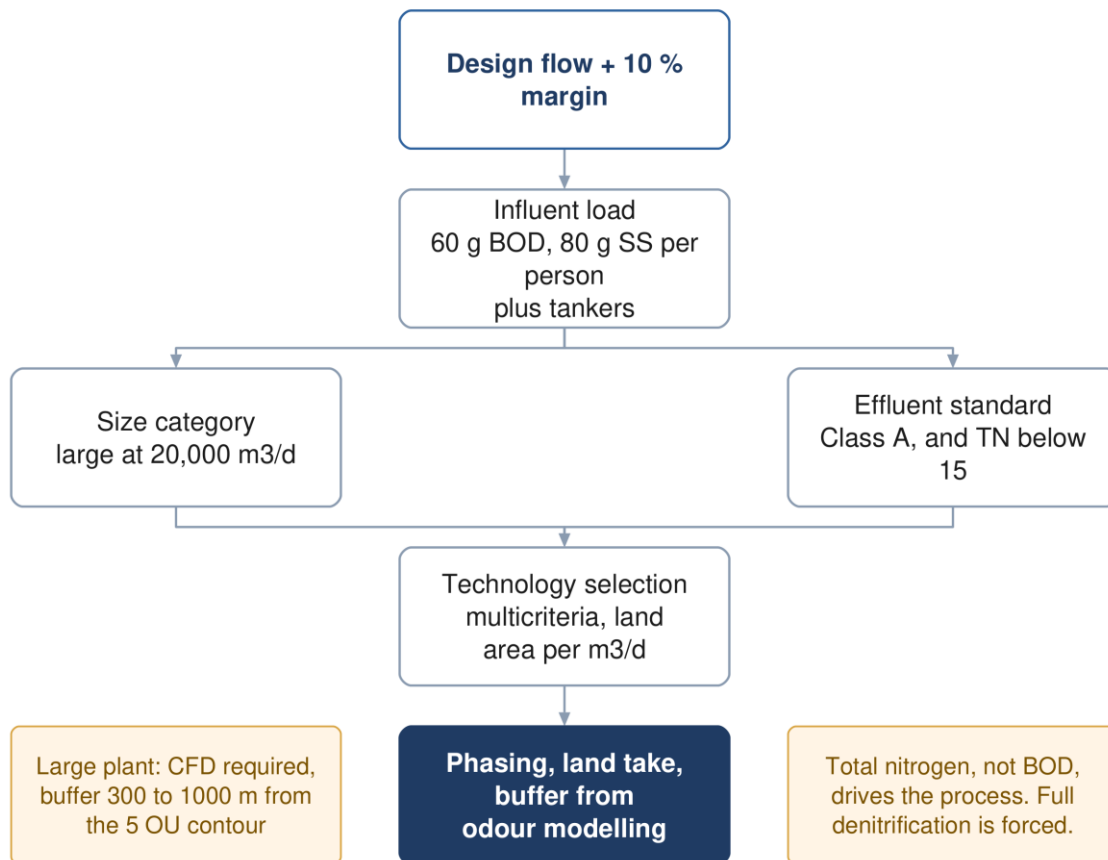


Figure 8 Sizing and phasing the plant. Total nitrogen, not BOD, drives the process choice.

11.3 Design horizon and margin

A plant is designed for a horizon of at least fifteen years and must meet the projected population, with anticipated industrial and institutional needs taken into account. Separately, the corporate planning life cycle is twenty-five years, which is also the period over which options are compared.

A ten per cent margin is applied to the design flow as an operational safety allowance, over and above any redundancy in the design rather than instead of it.

11.4 Influent characterisation

Design is to be on the basis of at least 60 g of BOD and 80 g of suspended solids per person per day. Those are floors, not typical values — the guideline's word is "at least".

Table 8 Design raw sewage characteristics, where site data is absent

Parameter	Design value	Parameter	Design value
BOD ₅	350 – 400 mg/l	Ammoniacal N	40 – 50 mg/l
COD	700 – 900 mg/l	Total Kjeldahl N	60 – 80 mg/l
Suspended solids	400 – 500 mg/l	Total phosphorus	10 – 15 mg/l
Inert solids	20 %	Alkalinity as CaCO ₃	200 – 400 mg/l
Fat, oil and grease	50 – 100 mg/l	pH	6.5 – 8.0
		Temperature	20 / 35 °C

These values are indicative and are to be used after agreement with NWS, in preference to which come the specific character of the catchment and NWS's own laboratory database. Sludge liquor returns, side streams and tanker loads are not included in them and must be added.

Tankered sewage is far stronger

Sewage arriving by tanker carries BOD from 350 up to 1050 mg/l, COD from 1350 to 5000, and suspended solids from 900 to 4300. Septic tank contents are described as much more concentrated than network sewage. Where tankers form a significant share of the inflow, this drives the load calculation rather than the network figures.

The trigger for a separate treatment line. Domestic sewage has a COD to BOD ratio between 1.8 and 2.2. Above that, the guideline states the influent is not effectively treatable biologically, and a separate line for high-strength wastewater is required if the volumes are significant. What counts as significant is not quantified and needs NWS agreement.

11.5 Load, and an equation the guideline does not print

The guideline gives per-capita loads, design concentrations and peak factors, but nowhere prints the relation converting a flow and a concentration into a mass load. It is standard, and is stated here as a derivation rather than a citation.

$$\text{Load} = \frac{Q \times C}{1000} \quad (24)$$

Symbol	Meaning	Unit
Load	mass load of the determinand	kg/d
Q	flow	m ³ /d
C	concentration	mg/l

Hydraulic pass-through structures are sized on peak hourly flow. Biological treatment is sized on average annual flow and the design inlet load. Both must include recycled liquors and tanker volumes.

11.6 Process sizing

The guidelines give ranges, not equations. No oxygen demand, sludge yield, solids retention time or clarifier area equation is printed anywhere. At concept and preliminary stage the guideline directs the designer to empirical methods — Metcalf and Eddy, or DWA, formerly ATV. At detailed design it requires verification in accredited software using IWA models. The tables in the guideline are ranges to land inside, and they are the enforceable part.

Table 9 Activated sludge configurations

Mode	F:M (kg BOD/kg MLSS/d)	MLSS (mg/l)	Minimum SRT (d)
High rate	above 1.0	below 2000	1
Conventional, 20 mg/l BOD	0.25 – 0.4	2000 – 3000	2 – 4
Conventional, 10 mg/l BOD	0.15 – 0.25	2500 – 3000	4 – 6
Conventional with nitrification	0.15	3000 – 4000	above 6
Extended aeration / MLE	0.05 – 0.15	2000 – 4000	above 10

11.7 Land area

Footprint is indicative and is used for early planning, not as a compliance limit. It must cover process units, sludge handling, buffer zones and — the guideline is explicit — the land needed for energy-efficient solutions such as a solar farm inside the plant perimeter.

Table 10 Indicative footprint by technology, m² per m³/d

Technology	Footprint	Technology	Footprint
Membrane bioreactor	0.45 – 0.9	Sequencing batch reactor	0.9 – 1.8
Moving bed biofilm reactor	0.9 – 1.8	Conventional activated sludge	1.8 – 3.6
Integrated fixed film	1.2 – 2.5	Constructed wetland	above 10

Built structures may not occupy more than 35 % of the allocated land, with a minimum five-metre setback from site boundaries.

11.8 Effluent quality

The process must be capable of meeting Class A or Class B of Ministerial Decision 145/1993. The headline Class A values are 15 mg/l BOD, 150 COD, 15 suspended solids, 200 MPN per 100 ml faecal coliforms and fewer than one nematode ovum per litre.

Total nitrogen is the parameter that actually drives the process. NWS overlays a limit of below 15 mg/l total nitrogen, which Ministerial Decision 145/93 does not contain. Class A on its own would permit around 21 mg/l once organic nitrogen, ammonia and nitrate are added. Full nitrification and denitrification are therefore mandatory in practice, and nitrogen rather than BOD or solids governs technology selection and sludge age.

If discharge to a wadi is contemplated, the standard tightens sharply. Effluent to a wadi must meet Class A, and where the wadi reaches the sea, ammonia, nitrogen and phosphorus instead take the values of Decision 159/2005. Total phosphorus falls from 30 to 2 mg/l and ammoniacal nitrogen from 5 to 1. That forces enhanced biological phosphorus removal with chemical polishing. Any wadi discharge is subject to Environmental Authority and APSR approval.

11.9 Siting and buffer

Site selection is assessed against fifteen criteria grouped under accessibility, physical characteristics, environmental and climate impact, social impact and cost. Two carry hard numbers: the site must consider the 25 and 100 year flood levels, and plants must be fully operational during floods.

For a large plant the residential buffer is not a fixed figure. It is the distance to the 5 odour-unit contour from a dispersion model, bounded between 300 and 1000 m. Odour modelling therefore has to precede siting, not follow it.

Source: G203 §10.2 p63-67, §10.3 p74-77, Table 27 p63, Table 28 p64; G201 Table 8 p43-44.

12 Treated effluent

12.1 How much is produced

$$Q_{TSE} = 0.95Q_{inlet} \quad (25)$$

The missing five per cent covers evaporation, reuse within the process, and the plant's own consumption for landscaping and dust control.

$$Q_{delivered} = 0.90Q_{TSE} = 0.855Q_{inlet} \quad (26)$$

A further ten per cent is lost in the distribution network, chiefly at joints and connections. Note the difference in force: the 95 % production ratio is an assumption the guideline permits, while the 10 % network loss is one it requires.

Source: G201 §7.4.6.1 p73 and §7.4.6.3 p75-76.

12.2 Who takes it

The TOR does not name customers. Identifying them is the consultant's task, and the guideline classifies them in two groups.

Public consumers	Private consumers
Beautification of highways and main roads	Community parks
Beautification of secondary roads	Golf courses
Beautification of interchanges and roundabouts	Private gardens
Public parks	Nurseries and farms

12.3 How much each needs

Table 11 Summer irrigation demand, for concept planning

Planting	Demand	Planting	Demand
Shrubs	20 – 40 l/plant/d	Ground cover	10 l/m ² /d
Palm trees	120 – 165 l/plant/d	Seasonal flowers	10 l/m ² /d
Other trees	40 – 80 l/plant/d	Grass	12 l/m ² /d
Hedges	10 l/m/d	Roads and junctions	10 l/m ² /d

Planting densities are 15 m for trees and 3 m for shrubs. The rate for roads and junctions applies where the vegetation type is unknown and is subject to the municipality's approval.

12.4 Seasonality and sizing

Demand runs at 100 % from June to August, 75 % in spring and autumn, and 50 % from December to February. The system is sized on the summer peak. Any consumer averaging more than 500 m³/d is to be studied individually with its own irrigation timing pattern. Reservoirs are designed for a minimum of 24 hours storage.

Source: G201 §7.4.6 p73-77, Tables 20 to 23.

13 Sludge

13.1 Purpose

Sludge handling and disposal must be considered an integral part of the treatment system, and plans and specifications for it must be incorporated into the design of every plant. It is not an appendix to the process design.

13.2 How much

$$\text{Sludge} = 0.25 \times Q_{\text{inlet}} \quad (27)$$

Symbol	Meaning	Unit
Sludge	sludge produced, dry solids	kg/d
Q inlet	plant inflow	m ³ /d

This is a master-plan baseline and an explicit starting point, not a design figure. It is a volumetric yield tied to inflow rather than the conventional yield per kilogram of BOD removed, and the guideline does not state whether it is dry solids or wet cake — read as dry solids. The wastewater guideline gives no yield factor at all; sludge production is instead a required output of the process model.

13.3 Where it goes

Ibri is named as the governorate's sludge treatment centre. NWS's own sludge management plan lists, for Adh Dhahirah, a sludge treatment centre performing composting at Ibri STP. The plant is a receiver for the governorate, not merely a producer of its own sludge. That has consequences for land area, odour buffer, and vehicle access which must be carried into the site selection and the footprint.

Reuse is the default: Ministerial Decision 145/93 requires sludge to be reused unless no form of reuse is possible, and quality must comply with its heavy metal limits — which are referenced by the guideline but not reproduced in it, and must be obtained from the Decision itself. Sludge exceeding those limits may go to landfill only with prior ministerial approval.

Table 12 Be'ah landfill acceptance criteria

Criterion	Requirement
Solids content	minimum 80 %, dried before disposal
pH	neutral
Temperature	ambient
Daily quantity	not exceeding 60 tonnes per day
Standing	Be'ah may stop receiving sludge at any time

The 80 % threshold rules out mechanical dewatering alone. The best performance in the guideline's own tables is a plate filter press at 40 to 45 % dry solids. Drying beds reach 60 to 75 %, still short. Thermal or solar drying, or composting, is therefore effectively forced if landfill is the outlet — which aligns with the composting centre already designated for Ibri.

Onsite dewatering facilities are required at all plants unless NWS states otherwise, sized on peak weekly average flow at eleven hours a day, seven days a week, with a standby unit and solids recovery of at least 95 %.

Source: G201 §7.4.7 p78; G203 §10.6.8 p135-137 and p151-155.

14 Options and appraisal

14.1 How many options, and of what kind

A minimum of three options is required, and separately for the sewer network, the treated effluent network and the plant. The guideline also states what kind they should be.

1. an option that pushes environmental sustainability, including nature-based solutions
2. an internationally best-in-class, state-of-the-art solution
3. a standard solution using practice and technology already established in Oman

The three-option minimum is mandatory; the archetypes are offered as guidance. Each option must present equivalent functional requirements and comparable reliability and redundancy, so that the comparison is unbiased.

Options appraisal and the recommendation

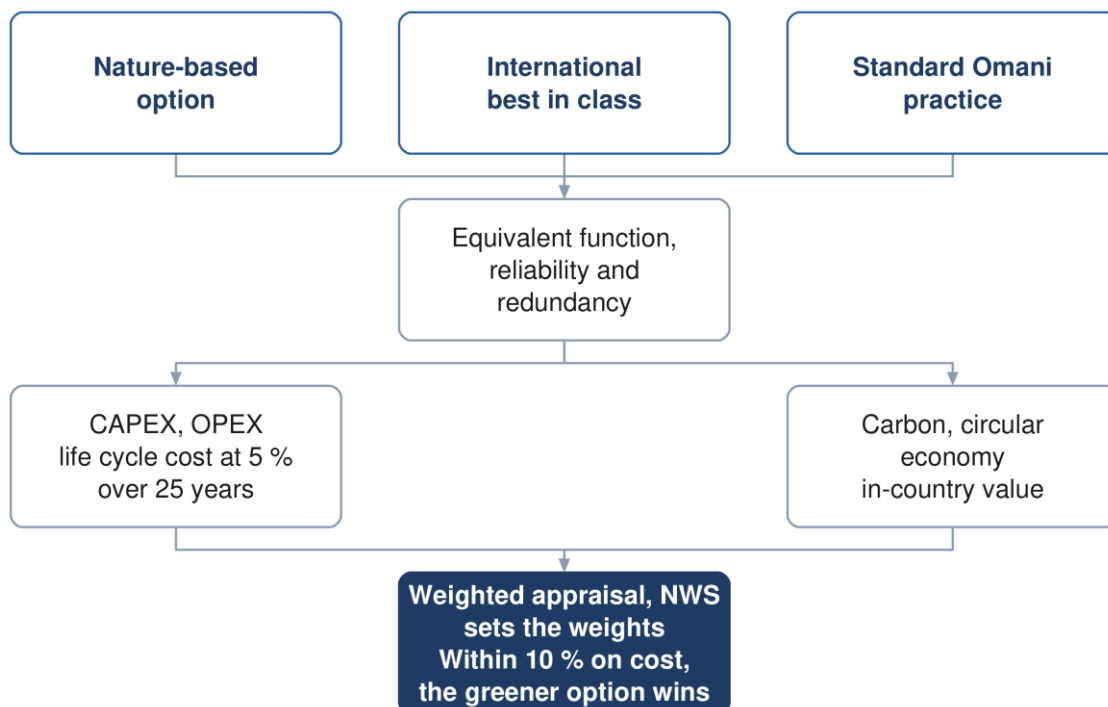


Figure 9 Options appraisal. Where costs sit within ten per cent, the greener option is adopted.

14.2 The appraisal parameters

Capital and operating cost; life cycle cost; carbon footprint over the project lifetime; resource efficiency under a circular economy approach including decommissioning; in-country value; and the degree of nature-based solution. The evaluation horizon is twenty-five years for every parameter, and NWS sets the weighting.

14.3 Net present value

No formula for this exists in the guidelines. Net present value, life cycle cost, carbon footprint and the multi-criteria score are all named and specified in scope, and none is written as an equation anywhere in the three documents. This was verified by full-text search and by checking every page for equations dropped as images.

Cite ISO 15686-5 for life cycle cost and the GHG Protocol and ISO 14064 for carbon. What the guideline does fix is the discount rate and the horizon.

$$NPV = \sum_{t=1}^n \frac{C_t}{(1+i)^t} \quad (28)$$

Symbol	Meaning	Unit
C t	net cash flow in year t	OMR
i	discount rate — 5 % , unless NWS instructs otherwise	fraction
n	evaluation period — 25 years	years

The equation above is the standard form, given for completeness. It is not a guideline citation.

14.4 Operating cost

The guideline lists what operating cost must include: labour and staffing, vehicles and equipment, power and utilities at the current APSR tariff, spare parts and consumables, chemicals, and general maintenance and repair. The tariff itself is not in the guideline and must be obtained.

14.5 Carbon

Carbon footprint is to be evaluated for construction and operation in accordance with ISO 14064 and the GHG Protocol, expressed in tonnes of carbon dioxide equivalent per year and per cubic metre produced. Scopes 1 and 2 are counted in full; Scope 3 is counted for significant elements where information is available or can be reasonably estimated. The benchmark for treated effluent is 1.17×10^{-3} tonnes per cubic metre.

One of the options must include a carbon reduction plan comparing a conventional base case with an optimised scenario, against NWS targets of 52 % reduction by 2030 and 96 % by 2050. Since more than eighty per cent of NWS operational emissions come from electricity, the levers that matter are gravity flow, minimised lift, efficient equipment and renewable generation.

14.6 Choosing

A weighted multi-criteria analysis compares the options against total lifetime cost, sustainability (carbon, circular economy and nature-based solutions), social development and in-country value, adaptability and resilience, operability, constructability, and environmental impact. No scoring scale or normalisation rule is specified, so the method must be proposed and agreed.

Sensitivity analysis varies exactly three things: the weighting between categories, the discount rate, and the input design criteria.

The tie-break rule. Where options fall within ten per cent of each other on total lifetime cost, the more sustainable option is to be adopted. This makes the sustainability assessment decisive rather than decorative whenever the costs are close.

14.7 Cost accuracy and value engineering

Concept-stage estimates carry an accuracy of plus or minus twenty per cent, and the report must state its accuracy class. Measurement follows CESMM3.

Formal value engineering is triggered at concept for this project. The threshold table places a general value engineering study at concept stage, led by the design team, for projects below five million rials. Its footnote overrides that for treatment plants and pumping stations above two million, which require a formal study by an

independent certified consultant at both concept and preliminary stage. The Ibri plant clears that threshold, so an external appointment falls inside the concept programme.

Source: G201 §11 p92-94 and §12 p95-106.

15 Where the guidelines cannot be relied on

This section exists because a reference document that presents its source as flawless is not usable. Everything below was verified at the page. Where the guideline is wrong, this document reproduces what it prints and says what is wrong with it; it does not silently correct the client's own standard.

15.1 Formulae that do not exist in the guidelines

Each of these is commonly assumed to be in the guidelines and is not. Citing NWS for any of them would be a fabricated reference.

Formula	Cite instead	What NWS does supply
Net present value	ISO 15686-5	5 % discount rate, 25 year horizon
Life cycle cost	ISO 15686-5	the cost-stage scope list
Carbon footprint	ISO 14064, GHG Protocol	units and benchmark values
Multi-criteria score	designer's own, agreed with NWS	the criteria and who weights them
Total dynamic head	standard hydraulics	the component list, in prose
Pump power	standard hydraulics	nothing; no efficiency assumption
Darcy-Weisbach	standard form	roughness coefficients only
Hazen-Williams	standard form	C values only
Wave celerity	Korteweg	a qualitative description
Mass load from flow and concentration	standard	loads and concentrations separately
Oxygen demand, SRT, clarifier area	Metcalf and Eddy, or DWA	ranges to land inside
Surge vessel volume	—	a 20 % minimum allowance
Emergency storage at a pumping station	—	nothing; propose and get approval
Roughness for a raw sewage force main	—	potable and treated effluent only
Aquifer recharge criteria	—	absent from all three documents

15.2 A mandatory method that cannot be completed

Tractive force. The check is required, the equation is given, and the required value of shear stress in pascals appears nowhere in the wastewater guideline's 201 pages or the general guideline's 152. Any value used must come from the literature and be agreed with NWS in writing. This is the single largest hole in the gravity design chain.

15.3 Errors of substance

Where	What is wrong	How to handle it
G203 p24	full-bore flow printed as velocity divided by area, which is dimensionally impossible	use velocity multiplied by area; note the defect
G201 p72	Peltier printed with 1 in the numerator; the published form carries 2.5	reproduce as printed; query NWS
G201 p62	Adh Dhahirah tanker ratio of 333 % cannot be arithmetically true; the volumes are sound	do not use the ratio; query NWS
G201 p144	pipeline emptying time evaluates to metres to the power one and a half times seconds squared	the guideline calls it a quick check; use a transient model
G203 p25	Manning constant 6.3448 against an exact 6.3496	quote the guideline value; footnote the exact one
G203 p40 / p42	two tables disagree on duty pumps for the largest station type	take the conservative reading; flag
G203 p146	aerobic digestion text requires 45 days retention; its own table gives 10 to 15	the text governs; note the conflict
G203 p124	clarifier surface loading and overflow rate do not reconcile,	reproduce both; do not silently pick one

	both stated at average flow	
G203 p185	hydrogen sulphide risk bands overlap and leave a gap	reproduce verbatim; flag
G203 p71	chlorine residual worded as "at least between"	0.3 to 1.0 at the consumer; up to 3.0 at the plant

15.4 Cross-references that do not resolve

- the TOR cites item 2.1 of Section 05 of the wastewater manual, which no longer exists after the March 2026 renumbering; the equivalent content is now §10.1
- a package-plant peak factor of 3.0 is attributed to the general guideline, which nowhere prints 3.0
- two internal references to the tanker discharge section point to the wrong subsection
- the general guideline is cited twice as AM-GUD rather than PAM-GUD
- value engineering timing is given as concept in one table and detailed design only in another
- environmental impact assessment timing is scoping-at-preliminary in one clause and full-assessment-at-concept in another

15.5 What to do about all this

Three rules keep the report defensible. Quote the guideline as it is printed, and separately say what is wrong with it — never publish a silently corrected version of the client's own standard. Where a formula is not NWS's, attribute it to whoever it belongs to. And where the guideline is silent on something it makes mandatory, propose a value, say where it came from, and obtain agreement in writing before the design depends on it.