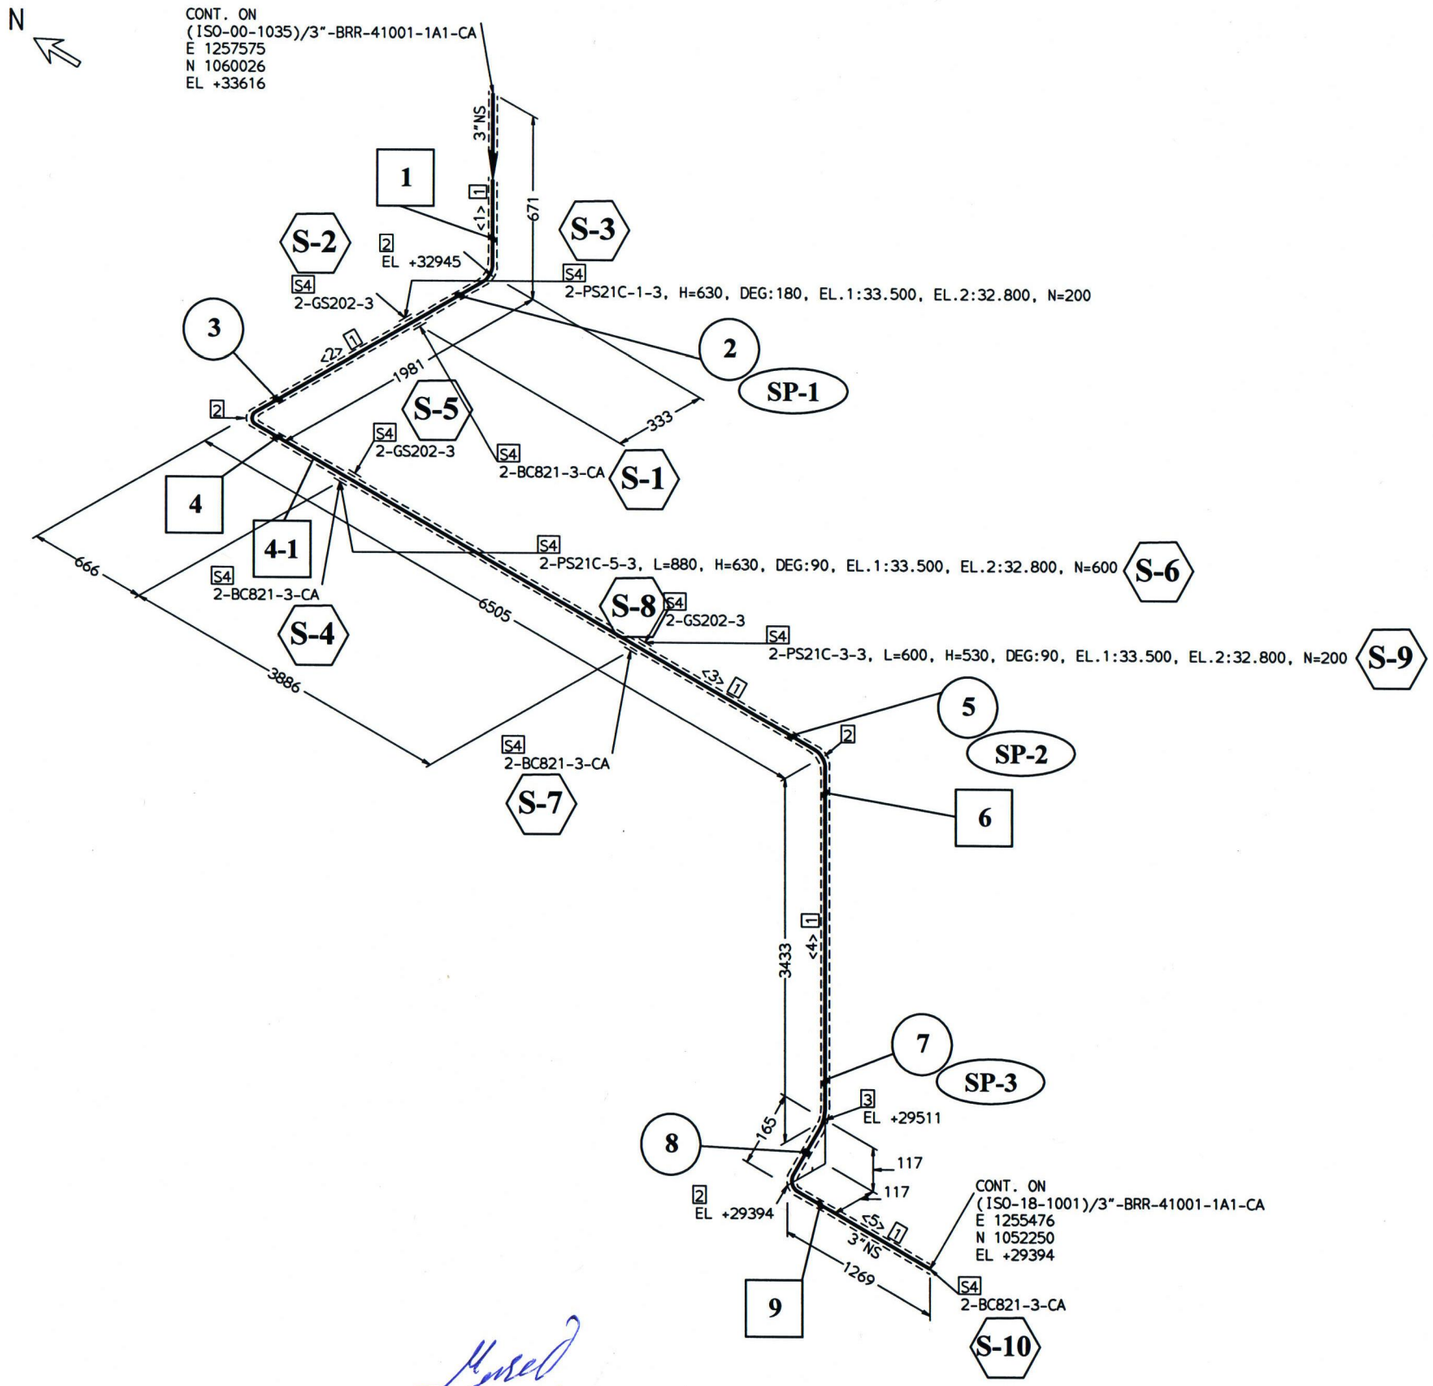



FABRICATION MATERIALS

| PT NO | COMPONENT DESCRIPTION | N.S. (INS) | ITEM CODE | QTY |
|---|---|---|---|---|
| | PIPE | | | |
| 1 | PIPE S40 BE SMLS A333-6 ASME B36.10 | 3 | P04A0G | 13.1M |
| | FITTINGS | | | |
| 2 | ELBOW 90 LR S40 BW A420-WPL6 ASME B16.9 | 3 | EL04BE1C | 4 |
| 3 | ELBOW 45 LR S40 BW A420-WPL6 ASME B16.9 | 3 | EK04BE1C | 1 |
| | SUPPORTS | | | |
| 4 | STRESS SUPPORT | 3 | 1A1-ATTA-3"- | 10 |

CUT PIPE LENGTH

| PIECE NO | CUT LENGTH | N.S. (INS) | REMARKS | PIECE NO | CUT LENGTH | N.S. (INS) | REMARKS |
|---|---|---|---|---|---|---|---|
| <1> | 557 | 3 | | <2> | 1753 | 3 | |
| <3> | 6277 | 3 | | <4> | 3268 | 3 | |
| <5> | 1155 | 3 | | | | | |

0A **JOINT NO (4-1) ADDED .**

Issued 14.05.6.2

Holded Iso Drawing Released For construction.

| | |
|---|---|
| PROJECT: | HDPE PLANT AND UTILITY (2146) |
| OWNER: | RAYAN POLYMER POUYA COMPANY |
| CONTRACTOR: | HAMPA ENERGY ENGINEERING & DESIGN COMPANY |
| DOCUMENT NO.: | 2146-ISO-25-0010 |
| LINE NO.: | 3"-BRR-41001-1A1-CA |
| ISOMETRIC NO.: | ISO-25-1001 |
| SHT NO.: | 1 /1 |
| REF. P&ID DWG.: | 4101/8022 |
| REF. PLAN DWG.: | 2146-10-20-DD-PI-DWG-0011-12 |

| | |
|---|---|
| PRESSURE (barg.) DESIGN: | 8, FV |
| OPERATING: | 1.5 |
| TEMPERATURE (C.) DESIGN: | -15~85 |
| OPERATING: | -0.34 |
| INSULATION TYPE: | CA |
| THK (mm): | 40 |
| TEST FLUID: | Water |
| PRESSURE: (barg.) | 12 |
| PAINT: | P-4 |
| NDT: | A |
| PWHT: | ASME B31.3 |
| LOCATION: | AG |
| LEVEL: | 2 |
| LINE CLASS: | 1A1 |

| REV. | DATE | DESCRIPTION | PRE'D. | CHE'D BY | APP'D BY |
|---|---|---|---|---|---|
| 0A | 24-AUG-2026 | | | | |
| 0 | 01.08.2026 | TOTALLY HOLD | M.IM | R.D | M.A |

NOTE
1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

Piping Supervision
شرکت رایان پلیمر پویا
(سهامی خاص)
نظارت پایپینگ

THIS DOCUMENT AND THE DESIGN IT COVERED IS THE PROPERTY OF POYO AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.