Note!

IsoDrawing Released

for construction - Masod

1405.5.13

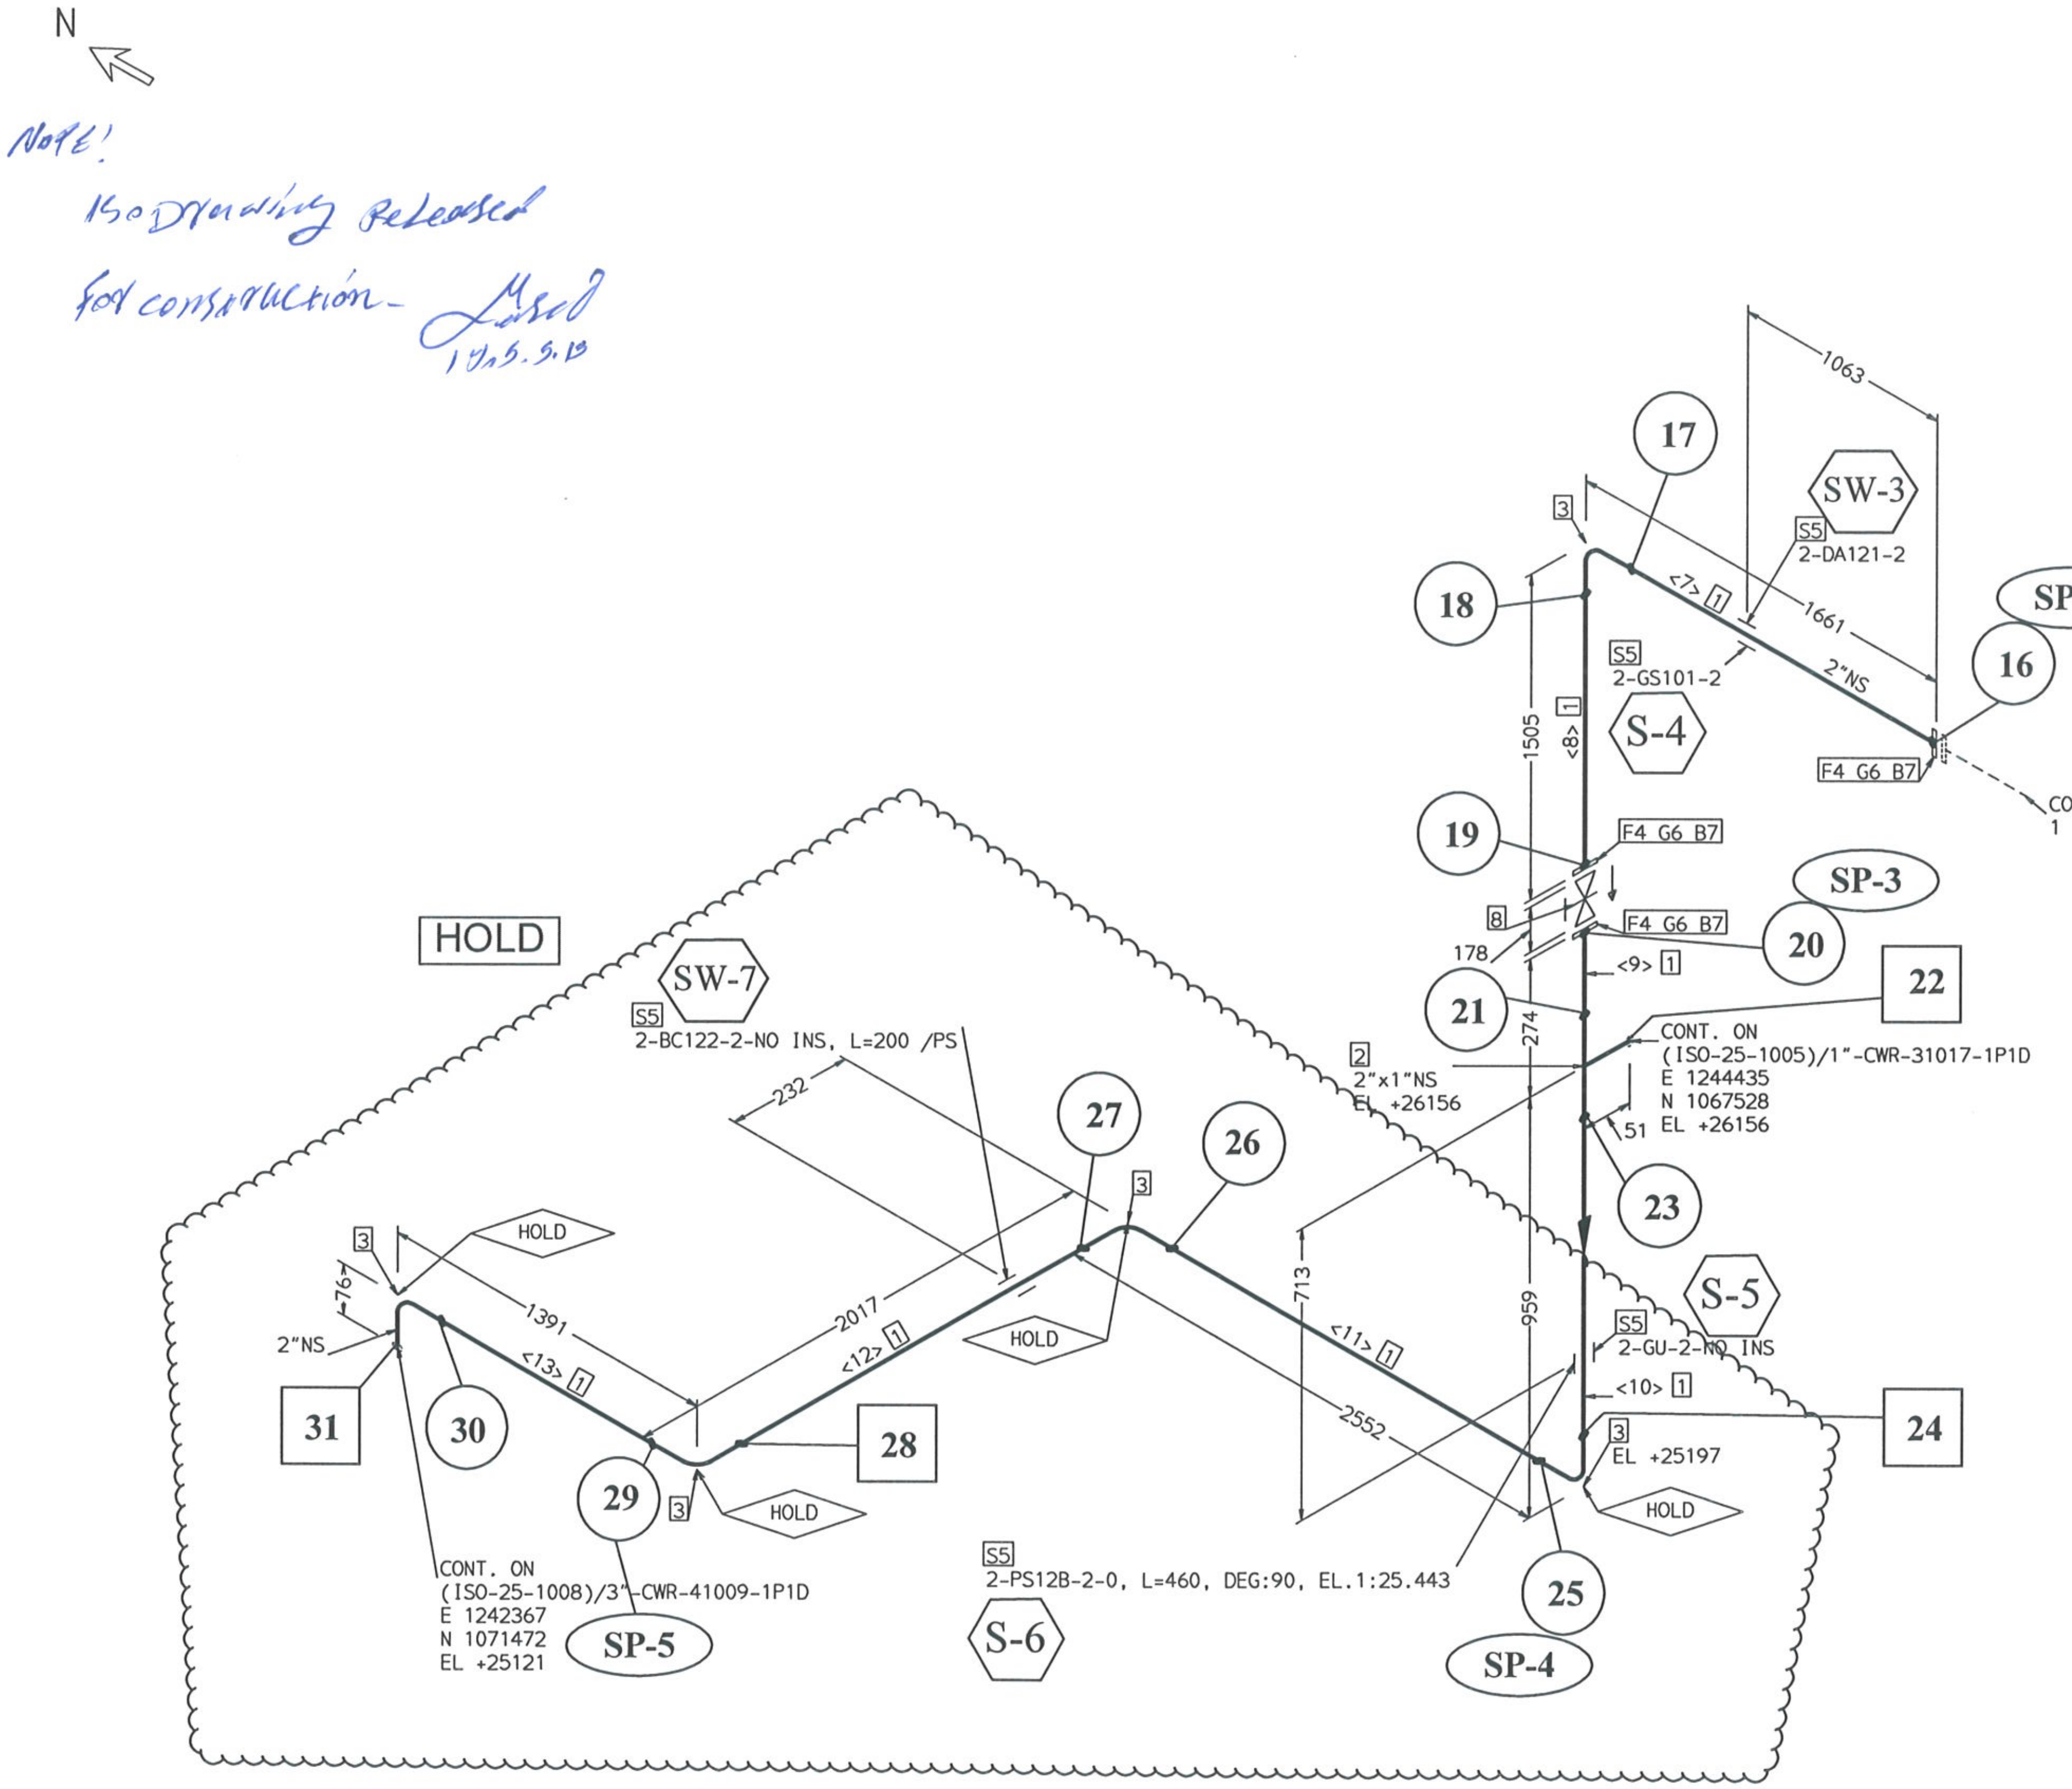

FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE S40 BE ERW(EJ=0.85) API 5L-B PSL1 ASME B36.10	2	P04D1A	9.6M
	FITTINGS			
2	REDUCING TEE S40 S80 BW A234-WPBW ERW(EJ=0.85) ASME B16.9	2 x 1	TT0408BE2A	1
3	ELBOW 90 LR S40 BW A234-WPBW ERW(EJ=0.85) ASME B16.9	2	EL04BE2A	5
	FLANGES			
4	FLANGE SLIP ON 150# RF A105 ASME B16.5 SRF	2	F12SRE0A	3
	SUPPORTS			
5	STRESS SUPPORT	2	1P1D-ATTA-2"	5

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	GASKETS			
6	GASKET 150# RF SHEET NON-ASBESTOS 2mm THK KLINGER C-4430 or EQ. ASME B16.21	2	G12S1Q19	3
	BOLTS			
7	90 STUD BOLT ASTM A193 GR.B7 + 2 HEAVY HEX NUTS ASTM A194 GR.2H ASME B18.2 PTFE COATED	5/8	BSP0CUP	12
	VALVES / IN-LINE ITEMS			
8	VALVE GATE 150# RF A216-WCB BODY W/13Cr TRIM OSY-BB FLEXIBLE WEDGE HAND WHEEL OP. ASME 16.10 API 600 API 598 SRF	2	VGA1R1	1

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<7>	1575	2		<8>	1419	2	
<9>	200	2		<10>	819	2	
<11>	2400	2		<12>	1865	2	
<13>	1239	2					

Piping Supervision

شرکت رایان پلیمر پویا

(سهامی خاص)

نظارت پایپینگ

Petro Pars General Co.

PROJECT: HDPE PLANT AND UTILITY (2146)

OWNER: RAYAN POLYMER POUYA COMPANY

CONTRACTOR: HAMPA ENERGY ENGINEERING & DESIGN COMPANY

DOCUMENT NO.: 2146-ISO-25-0010

LINE NO.: 2"-CWR-31016-1P1D | ISOMETRIC NO.: ISO-25-1004 | SHT NO.: 2 /2

REF. P&ID DWG.: 3104

REF. PLAN DWG.: 2146-10-20-DD-PI-DWG-0011-12

PRESSURE (barg.)
DESIGN: 8 , FV
OPERATING: 4.5

TEMPERATURE (C.)
DESIGN: 85
OPERATING: 43

INSULATION
TYPE: NO INS
THK (mm): 0

TEST
FLUID: Water
PRESSURE (barg.): 12

PAINT: P-1

NDT: B

PWHT: ASME B31.3

LOCATION: AG

LEVEL: 1

LINE CLASS: 1P1D

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	ISSUED FOR CONSTRUCTION (WITH HOLD)	M.IM	R.D	M.A

NOTE

1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

THIS DOCUMENT AND THE DESIGN IT COVERS IS THE PROPERTY OF POGC AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.