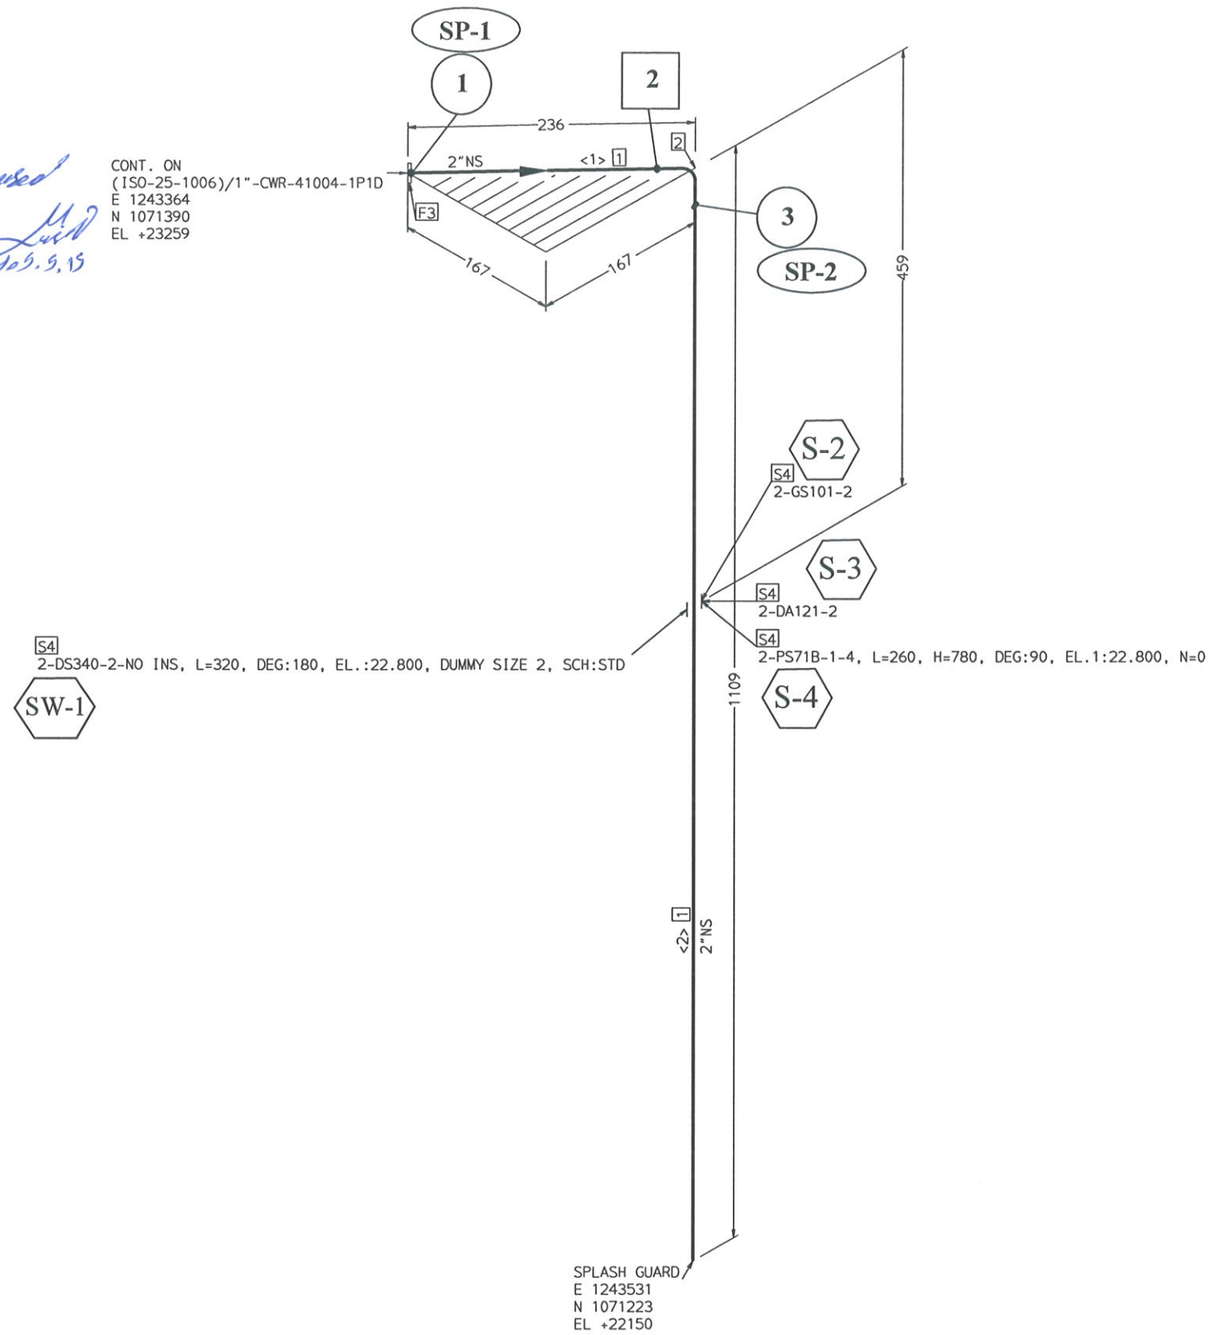


FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE S40 BE ERW(EJ=0.85) API 5L-B PSL1 ASME B36.10	2	P04D1A	1.2M
	FITTINGS			
2	ELBOW 90 LR S40 BW A234-WPBW ERW(EJ=0.85) ASME B16.9	2	EL04BE2A	1
	FLANGES			
3	FLANGE SLIP ON 150# RF A105 ASME B16.5 SRF	2	F12SRE0A	1
	SUPPORTS			
4	STRESS SUPPORT	2	1P1D-ATTA-2"	4

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<1>	150	2		<2>	1033	2	

PROJECT:	HDPE PLANT AND UTILITY (2146)
OWNER:	RAYAN POLYMER POUYA COMPANY
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY
DOCUMENT NO.:	2146-ISO-25-0010
LINE NO.:	2"-CWR-41008-1P1D
ISOMETRIC NO.:	ISO-25-1007
SHT NO.:	1 /1
REF. P&ID DWG.:	4101
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12

PRESSURE (barg.)	
DESIGN:	1.8
OPERATING:	ATM
TEMPERATURE (C.)	
DESIGN:	85
OPERATING:	48
INSULATION	
TYPE:	NO INS
THK (mm):	0
TEST	
FLUID:	Water
PRESSURE: (barg.)	2.7

PAINT:	P-1
NDT:	B
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	1
LINE CLASS:	1P1D

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	TOTALLY HOLD	M. IM	R.D	M.A

NOTE

1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

Piping Supervision
شرکت زایان پلیمر پویا
(سهامی خاص)
نظارت پایپینگ

Petro Pars Ghadrat Co.

THIS DOCUMENT, AND THE DESIGN IT COVERS, IS THE PROPERTY OF POGC AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.