
NOTE:
ISO Drawing Released
For construction
14/05/25

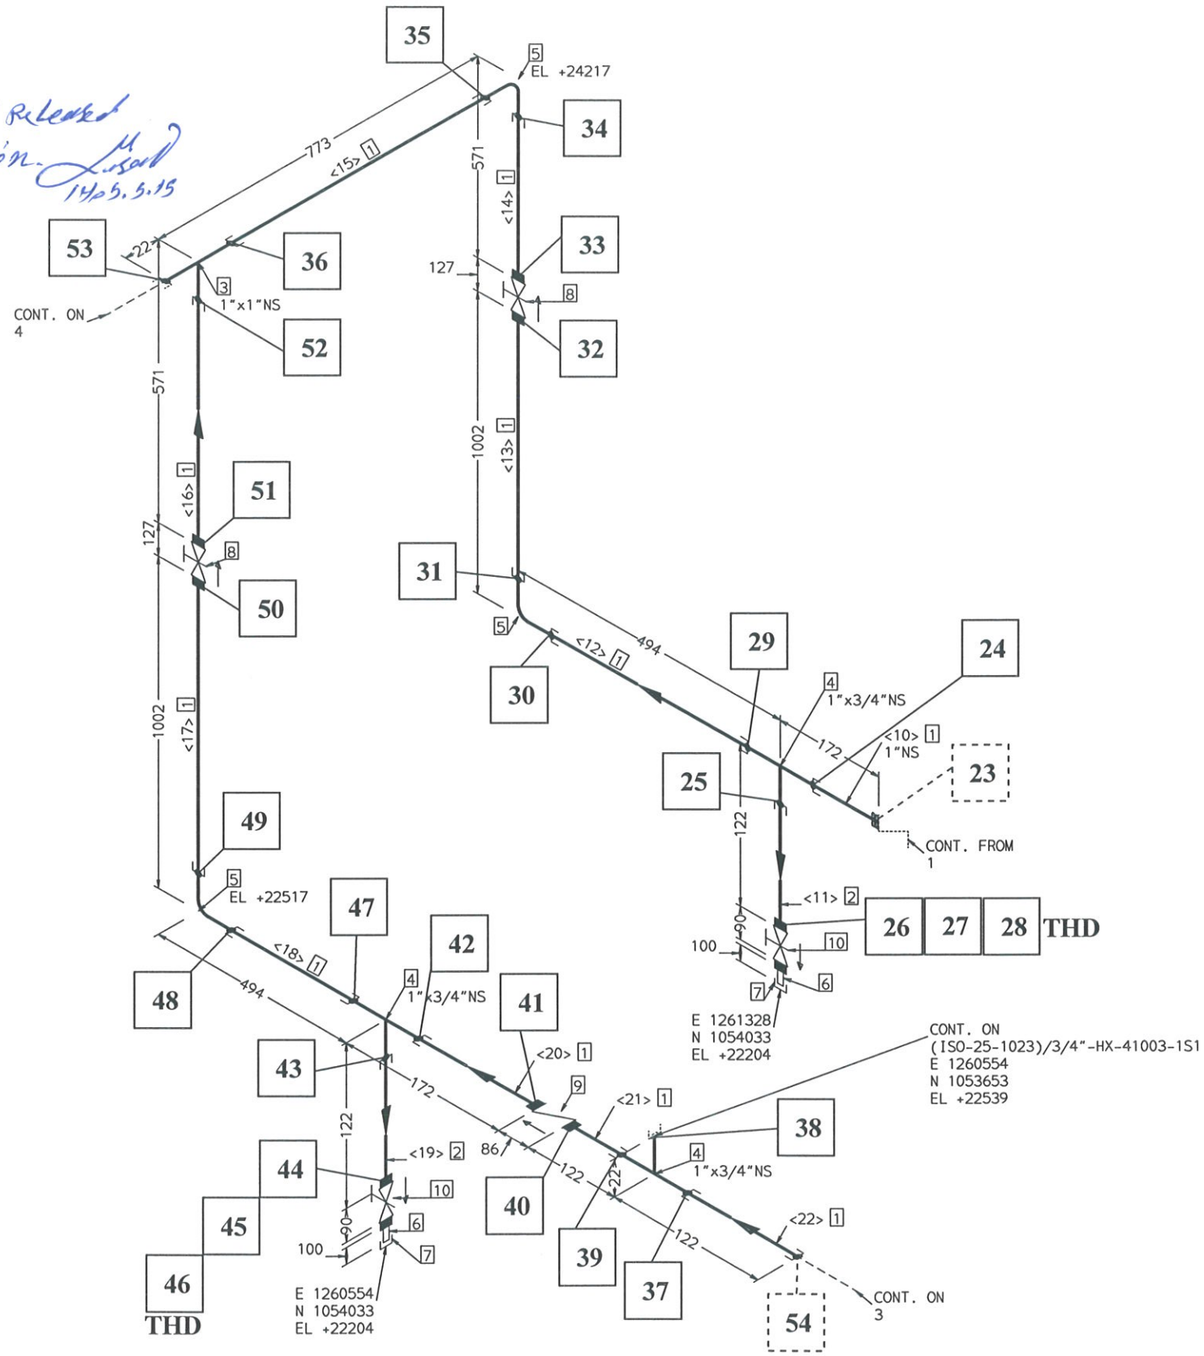

FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE 40S PE SMLS A312-TP304 ASME B36.19	1	P74C0A	5.2M
2	PIPE 40S PE SMLS A312-TP304 ASME B36.19	3/4	P74C0A	0.2M
	FITTINGS			
3	EQUAL TEE 3000# SW A182-F304 ASME B16.11	1 x 1	TT9090SG0A	1
4	REDUCING TEE 3000# SW A182-F304 ASME B16.11	1 x 3/4	TT9090SG0A	3
5	ELBOW 90 3000# SW A182-F304 ASME B16.11	1	EL90SG0A	3
6	STRAIGHT NIPPLE 40S SMLS TOE A312-TP304 (L=100mm) ASME B36.19	3/4	NI74YNC0A	2
7	CAP 3000# NPT A182-F304 ASME B16.11	3/4	KA90NG0A	2

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	VALVES / IN-LINE ITEMS			
8	VALVE GATE 800# SW A182-F304 BODY W/304SS TRIM HF-BODY SEAT OSY-BB SOLID WEDGE	1	VGU4S1	2
9	VALVE CHECK 800# SW PISTON A182-F304 BODY W/304SS TRIM HF-BODY SEAT HORIZ LIFT-BB	1	VCU4S1	1
10	VALVE GATE 800# SW A182-F304 BODY W/304SS TRIM HF-BODY SEAT OSY-BB SOLID WEDGE	3/4	VGU4S1	2

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<10>	150	1		<11>	100	3/4	
<12>	450	1		<13>	980	1	
<14>	549	1		<15>	729	1	
<16>	549	1		<17>	980	1	
<18>	450	1		<19>	100	3/4	
<20>	150	1		<21>	100	1	
<22>	100	1					

PROJECT:	HDPE PLANT AND UTILITY (2146)
OWNER:	RAYAN POLYMER POUYA COMPANY
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY
DOCUMENT NO.:	2146-ISO-25-0010
LINE NO.:	1"-HX-41002-1P1
ISOMETRIC NO.:	ISO-25-1022
SHT NO.:	2 /4
REF. P&ID DWG.:	4101
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12

PRESSURE (barg.)	
DESIGN:	7.0
OPERATING:	3.23
TEMPERATURE (C.)	
DESIGN:	120
OPERATING:	45
INSULATION	
TYPE:	NO INS
THK (mm):	0
TEST	
FLUID:	Air
PRESSURE: (barg.)	7.7

PAINT:	P-13
NDT:	B
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	1
LINE CLASS:	1P1

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	TOTALLY HOLD	M.IM	R.D	M.A

NOTE
1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

Piping Supervision
نظارت پایپینگ

THIS DOCUMENT, AND THE DESIGN IT COVERS IS THE PROPERTY OF POGC AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.