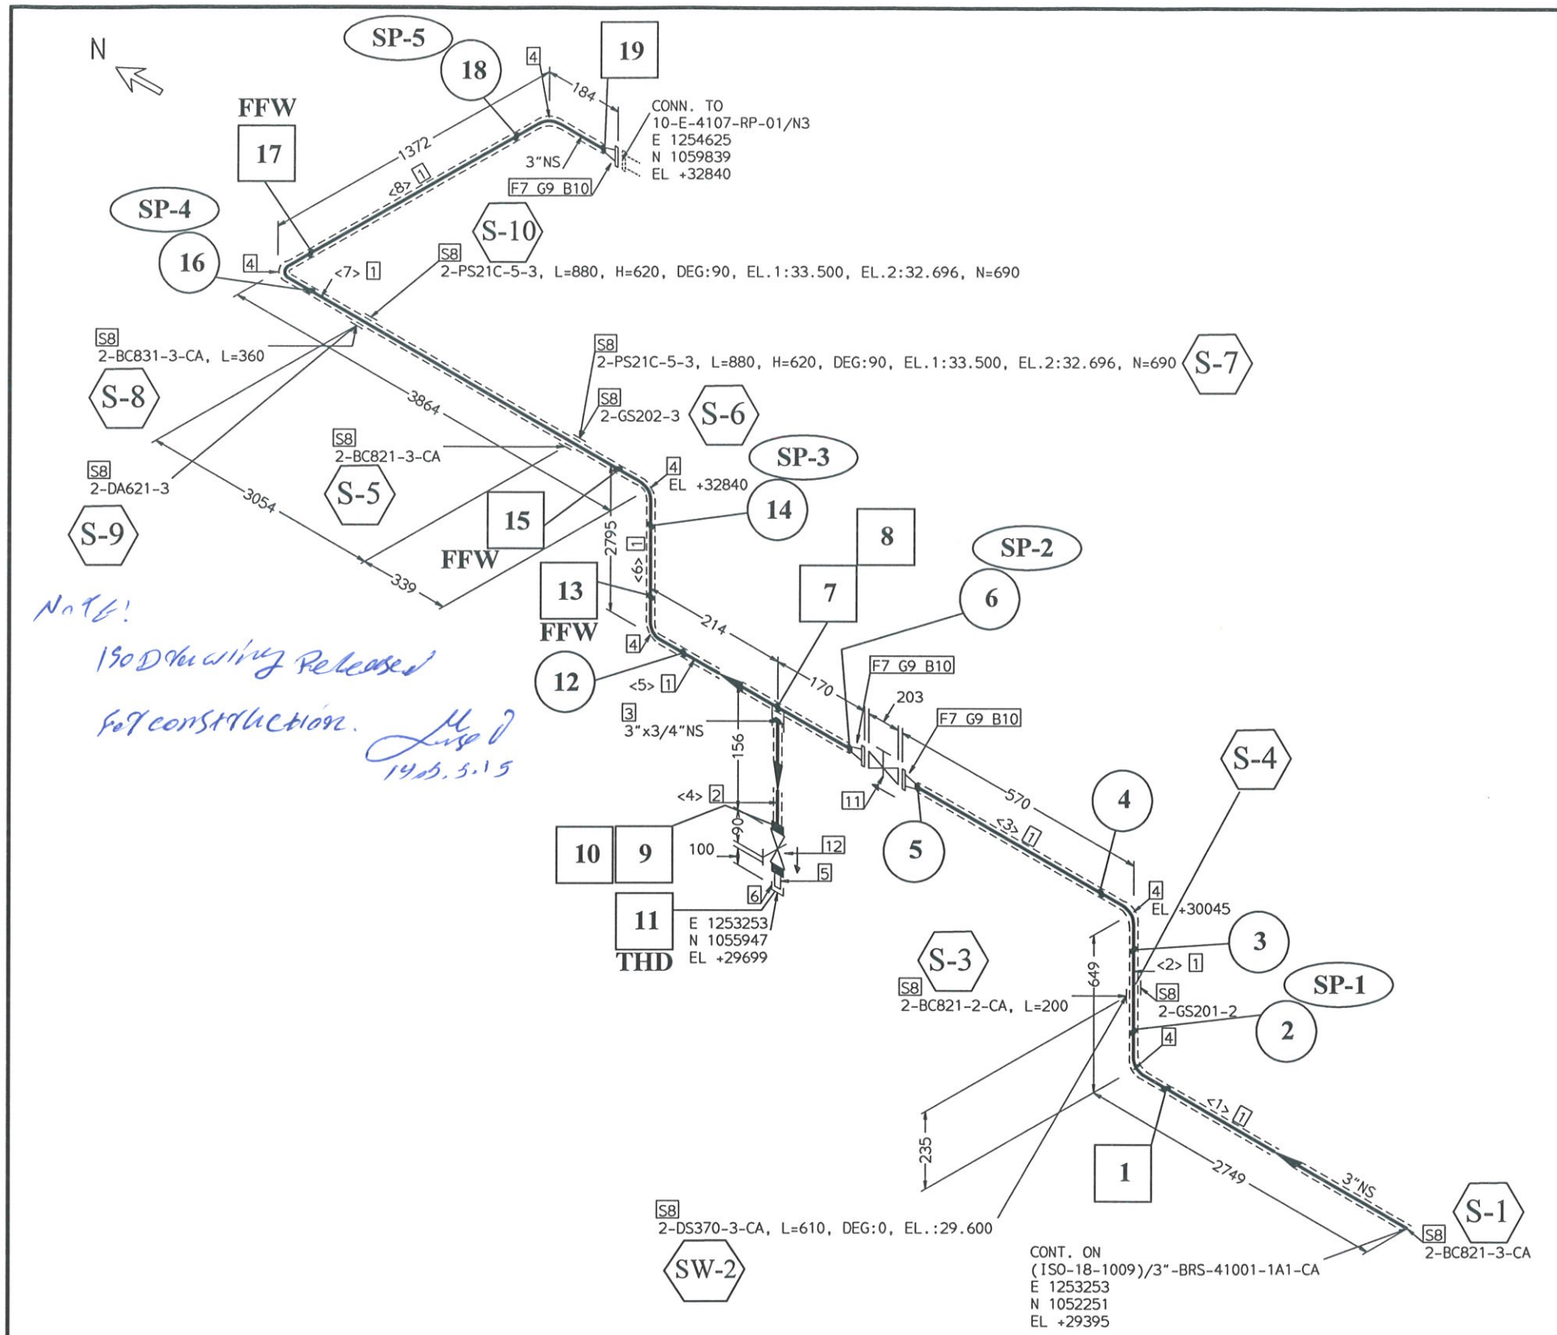


NOTE!
ISO Drawing Released
For construction.
14.05.15

FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE S40 BE SMLS A333-6 ASME B36.10	3	P04A0G	11.0M
2	PIPE S80 PE SMLS A333-6 ASME B36.10	3/4	P08A0G	0.1M
	FITTINGS			
3	HALF COUPLING 3000# SW A350-LF2 CL.1 ASME B16.11	3 x 3/4	CH90SE0F	1
4	ELBOW 90 LR S40 BW A420-WPL6 ASME B16.9	3	EL04BE1C	6
5	STRAIGHT NIPPLE S80 SMLS TOE A333-6 (L=100mm) ASME B36.10	3/4	NI08YNA0G	1
6	CAP 3000# NPT A350-LF2 CL.1 ASME B16.11	3/4	KA90NE0F	1
	FLANGES			
7	FLANGE WELDING NECK S40 150# RF A350-LF2 CL.1 ASME B16.5 SRF	3	F12W04RE0F	3
	SUPPORTS			
8	STRESS SUPPORT	3	1A1-ATTA-3"-	10

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	GASKETS			
9	GASKET 150# RF SHEET NON-ASBESTOS 2mm THK KLINGER C-4430 or EQ. ASME B16.21	3	G12S1Q19	3
	BOLTS			
10	90 STUD BOLT ASTM A320-Gr.L7 + 2 HEAVY HEX NUTS A194-Gr.4 ASME B18.2 PTFE COATED	5/8	BSP0IUP	12
	VALVES / IN-LINE ITEMS			
11	VALVE GATE 150# RF A352-LCB BODY W/304SS TRIM HF-BODY SEAT & DISC SEAT OSY-BB FLEXIBLE WEDGE	3	VGA2R1	1
12	VALVE GATE 800# SW A350-LF2 CL.1 BODY W/304SS TRIM HF-BODY SEAT & DISC SEAT OSY-BB SOLID WEDGE	3/4	VGU2S1	1

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<1>	2635	3		<2>	421	3	
<3>	386	3		<4>	100	3/4	
<5>	200	3		<6>	2567	3	
<7>	3636	3		<8>	1144	3	

Piping Supervision
شرکت رایان پلیمر پویا
(سهامی خاص)
نظارت پایپینگ

Petro Pars Engineering & Construction Co.
شرکت فنی و مهندسی پتروپارس

PROJECT:	HDPE PLANT AND UTILITY (2146)		
OWNER:	RAYAN POLYMER POUYA COMPANY		
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY		
DOCUMENT NO.:	2146-ISO-25-0010		
LINE NO.:	3"-BRS-41001-1A1-CA	ISOMETRIC NO.: ISO-25-1003	SHT NO.: 1 /1
REF. P&ID DWG.:	8022/4101		
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12		

PRESSURE (barg.) DESIGN:	8, FV
PRESSURE (barg.) OPERATING:	3.5
TEMPERATURE (C.) DESIGN:	-15~85
TEMPERATURE (C.) OPERATING:	-10
INSULATION TYPE:	CA
INSULATION THK (mm):	40
TEST FLUID:	Water
TEST PRESSURE: (barg.)	12
PAINT:	P-4
NDT:	A
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	2
LINE CLASS:	1A1

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	TOTALLY HOLD	M.IM	R.D	M.A

NOTE
1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

THIS DOCUMENT AND THE DESIGN IT COVERS IS THE PROPERTY OF POGC AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.