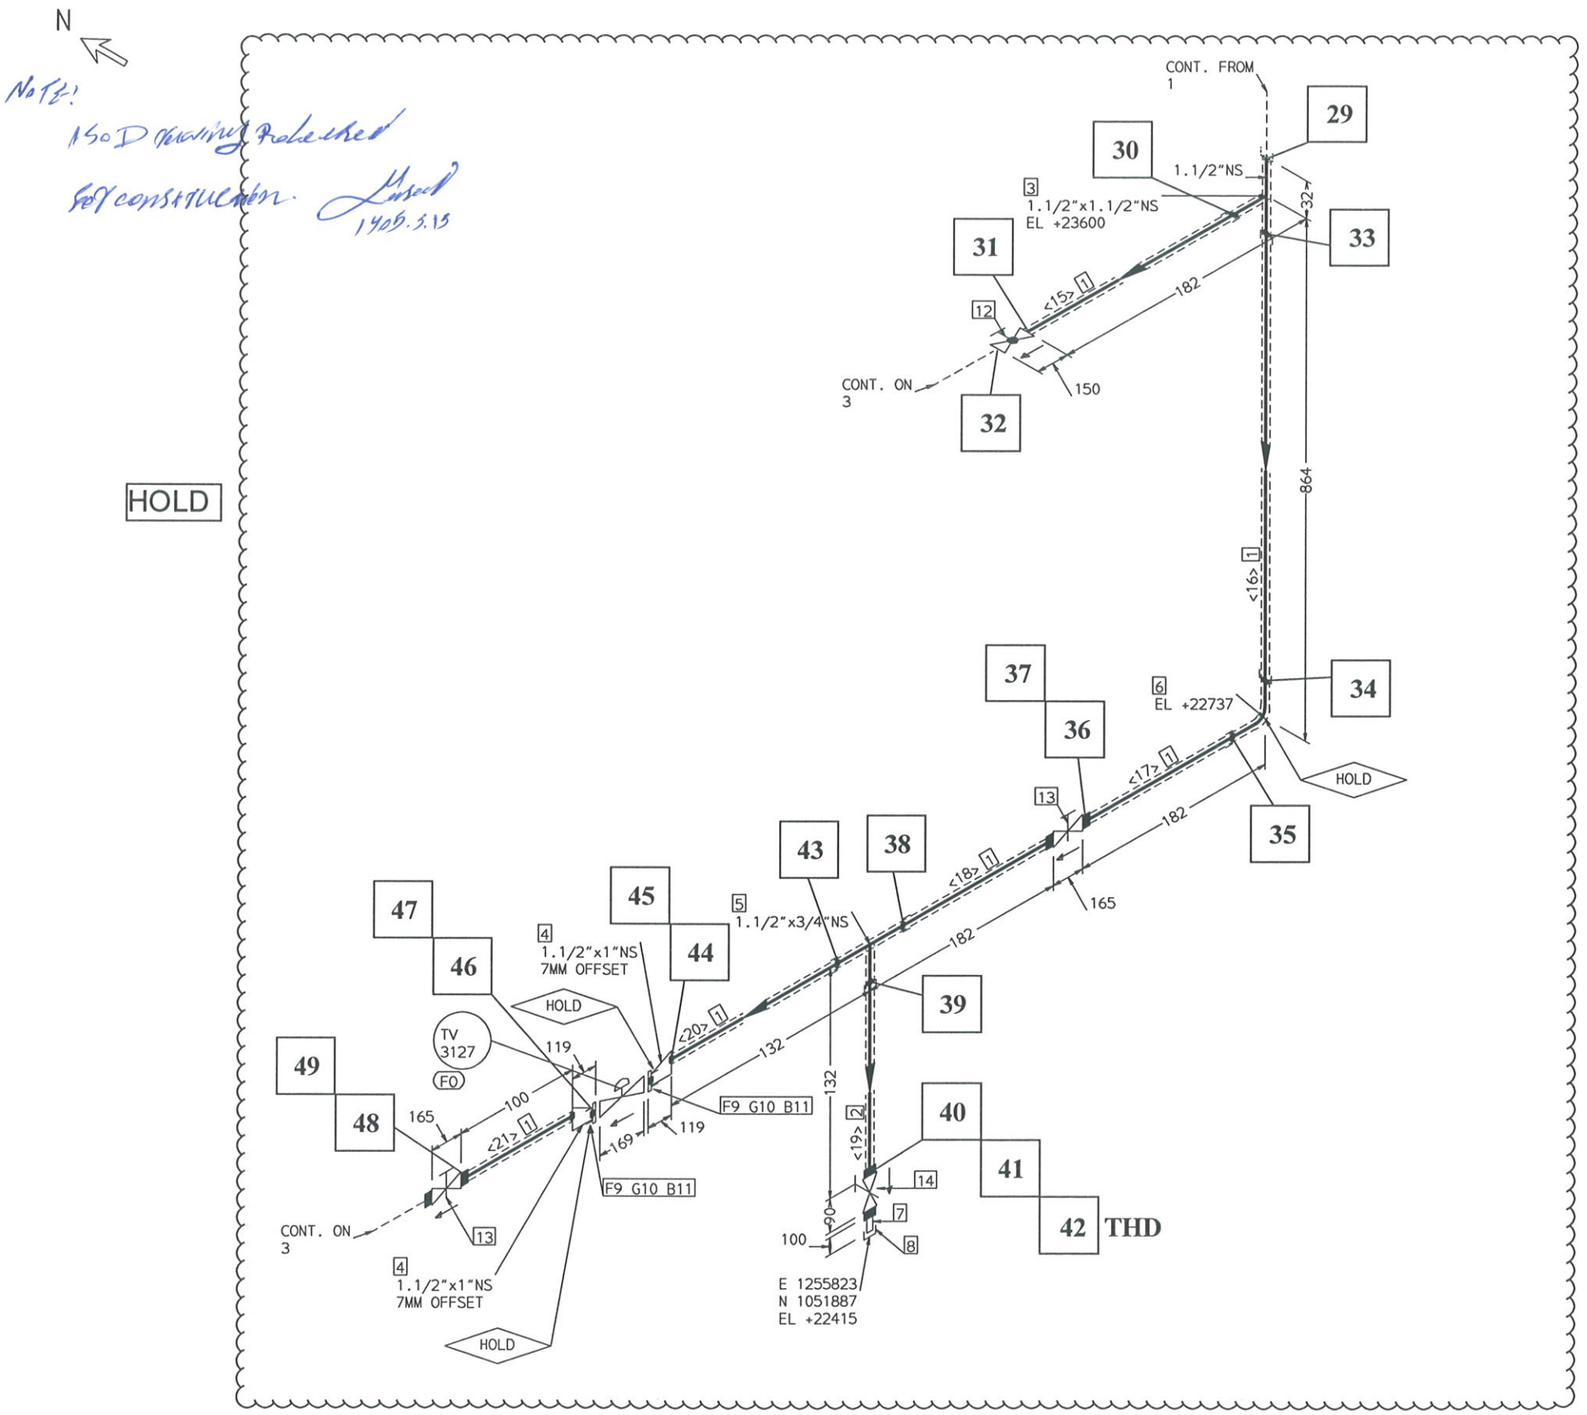


HOLD

FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE S80 PE SMLS API 5L-B PSL1 ASME B36.10	1.1/2	P08A0C	1.5M
2	PIPE S80 PE SMLS API 5L-B PSL1 ASME B36.10	3/4	P08A0C	0.1M
	FITTINGS			
3	EQUAL TEE 3000# SW A105 ASME B16.11	1.1/2 x 1.1/2	TT9090SE0A	1
4	SWAGED NIPPLE ECC. S80 S80 PBE A234-WPB MSS SP-95	1.1/2 x 1	NSE90YYE0A	2
5	REDUCING TEE 3000# SW A105 ASME B16.11	1.1/2 x 3/4	TT9090SE0A	1
6	ELBOW 90 3000# SW A105 ASME B16.11	1.1/2	EL90SE0A	1
7	STRAIGHT NIPPLE S80 TOE SMLS API 5L-B PSL1 (L=100mm) ASME B36.10	3/4	NI08YNA0C	1
8	CAP 3000# NPT A105 ASME B16.11	3/4	KA90NE0A	1
	FLANGES			
9	FLANGE SOCKET WELD S80 150# RF A105 ASME B16.5 SRF	1	F12K08RE0A	2

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	GASKETS			
10	GASKET 150# RF GRAPHITE W/SS REINFORCEMENT 2.0mm THK KLINGER PSM/AS or EQ. ASME B16.21	1	G12S1Q20	2
	BOLTS			
11	70 STUD BOLT ASTM A193 GR.B7 + 2 HEAVY HEX NUTS ASTM A194 GR.2H ASME B18.2 PTFE COATED	1/2	BSP0CUP	8
	VALVES / IN-LINE ITEMS			
12	VALVE GLOBE 800# SW A105 BODY W/13Cr TRIM HF-BODY SEAT & DISC SEAT OSY-BB HAND WHEEL OP.	1.1/2	VOU1S2	1
13	VALVE GATE 800# SW A105 BODY W/13Cr TRIM HF-BODY SEAT & DISC SEAT OSY-BB SOLID WEDGE HAND WHEEL OP.	1.1/2	VGU1S2	2
14	VALVE GATE 800# SW A105 BODY W/13Cr TRIM HF-BODY SEAT & DISC SEAT OSY-BB SOLID WEDGE HAND WHEEL OP.	3/4	VGU1S2	1

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<15>	150	1.1/2		<16>	800	1.1/2	
<17>	150	1.1/2		<18>	150	1.1/2	
<19>	100	3/4		<20>	100	1.1/2	
<21>	100	1.1/2					

PROJECT:	HDPE PLANT AND UTILITY (2146)
OWNER:	RAYAN POLYMER POUYA COMPANY
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY
DOCUMENT NO.:	2146-ISO-25-0010
LINE NO.:	11/2"-HWS-31003-1P2-HB
ISOMETRIC NO.:	ISO-25-1017
SHT NO.:	2 /4
REF. P&ID DWG.:	8059/3104
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12

PRESSURE (barg.) DESIGN:	8 , FV
PRESSURE (barg.) OPERATING:	5
TEMPERATURE (C.) DESIGN:	120
TEMPERATURE (C.) OPERATING:	75-100
INSULATION TYPE:	HB
INSULATION THK (mm):	50
TEST FLUID:	Water
TEST PRESSURE (barg.):	12.0
PAINT:	P-4
NDT:	A
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	1
LINE CLASS:	1P2

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	ISSUED FOR CONSTRUCTION (WITH HOLD)	M.IM	R.D	M.A

NOTE

1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

Piping Supervision
شرکت رایان پلیمر پویا
(سهامی خاص)
نظارت پایپینگ

THIS DOCUMENT AND THE DESIGN IT COVERS IS THE PROPERTY OF POSC AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.