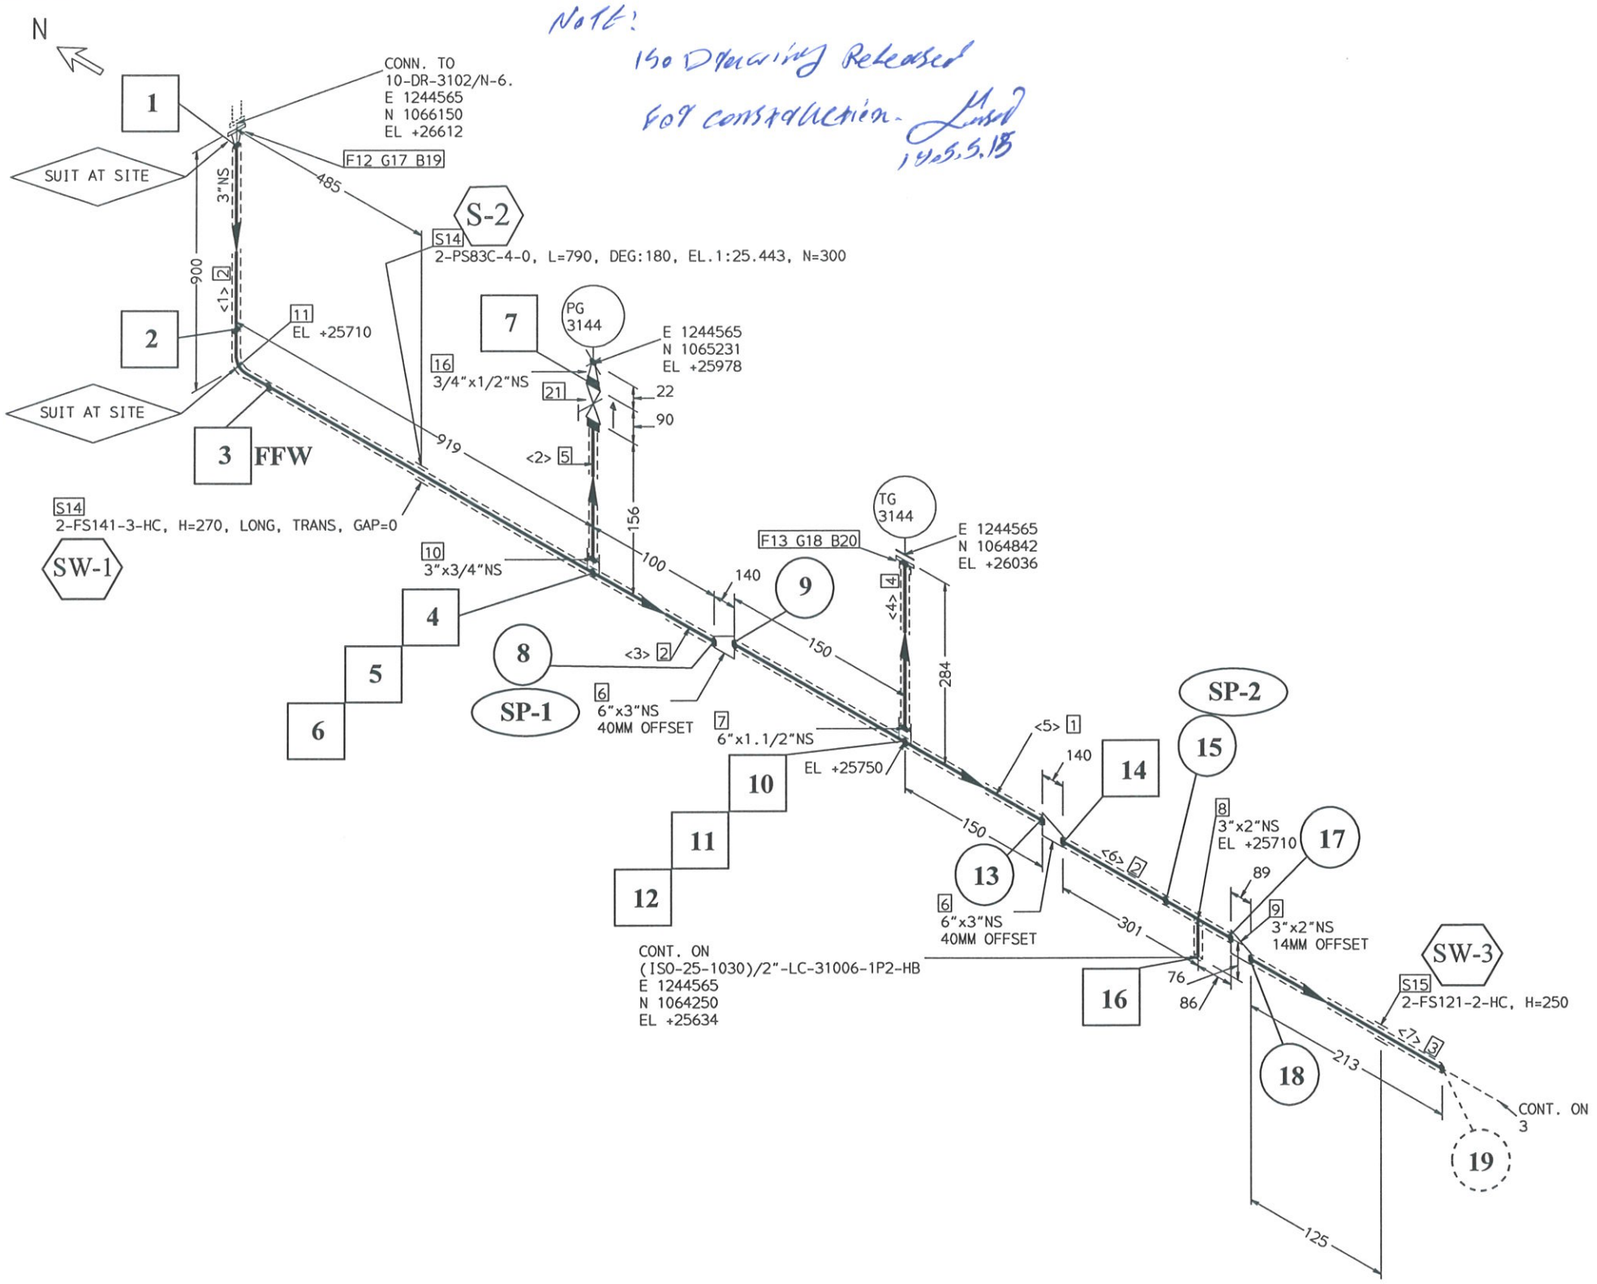


FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE S40 BE ERW(EJ=0.85) API 5L-B PSL1 ASME B36.10	6	P04D1A	0.3M
2	PIPE S40 BE ERW(EJ=0.85) API 5L-B PSL1 ASME B36.10	3	P04D1A	1.9M
3	PIPE S40 BE ERW(EJ=0.85) API 5L-B PSL1 ASME B36.10	2	P04D1A	0.3M
4	PIPE S80 PE SMLS API 5L-B PSL1 ASME B36.10	1.1/2	P08A0C	0.2M
5	PIPE S80 PE SMLS API 5L-B PSL1 ASME B36.10	3/4	P08A0C	0.1M
	FITTINGS			
6	REDUCER ECCENTRIC S40 S40 BW A234-WPBW ERW(EJ=0.85) ASME B16.9	6 x 3	RE0404BE2A	2
7	HALF COUPLING 3000# SW A105 ASME B16.11	6 x 1.1/2	CH90SE0A	1
8	REDUCING TEE S40 S40 BW A234-WPBW ERW(EJ=0.85) ASME B16.9	3 x 2	TT0404BE2A	1
9	REDUCER ECCENTRIC S40 S40 BW A234-WPBW ERW(EJ=0.85) ASME B16.9	3 x 2	RE0404BE2A	1
10	HALF COUPLING 3000# SW A105 ASME B16.11	3 x 3/4	CH90SE0A	1
11	ELBOW 90 LR S40 BW A234-WPBW ERW(EJ=0.85) ASME B16.9	3	EL04BE2A	1
	FLANGES			
12	FLANGE WELDING NECK S40 150# RF A105 ASME B16.5 SRF	3	F12W04RE0A	1
13	FLANGE SOCKET WELD S80 150# RF A105 ASME B16.5 SRF	1.1/2	F12K08RE0A	1
	SUPPORTS			
14	STRESS SUPPORT	3	1P2-ATTA-3"-	2
15	STRESS SUPPORT	2	1P2-ATTA-2"-	1

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	FITTINGS			
16	REDUCER INSERT 3000# PLE X TSE (NPTF) A105 MANUF. STD	3/4 x 1/2	RI90SE0A	1
	GASKETS			
17	GASKET 150# RF GRAPHITE W/SS REINFORCEMENT 2.0mm THK KLINGER PSM/AS or EQ. ASME B16.21	3	G12S1Q20	1
18	GASKET 150# RF GRAPHITE W/SS REINFORCEMENT 2.0mm THK KLINGER PSM/AS or EQ. ASME B16.21	1.1/2	G12S1Q20	1
	BOLTS			
19	90 STUD BOLT ASTM A193 GR.B7 + 2 HEAVY HEX NUTS ASTM A194 GR.2H ASME B18.2 PTFE COATED	5/8	BSP0CUP	4
20	70 STUD BOLT ASTM A193 GR.B7 + 2 HEAVY HEX NUTS ASTM A194 GR.2H ASME B18.2 PTFE COATED	1/2	BSP0CUP	4
	VALVES / IN-LINE ITEMS			
21	VALVE GATE 800# SW A105 BODY W/13Cr TRIM HF-BODY SEAT & DISC SEAT OSY-BB SOLID WEDGE HAND WHEEL OP.	3/4	VGU1S2	1

****
* CONT. ON 2 *
****

PROJECT:	HDPE PLANT AND UTILITY (2146)
OWNER:	RAYAN POLYMER POUYA COMPANY
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY
DOCUMENT NO.:	2146-ISO-25-0010
LINE NO.:	3"-LC-31002-1P2-HC
ISOMETRIC NO.:	ISO-25-1026
SHT NO.:	1 /3
REF. P&ID DWG.:	3104/8059(1)
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12

PRESSURE (barg.) DESIGN:	1 , FV
PRESSURE (barg.) OPERATING:	ATM
TEMPERATURE (C.) DESIGN:	130
TEMPERATURE (C.) OPERATING:	100
INSULATION TYPE:	HC
INSULATION THK (mm):	70
TEST FLUID:	Water
TEST PRESSURE: (barg.)	1.5
PAINT:	P-4
NDT:	A
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	2
LINE CLASS:	1P2

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	ISSUED FOR CONSTRUCTION(WITH HOLD)	M.IM	R.D	M.A

NOTE
1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

Petro Pars Ghodrat Co.

Piping Supervision

THIS DOCUMENT, AND THE DESIGN IT COVERS IS THE PROPERTY OF POGC AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.