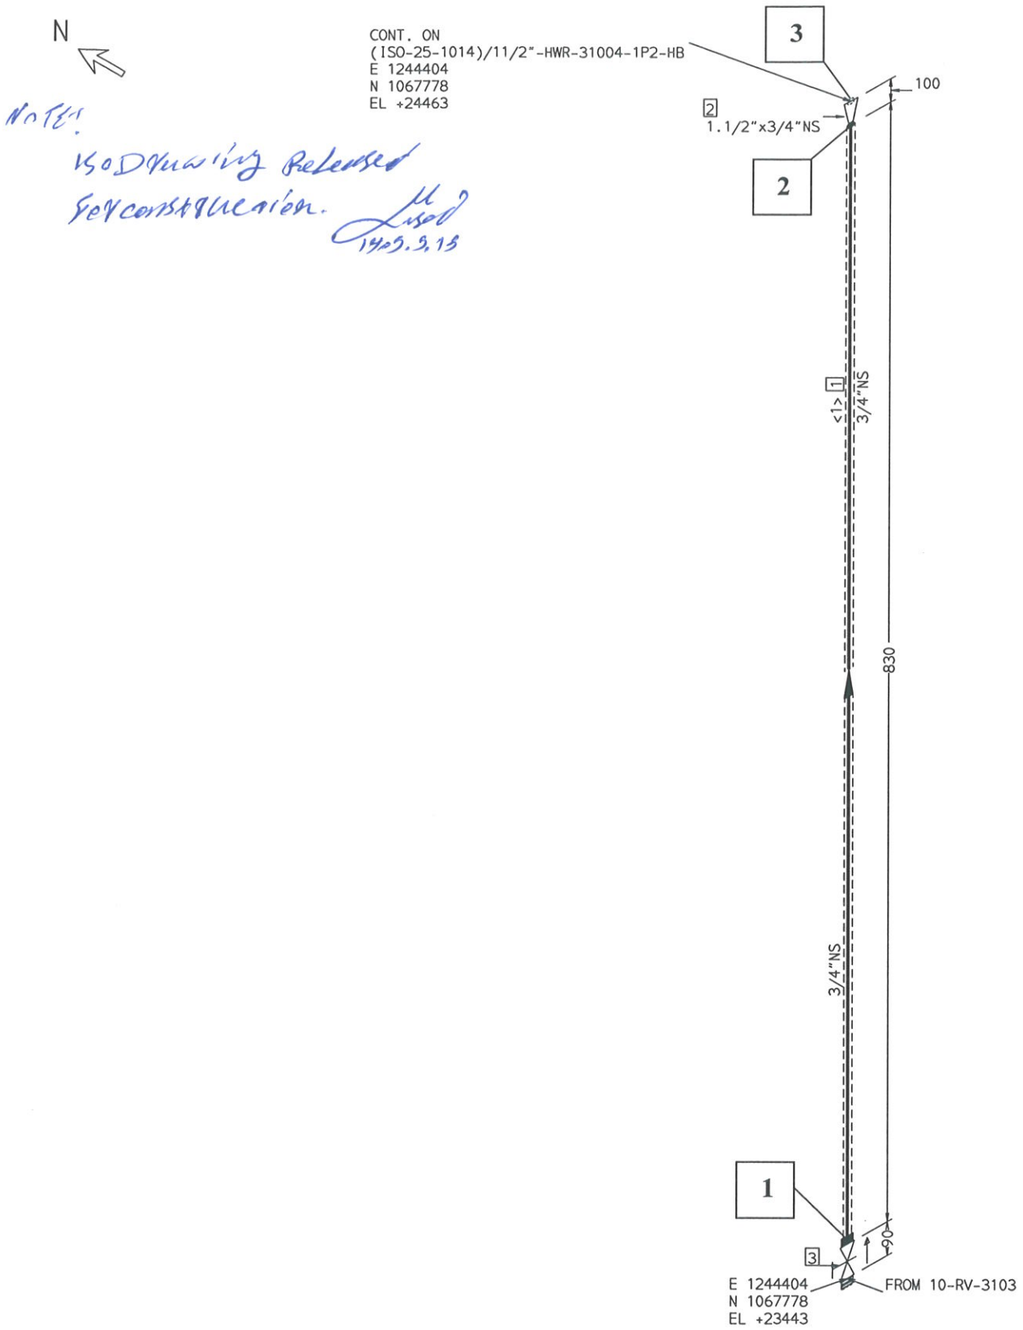


Notes:
ISO Drawing Released for Construction.
14-05-13

FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE S80 PE SMLS API 5L-B PSL1 ASME B36.10	3/4	P08A0C	0.9M
	FITTINGS			
2	SWAGED NIPPLE CON. S80 S80 PBE A234-WPB MSS SP-95	1.1/2 x 3/4	NSC90YYE0A	1

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	VALVES / IN-LINE ITEMS			
3	VALVE GATE 800# SW A105 BODY W/13Cr TRIM HF-BODY SEAT & DISC SEAT OSY-BB SOLID WEDGE HAND WHEEL OP.	3/4	VGU1S2	1

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<1>	830	3/4					

PROJECT:	HDPE PLANT AND UTILITY (2146)
OWNER:	RAYAN POLYMER POUYA COMPANY
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY
DOCUMENT NO.:	2146-ISO-25-0010
LINE NO.:	3/4"-HWR-31004-1P2-HB
ISOMETRIC NO.:	ISO-25-1015
SHT NO.:	1 /1
REF. P&ID DWG.:	4101/8059
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12

PRESSURE (barg)	
DESIGN:	8 , FV
OPERATING:	4.5
TEMPERATURE (C.)	
DESIGN:	120
OPERATING:	75-100
INSULATION	
TYPE:	HB
THK (mm):	50
TEST	
FLUID:	Water
PRESSURE: (barg.)	12.0

PAINT:	P-4
NDT:	A
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	1
LINE CLASS:	1P2

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	TOTALLY HOLD	M.IM	R.D	M.A

NOTE
1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

Piping Supervision
شرکت رایان پلیمر پویا
نظارت پایپینگ

THIS DOCUMENT AND THE DESIGN IT COVERS IS THE PROPERTY OF POGC AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.