
N

NOTE!
Iso Drawing Released
for construction. 14.05.15

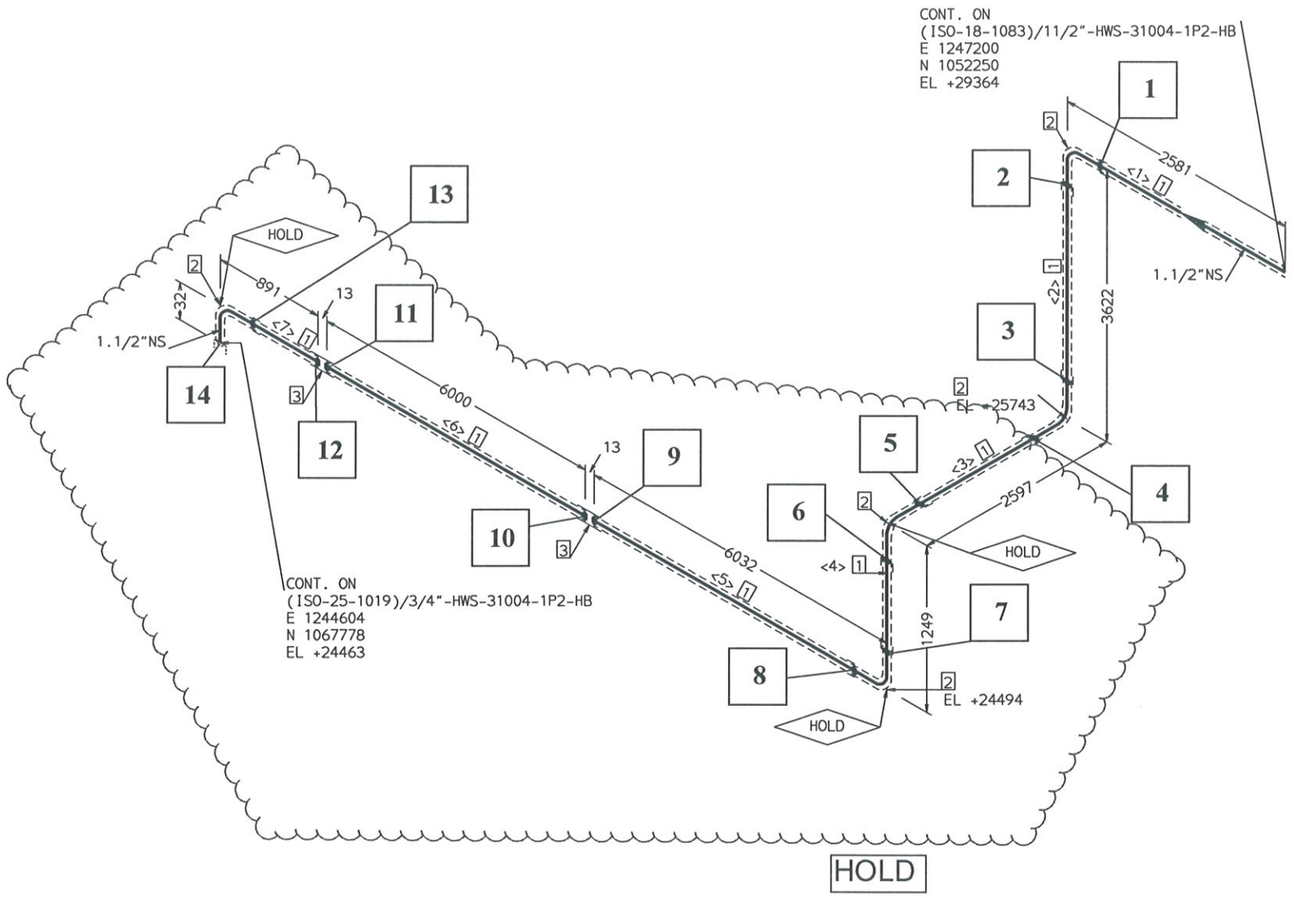

FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE S80 PE SMLS API 5L-B PSL1 ASME B36.10	1.1/2	P08A0C	22.7M
	FITTINGS			
2	ELBOW 90 3000# SW A105 ASME B16.11	1.1/2	EL90SE0A	5
3	FULL COUPLING 3000# SW A105 ASME B16.11	1.1/2	CF90SE0A	2

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<1>	2549	1.1/2		<2>	3558	1.1/2	
<3>	2533	1.1/2		<4>	1185	1.1/2	
<5>	6000	1.1/2		<6>	6000	1.1/2	
<7>	859	1.1/2					

HOLD

PROJECT:	HDPE PLANT AND UTILITY (2146)	
OWNER:	RAYAN POLYMER POUYA COMPANY	
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY	
DOCUMENT NO.:	2146-ISO-25-0010	
LINE NO.:	11/2"-HWS-31004-1P2-HB	ISOMETRIC NO.: ISO-25-1018 SHT NO.: 1 /1
REF. P&ID DWG.:	8059/3104	
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12	

PRESSURE (barg.) DESIGN:	8 , FV
PRESSURE (barg.) OPERATING:	5
TEMPERATURE (C.) DESIGN:	120
TEMPERATURE (C.) OPERATING:	75-100
INSULATION TYPE:	HB
INSULATION THK (mm):	50
TEST FLUID:	Water
TEST PRESSURE: (barg.)	12.0
PAINT:	P-4
NDT:	A
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	1
LINE CLASS:	1P2

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	ISSUED FOR CONSTRUCTION (WITH HOLD)	M. IM	R.D	M.A

NOTE
1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

Piping Supervision
شرکت رایان پلیمر پویا
(سهامی خاص)
نظارت پایپینگ

THIS DOCUMENT AND THE DESIGN IT COVERS IS THE PROPERTY OF PDMC AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.