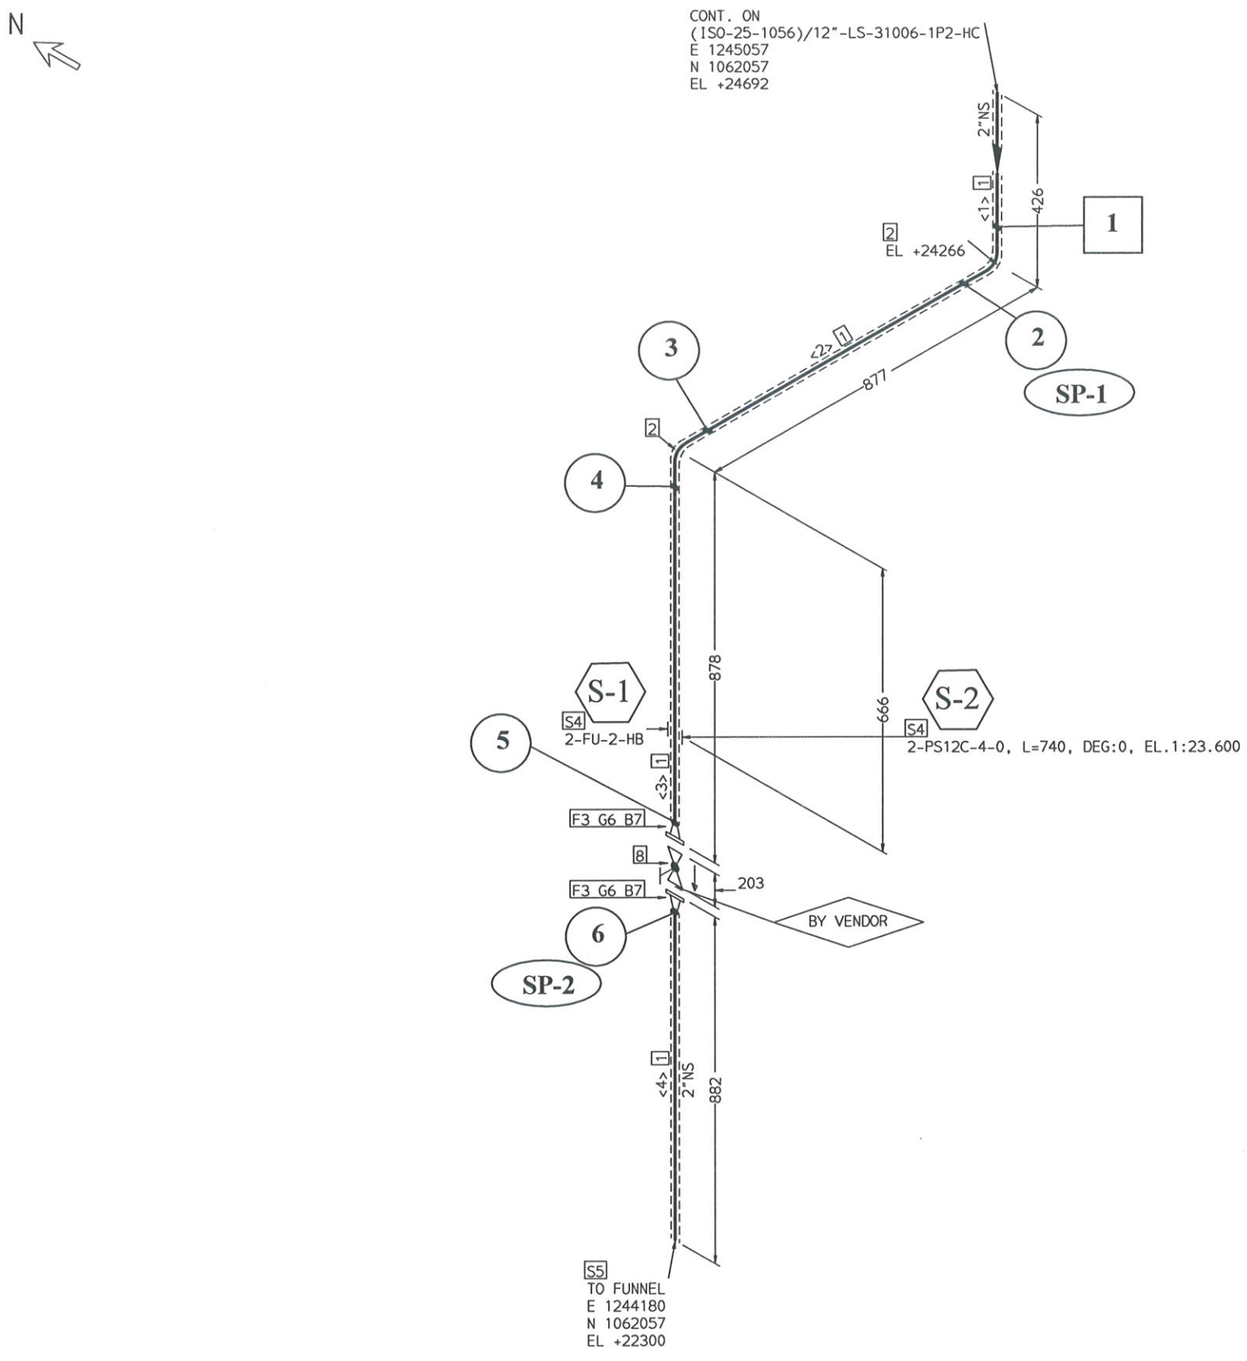


FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE S40 BE ERW(EJ=0.85) API 5L-B PSL1 ASME B36.10	2	P04D1A	2.7M
	FITTINGS			
2	ELBOW 90 LR S40 BW A234-WPBW ERW(EJ=0.85) ASME B16.9	2	EL04BE2A	2
	FLANGES			
3	FLANGE WELDING NECK S40 150# RF A105 ASME B16.5 SRF	2	F12W04RE0A	2
	SUPPORTS			
4	STRESS SUPPORT	2	1P2-ATTA-2"-	2
5	General purpose ATTA	2	1P2-ATTA-2"-	1

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	GASKETS			
6	GASKET 150# RF GRAPHITE W/SS REINFORCEMENT 2.0mm THK KLINGER PSM/AS or EQ. ASME B16.21	2	G12S1Q20	2
	BOLTS			
7	90 STUD BOLT ASTM A193 GR.B7 + 2 HEAVY HEX NUTS ASTM A194 GR.2H ASME B18.2 PTFE COATED	5/8	BSPOCUP	8
	VALVES / IN-LINE ITEMS			
8	VALVE GLOBE 150# RF A216-WCB BODY W/13Cr TRIM HF-BODY SEAT & DISC SEAT OSY-BB HAND WHEEL OP.	2	VOA1R3	1

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<1>	350	2		<2>	725	2	
<3>	738	2		<4>	818	2	

Piping Supervision
شرکت رایان پلیمر پویا
(سهامی خاص)
نظارت پایپینگ

شرکت فنی و مهندسی پتروپارس قدرت
Petro Pars Ghodrat Co.
واحد دفتر فنی پایپینگ

PROJECT:	HDPE PLANT AND UTILITY (2146)
OWNER:	RAYAN POLYMER POUYA COMPANY
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY
DOCUMENT NO.:	2146-ISO-25-0010
LINE NO.:	2"-LC-31015-1P2-HB
ISOMETRIC NO.:	ISO-25-1034
SHT NO.:	1 /1
REF. P&ID DWG.:	3104
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12

PRESSURE (barg.) DESIGN:	1 , FV
PRESSURE (barg.) OPERATING:	0.2
TEMPERATURE (C.) DESIGN:	130
TEMPERATURE (C.) OPERATING:	105
INSULATION TYPE:	HC
INSULATION THK (mm):	60
TEST FLUID:	Water
TEST PRESSURE: (barg.)	1.5
PAINT:	P-4
NDT:	A
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	1
LINE CLASS:	1P2

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	ISSUED FOR CONSTRUCTION	M. IM	R.D	M.A

NOTE
1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

THIS DOCUMENT AND THE DESIGN IT COVERED IS THE PROPERTY OF POG; AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART MAY BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.