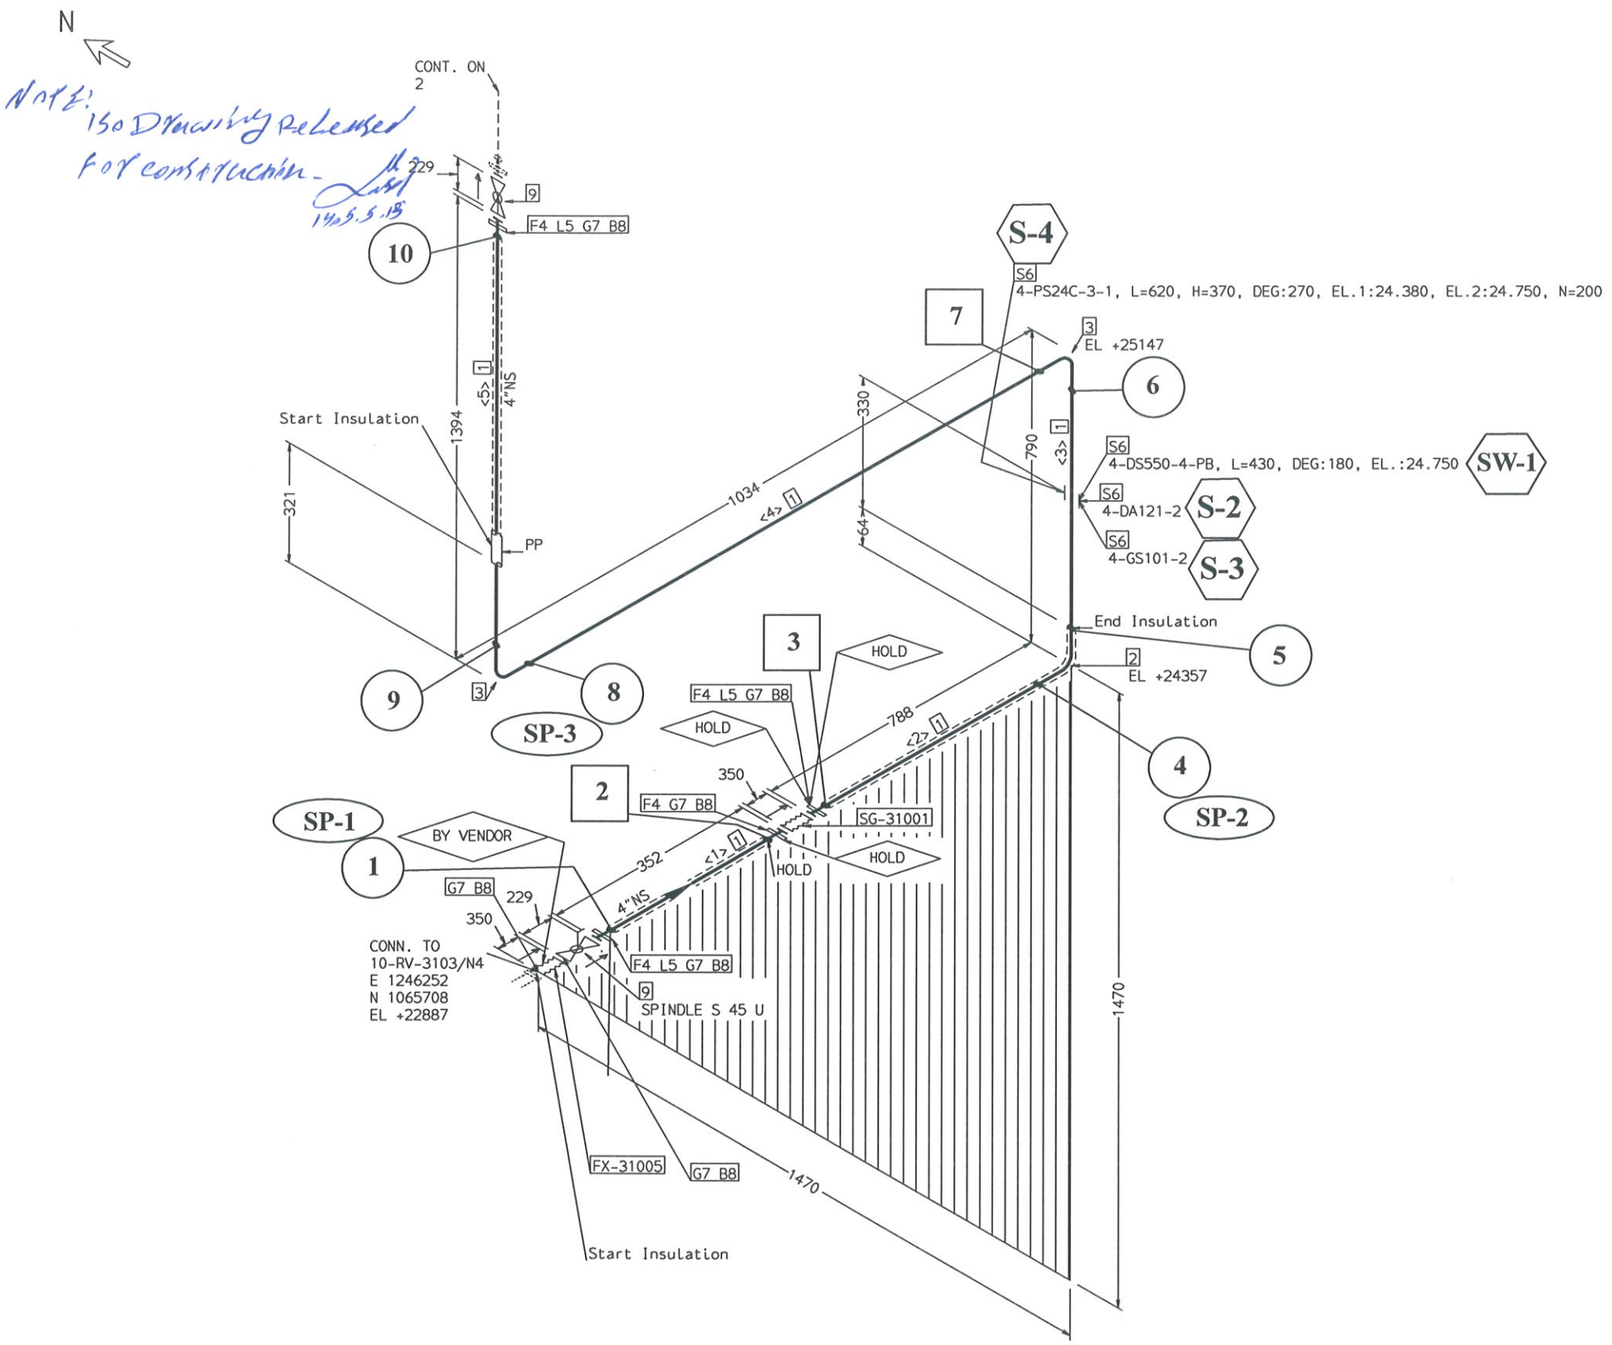


FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	PIPE			
1	PIPE 10S BE EFW(EJ=1) A312-TP304 ASME B36.19	4	P11C1A	3.4M
	FITTINGS			
2	ELBOW 45 LR 10S BW A403-WP304-W EFW(EJ=1) ASME B16.9	4	EK11BG2A	1
3	ELBOW 90 LR 10S BW A403-WP304-W EFW(EJ=1) ASME B16.9	4	EL11BG2A	2
	FLANGES			
4	FLANGE LAP JOINT 150# FF A105 ASME B16.5	4	F12RAE0A	4
5	STUB END SP 10S BW A403-WP304-W EFW(EJ=1) ASME B16.9	4	S12E11RG2A	4
	SUPPORTS			
6	STRESS SUPPORT	4	1S1-ATTA-4"-	4

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (INS)	ITEM CODE	QTY
	GASKETS			
7	GASKET 150# RF SHEET NON-ASBESTOS 2mm THK KLINGER C-4430 or EQ. ASME B16.21	4	G12S1Q19	6
	BOLTS			
8	90 STUD BOLT ASTM A193 GR.B7 + 2 HEAVY HEX NUTS ASTM A194 GR.2H ASME B18.2 PTFE COATED	5/8	BSP0CUP	48
	VALVES / IN-LINE ITEMS			
9	VALVE BALL 150# RF A351-CF8 BODY W/304SS BALL TEFLON SEAT FB FLOATING LEVER OP. LONG PA. ASME B16.10 API 608	4	VBA4R1	2

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS	PIECE NO	CUT LENGTH	N.S. (INS)	REMARKS
<1>	200	4		<2>	648	4	
<3>	574	4		<4>	730	4	
<5>	1166	4					

PROJECT:	HDPE PLANT AND UTILITY (2146)
OWNER:	RAYAN POLYMER POUYA COMPANY
CONTRACTOR:	HAMPA ENERGY ENGINEERING & DESIGN COMPANY
DOCUMENT NO.:	2146-ISO-25-0010
LINE NO.:	4"-XN-31018-1S1-PB
ISOMETRIC NO.:	ISO-25-1071
SHT NO.:	1 /2
REF. P&ID DWG.:	3104
REF. PLAN DWG.:	2146-10-20-DD-PI-DWG-0011-12

PRESSURE (barg.) DESIGN:	0.3
OPERATING:	0.04
TEMPERATURE (C.) DESIGN:	120
OPERATING:	100
INSULATION TYPE:	PB
THK (mm):	25
TEST FLUID:	Air
PRESSURE: (barg.)	0.3
PAINT:	P-4
NDT:	B
PWHT:	ASME B31.3
LOCATION:	AG
LEVEL:	3
LINE CLASS:	1S1

REV.	DATE	DESCRIPTION	PRE'D.	CHE'D BY	APP'D BY
0	01.08.2026	TOTALLY HOLD	M.IM	R.D	M.A

NOTE

1- ROOT GAPS OF BUTT WELD FITTINGS ARE NOT INCLUDED IN DIMENSIONS
2- ISOMETRIC DRAWING FOR 1 1/2" AND SMALLER PIPINGS ARE JUST FOR INFORMATION. PIPING ROUTING, DIMENSIONS AND ELEVATIONS TO BE CHECKED BY CONSTRUCTION CONSTRUCTOR BEFORE INSTALLATION.
3- FOR 1 1/2" AND SMALLER, SUPPORTS TO BE SELECTED BY CONSTRUCTION CONSTRUCTOR EXCEPT AS NOTED.
4- ACTUAL DIMENSION AND SIZE OF SPECIAL/INSTRUMENT ITEMS SHALL BE CHECKED BEFORE SPOOL FABRICATION BY CONSTRUCTION CONTRACTOR.

Piping Supervision
شرکت رایان پلیمر پویا
(سهامی خاص)
نظارت پایپینگ

شرکت فنی و مهندسی پتروپارس قدرت
Petro Pars Ghodrat Co.
گروه پروژه‌های رایان پلیمر
دفتر فنی پایپینگ

THIS DOCUMENT AND THE DESIGN IT COVERS IS THE PROPERTY OF PDRO AND ALL RIGHTS ARE RESERVED. NEITHER IN WHOLE NOR IN PART SHALL BE REPRODUCED OR TRANSMITTED TO THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT OF OWNER.