


HPOU: MITSUBISHI MSZ-FS12NA
HPIU: MITSUBISHI MUZ-FS12NA

EXPECTED HEATING CAPACITY
AT 5 DEG. F: 13.4 kBTUh

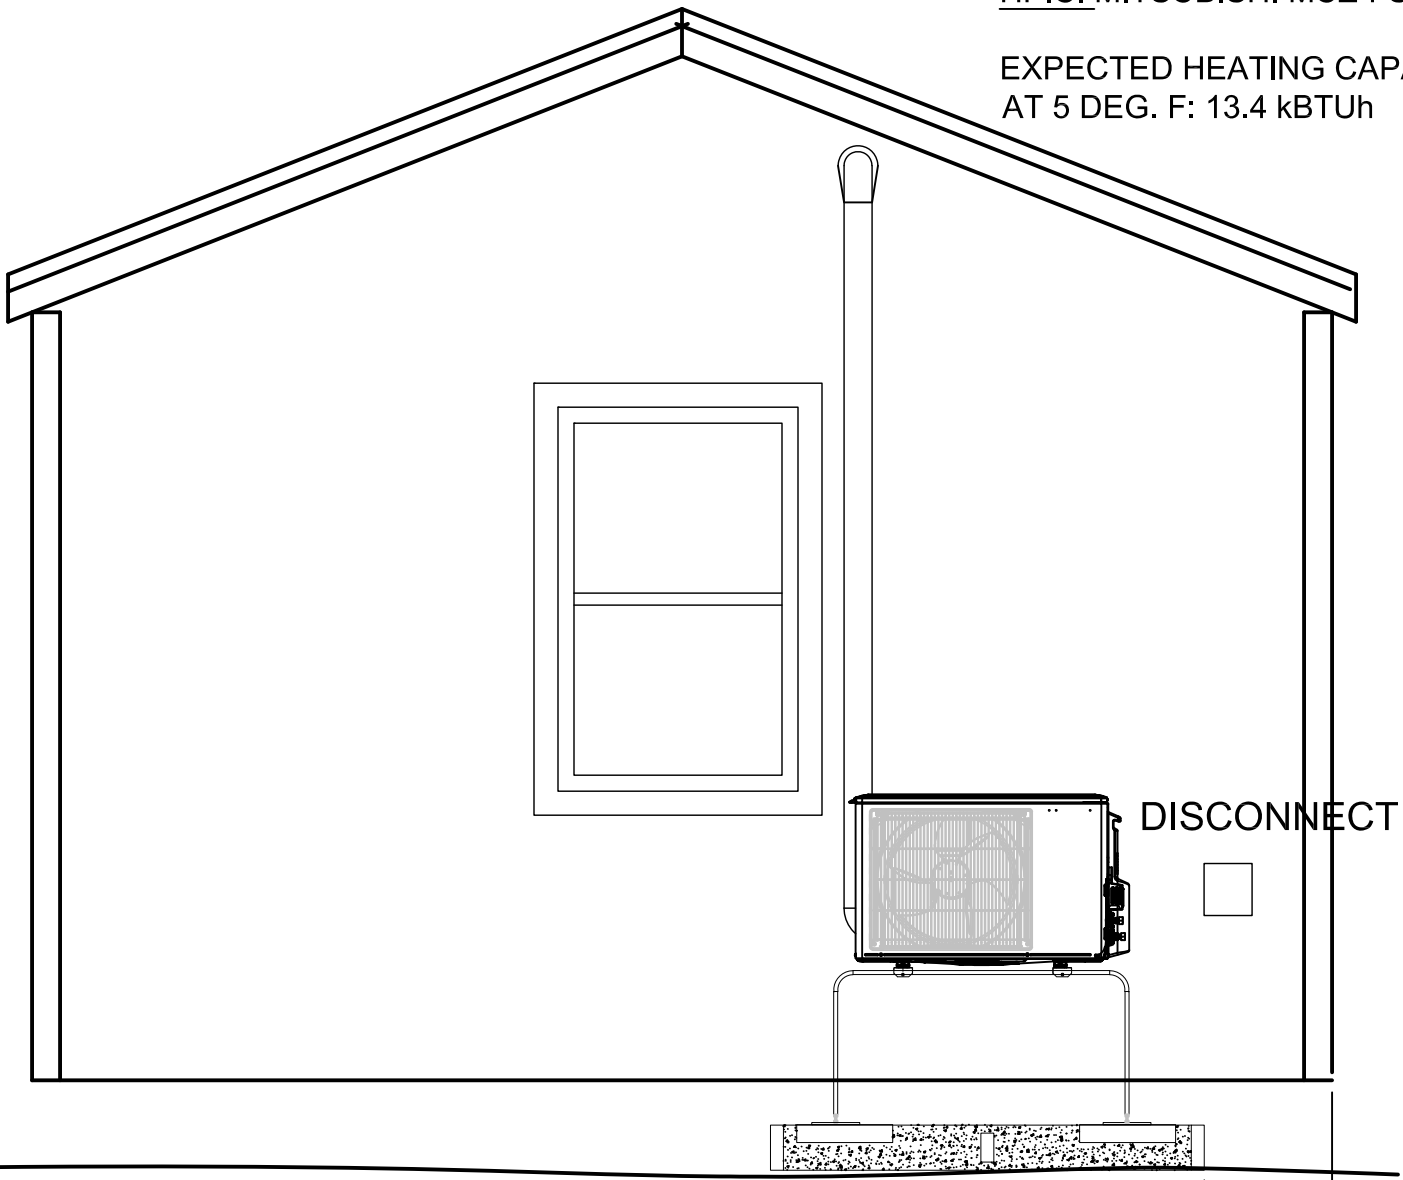

ELEVATION

SCALE: $\frac{1}{2}$ " = 1'0"

OCTOBER ENGINEERING LLC

Palermo, ME

207-649-0505

Sudbury, Ma

508-561-7553

NEWMAN COLD CLIMATE HEAT PUMP SYSTEM

1119 TURNER RIDGE ROAD
PALERMO, ME 04354

10-16-22

H-2
2 OF 2