



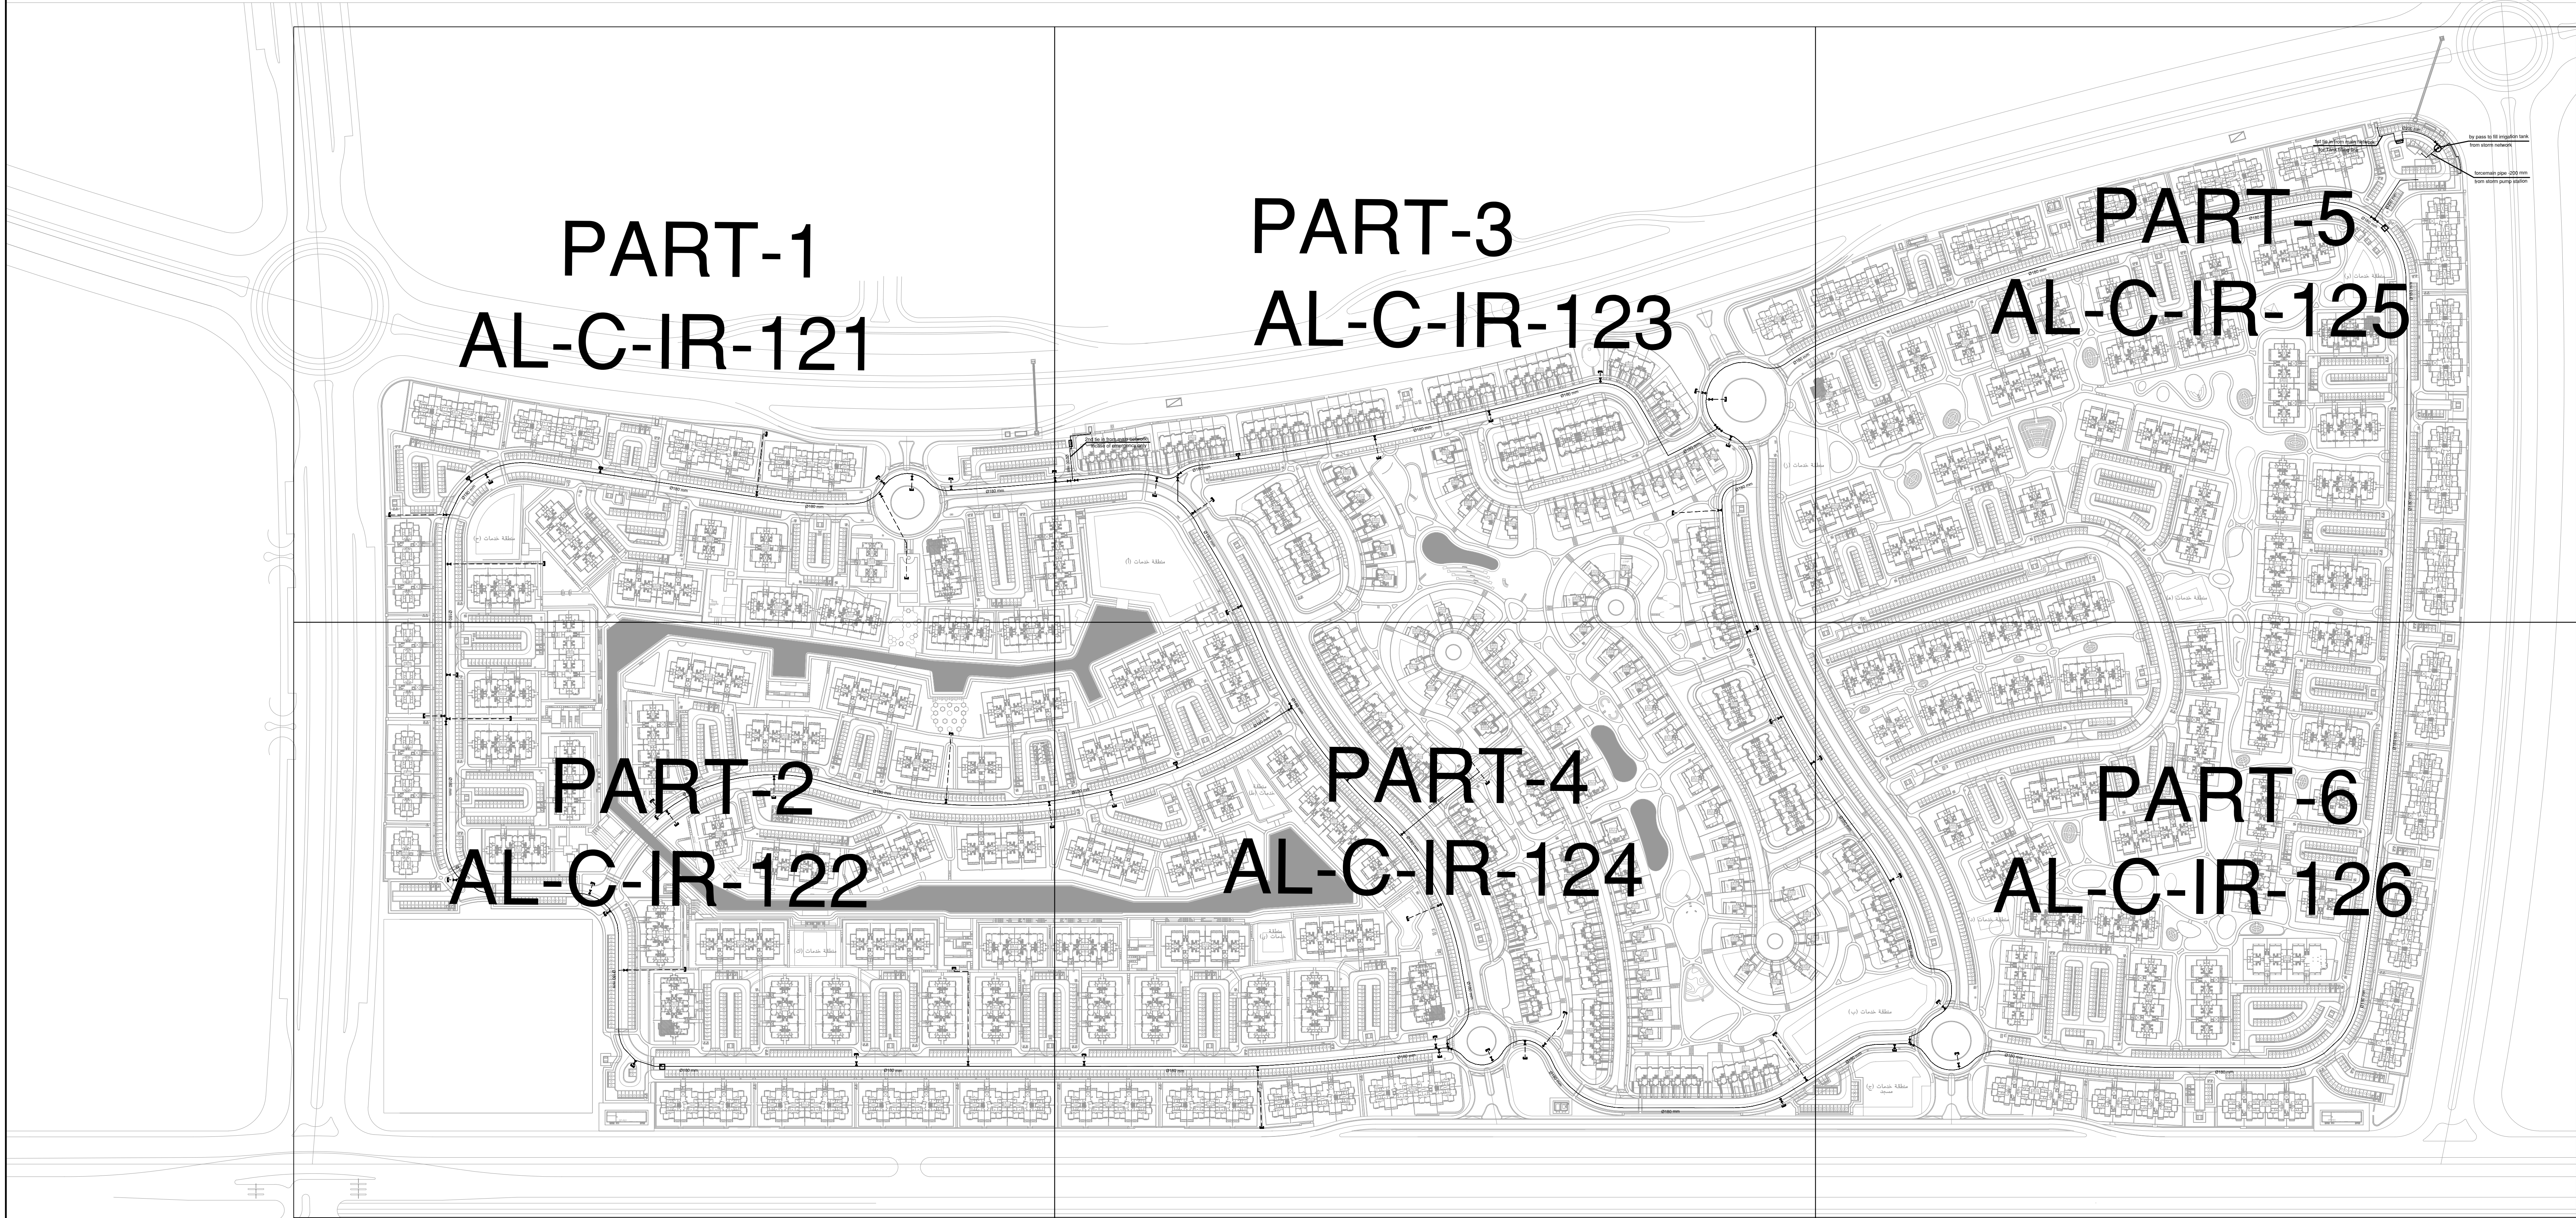

Road 1

- NOTES
1. PIPE DIAMETERS ARE SHOWN IN MILLIMETERS FOR NOMINAL DIAMETERS UNLESS OTHERWISE INDICATED.
 2. ALL PIPES SHALL BE HDPE WITH STANDING PRESSURE 10 BARS.
 3. PIPES SHALL BE LAID SUCH THAT THE MINIMUM SOIL COVER OVER PIPE CROWN NOT LESS THAN 120 CM.
 4. PIPES SHALL BE LAID INSIDE A SLEEVE AT ANY CROSSING WITH THE ROAD FOR MAINTENANCE.
 5. PIPES BESIDE PLANTS SHOULD BE PLACED INSIDE A CONCRETE ENCASMENT TO PROTECT PIPES FROM PLANT ROOTS.
 6. THE CONTRACTOR SHOULD COORDINATE THE FINAL LOCATION OF THE INS ACCORDING TO SITE CONDITION.
 7. THE CONTRACTOR SHOULD COORDINATE WITH OTHER UTILITIES DURING SITE CONSTRUCTION.
 8. FOR THE FINAL LOCATIONS OF INSPECTION CHAMBERS, FIRE HYDRANTS, WATER TANKS, PUMP ROOMS AND LIFT STATIONS REFER TO MASTER PLAN AND LANDSCAPE DRAWINGS.

- LEGEND
- PROPOSED IRRIGATION PIPE
 - IRRIGATION TIE IN - 110mm
 - GATE VALVE
 - FLOW WATER METER CHAMBER
 - END CAP
 - AIR VALVE
 - DRAIN VALVE

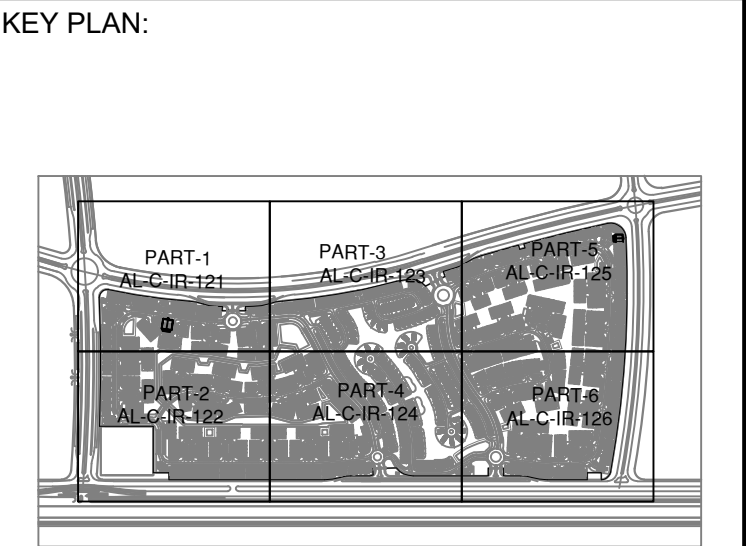

REV	DESCRIPTION	DATE
00	ISSUED FOR TENDER	JAN.2026

CLIENT:

MOUNTAIN VIEW
a place to look up to

QTY STAYS : 00MR ENCL WATER ST STAIR CAPITAL AL
PROPOSED WORK : 00MR ENCL WATER ST STAIR CAPITAL AL
TEL : +966 440 111 5 FAX : +966 440 111 5 MOB : +966 15 15 41

PROJECT NAME:

ALIVA
PHASE 01

CONSULTANTS:

DMA
DESIGN | ENGINEERING

87 El Mostahar Avenue, Jeddah 22, Jeddah District, El North, Cairo, Egypt
Tel: +966 2289 7566 / +966 2289 6309 Web: www.dma.com.eg

SHEET TITLE:

IRRIGATION NETWORK
KEY PLAN

SHEET REFERENCE NO:	DRW	2ME	DSN	2ME
AL-C-IR-120	CHK	RSS	APPRV	1MS
SCALE	1:2000			
PROJECT NO	DMA-I-M-040-000			
SHEET SERIAL NO.	01 OF 07	REVISION NO	00	